

**East Midlands Gateway
Phase 2 (EMG2)**

Document DCO 6.13J/MCO 6.13J

ENVIRONMENTAL STATEMENT

Volume 2 Technical Appendices

Appendix 13J

Sustainable Drainage Statement (EMG2 Works)

July 2025

13

The East Midlands Gateway Phase 2
and Highway Order 202X and The East Midlands Gateway
Rail Freight and Highway (Amendment) Order 202X

[SEGRO.COM/SLPEMG2](https://segro.com/slpemg2)

SEGRO

ENVIRONMENT

SEGRO (Properties) Ltd
East Midlands Gateway 2
Diseworth
Sustainable Drainage Statement – EMG2 Works

ENVIRONMENT

SEGRO (Properties) Ltd
East Midlands Gateway 2
Diseworth
Sustainable Drainage Statement – EMG2 Works

Birmingham
Livery Place, 35 Livery Street, Colmore Business District, Birmingham, B3 2PB
T: 0121 233 3322

Leeds
Whitehall Waterfront, 2 Riverside Way, Leeds
LS1 4EH
T: 0113 233 8000

London
11 Borough High Street
London, SE1 9SE
T: 0207 407 3879

Manchester
11 Portland Street, Manchester, M1 3HU
0161 233 4260

Nottingham
Waterfront House, Station Street, Nottingham NG2 3DQ
T: 0115 924 1100

June 2025

DOCUMENT ISSUE RECORD

Document Number:	EMG2-BWB-ZZ-XX-RP-CD-0001_SDS (EMG2 Works)
BWB Reference:	220500_SDS (EMG2 Works)

Revision	Date of Issue	Status	Author:	Checked:	Approved:
P01	20/05/2025	S2	Matthew Bailey BSc (Hons)	Rowan Jobling BEng (Hons)	Chris Dodd BEng (Hons) IEng MICE
P02	13/06/2025	S2	Matthew Bailey BSc (Hons)	Rowan Jobling BEng (Hons)	Chris Dodd BEng (Hons) IEng MICE
P03	25/06/2025	S2	Matthew Bailey BSc (Hons)	Rowan Jobling BEng (Hons)	Chris Dodd BEng (Hons) IEng MICE

Notice

All comments and proposals contained in this report, including any conclusions, are based on information available to BWB Consulting during investigations. The conclusions drawn by BWB Consulting could therefore differ if the information is found to be inaccurate or misleading. BWB Consulting accepts no liability should this be the case, nor if additional information exists or becomes available with respect to this scheme.

Except as otherwise requested by the client, BWB Consulting is not obliged to and disclaims any obligation to update the report for events taking place after: -

- (i) The date on which this assessment was undertaken, and
- (ii) The date on which the final report is delivered

BWB Consulting makes no representation whatsoever concerning the legal significance of its findings or the legal matters referred to in the following report.

All Environment Agency mapping data used under special license. Data is current as of June 2025 and is subject to change.

The information presented, and conclusions drawn, are based on statistical data and are for guidance purposes only. The study provides no guarantee against flooding of the study site or elsewhere, nor of the absolute accuracy of water levels, flow rates and associated probabilities.

This document has been prepared for the sole use of the Client in accordance with the terms of the appointment under which it was produced. BWB Consulting Limited accepts no responsibility for any use of or reliance on the contents of this document by any third party. No part of this document shall be copied or reproduced in any form without the prior written permission of BWB

CONTENTS

1.	INTRODUCTION.....	1
	Situational Context & Associated Development.....	1
	Sustainable Drainage Guidance.....	4
	Guidance Documents	4
	Climate Change and Urban Creep Allowances	5
2.	EXISTING CONDITIONS	6
	Existing Runoff Rates.....	11
	Existing Runoff Volume	12
3.	SURFACE WATER DRAINAGE STRATEGY	13
	Drainage Hierarchy	13
	Infiltration	14
	Surface water body	14
	Peak Flow Control.....	15
	Drainage Catchments.....	16
	Attenuated Storage	17
	Runoff Volume Control	19
	Sustainable Drainage Systems	19
	Water Quality	20
	Residual Risk and Designing for Exceedance	25
4.	MAINTENANCE	26
5.	FOUL WATER DRAINAGE.....	30
6.	SUMMARY	31

FIGURES

Figure 1.1: The EMG2 Project

Figure 2.1: Existing Site Topography based on EA 1m LiDAR

Figure 2.2: Site Location and Watercourse Network

Figure 2.3: BGS Bedrock Map

Figure 2.4: BGS Superficial Deposits

TABLES

Table 1.1: Site Details

Table 1.2: Soar Management Catchment Peak Rainfall Allowances

Table 2.1: Existing Runoff Rate per hectare from the Site

Table 3.1: Existing Runoff Rates based on measured contributing areas

Table 3.2: Existing & Proposed Runoff Rates from the proposed development

Table 3.3: Existing & Proposed Runoff Rates from the proposed development

Table 3.4: Attenuated Storage Requirements

Table 3.5: Pollution Hazard Indices for Different Land Use Classifications

Table 3.6: SuDS Mitigation Indices

Table 3.7: SuDS treatment measures for each catchment

Table 3.8: Comparison of Pollution Hazard Rating against Proposed Mitigation Index

Table 4.1: The SuDS Manual Typical Maintenance Schedule for Swales

Table 4.2: The SuDS Manual Typical Maintenance Schedule for Detention Basins

Table 4.3: Typical Maintenance Schedule for the A42 Inlet Headwall

Table 6.1: Sustainable Drainage Statement Summary

APPENDICES

Appendix 1: Proposed Parameters Plan

Appendix 2: Topographical Survey

Appendix 3: Sewer Asset Records

Appendix 4: CCTV Survey

Appendix 5: Greenfield Runoff Rate Calculations

Appendix 6: Greenfield Runoff Volume Calculation

Appendix 7: Concept Drainage Strategy

Appendix 8: Causeway Flow Calculations

Appendix 9: A42 Culvert Capacity Review

Appendix 10: STW Pre-development Enquiry

1. INTRODUCTION

- 1.1 A Sustainable Drainage Statement (SDS) sets out the principles of drainage design for a development and summarises the reasoning behind the chosen design. This includes justification of specific flow rates, volumes of attenuated storage, as well as the appropriate level of treatment to be provided to surface water runoff.
- 1.2 This SDS has been produced by BWB Consulting on behalf of SEGRO (Properties) Ltd in respect of a Development Consent Order (DCO) for East Midlands Gateway 2 (EMG2), with this SDS report forming an appendix to the Environmental Statement (ES) submitted in support of the DCO.
- 1.3 A Flood Risk Assessment (FRA) has been developed for the site (reference: EMG2-BWB-ZZ-XX-T-W-0001_FRA) and this SDS accompanies the FRA.
- 1.4 The proposed development is to be submitted for a DCO, and as such the details have been developed in consultation with the relevant statutory bodies relating to flood risk and drainage for the site.
- 1.5 The Lead Local Flood Authority (LLFA) for the site are Leicestershire County Council (LCC). The LLFA are not the prescribed consultee under the DCO process; however North West Leicestershire District Council, the Local Planning Authority (LPA), are. As the LPA is not the LLFA for the site, the Environment Agency (EA) have been deferred to as the relevant body to comment on the surface water drainage strategy. Despite this, as the LLFA is the body responsible for surface water flood risk in relation to planning, LCC have been consulted through the DCO consultation stage and will comment of the surface water drainage proposals, via the EA.
- 1.6 Severn Trent Water (STW) are responsible for waste water disposal.

Situational Context & Associated Development

- 1.7 The proposed development comprises a number of interrelated component parts as follows, and collectively they are referred to as the EMG2 Project:
 - **EMG2 Works:**
 - o Construction of logistics and advanced manufacturing development and ancillary buildings (DCO, Works No. 1);
 - o Construction of road infrastructure (DCO, Works No. 2);
 - o Construction of bus interchange (DCO, Works No. 3);
 - o Construction of HGV parking (DCO Works No. 4);
 - o Provision of hard and soft landscaping (DCO Works No. 5);
 - o Creation of a Community Park (DCO, Work No. 21); and
 - o Upgrade of the EMG1 substation (DCO, Work No. 20)¹.

¹ Note – As the existing substation is drained via the existing EMG1 drainage system, these specific works have been assessed within the EMG1 Works SDS report (reference: EMG2-BWB-ZZ-XX-RP-CD-0002_SDS (EMG1 Works))

- **Highways Works**

- A453 access junction works to the EMG2 Main Site (Works No. 6);
- Hyam's Lane works (Works No. 7);
- Works to the M1 northbound (Works No. 8);
- Construction of link road from the M1 northbound to the A50 westbound (Works No. 9);
- Works to the A50 westbound (Works No. 10);
- Works to the link road from the M1 southbound and A50 eastbound to M1 Junction 24 (Works No. 11);
- Works to the M1 Junction 24 roundabout and A453 northbound approaches (Works No. 12);
- Improvements to the EMG1 access junction (Works No. 13);
- Construction of the Active Travel Link between the EMG1 access junction and the A453 west of Finger Farm roundabout (Works No. 14);
- Provision of an uncontrolled crossing of the A453 at the East Midland Airport signalised access junction (Works No. 15);
- Works to M1 northbound signage on the approach to M1 Junction 23A (Works No. 16);
- Works to Long Holden (Works No. 17);
- Works to the A42/A453 Finger Farm roundabout (Works No. 18); and
- Upgrade to public footpath L57 to a cycle track (Works No. 19).

- **EMG1 Works**

- Construction of a new rail-served warehouse building on land adjacent to the rail-freight terminal referred to as Plot 16 (MCO, Works No. 3A) together with associated access and drainage infrastructure, (MCO, Works No. 5A) and landscaping (MCO, Works No. 6A).
- Alterations to the existing rail-freight terminal to improve its operation and efficiency;
- An expansion of the EMG1 Management Suite by the EMG1 site entrance to cater for the additional demand on management facilities resulting from EMG1 (MCO, Works No. 3B);
- Enhancements to the Public Transport Interchange by way of the installation of EV charging infrastructure for buses and provision of a drop-off layby adjacent to the transport hub (MCO, Works No. 5B and 5C); and
- Provision of a signalised crossing over the EMG1 exit road approach to the access junction to EMG1 (MCO, Works No. 8A).

1.8 An illustrative site location plan is provided as **Figure 1.1**, which also identifies the approximate extent of the development component parts.

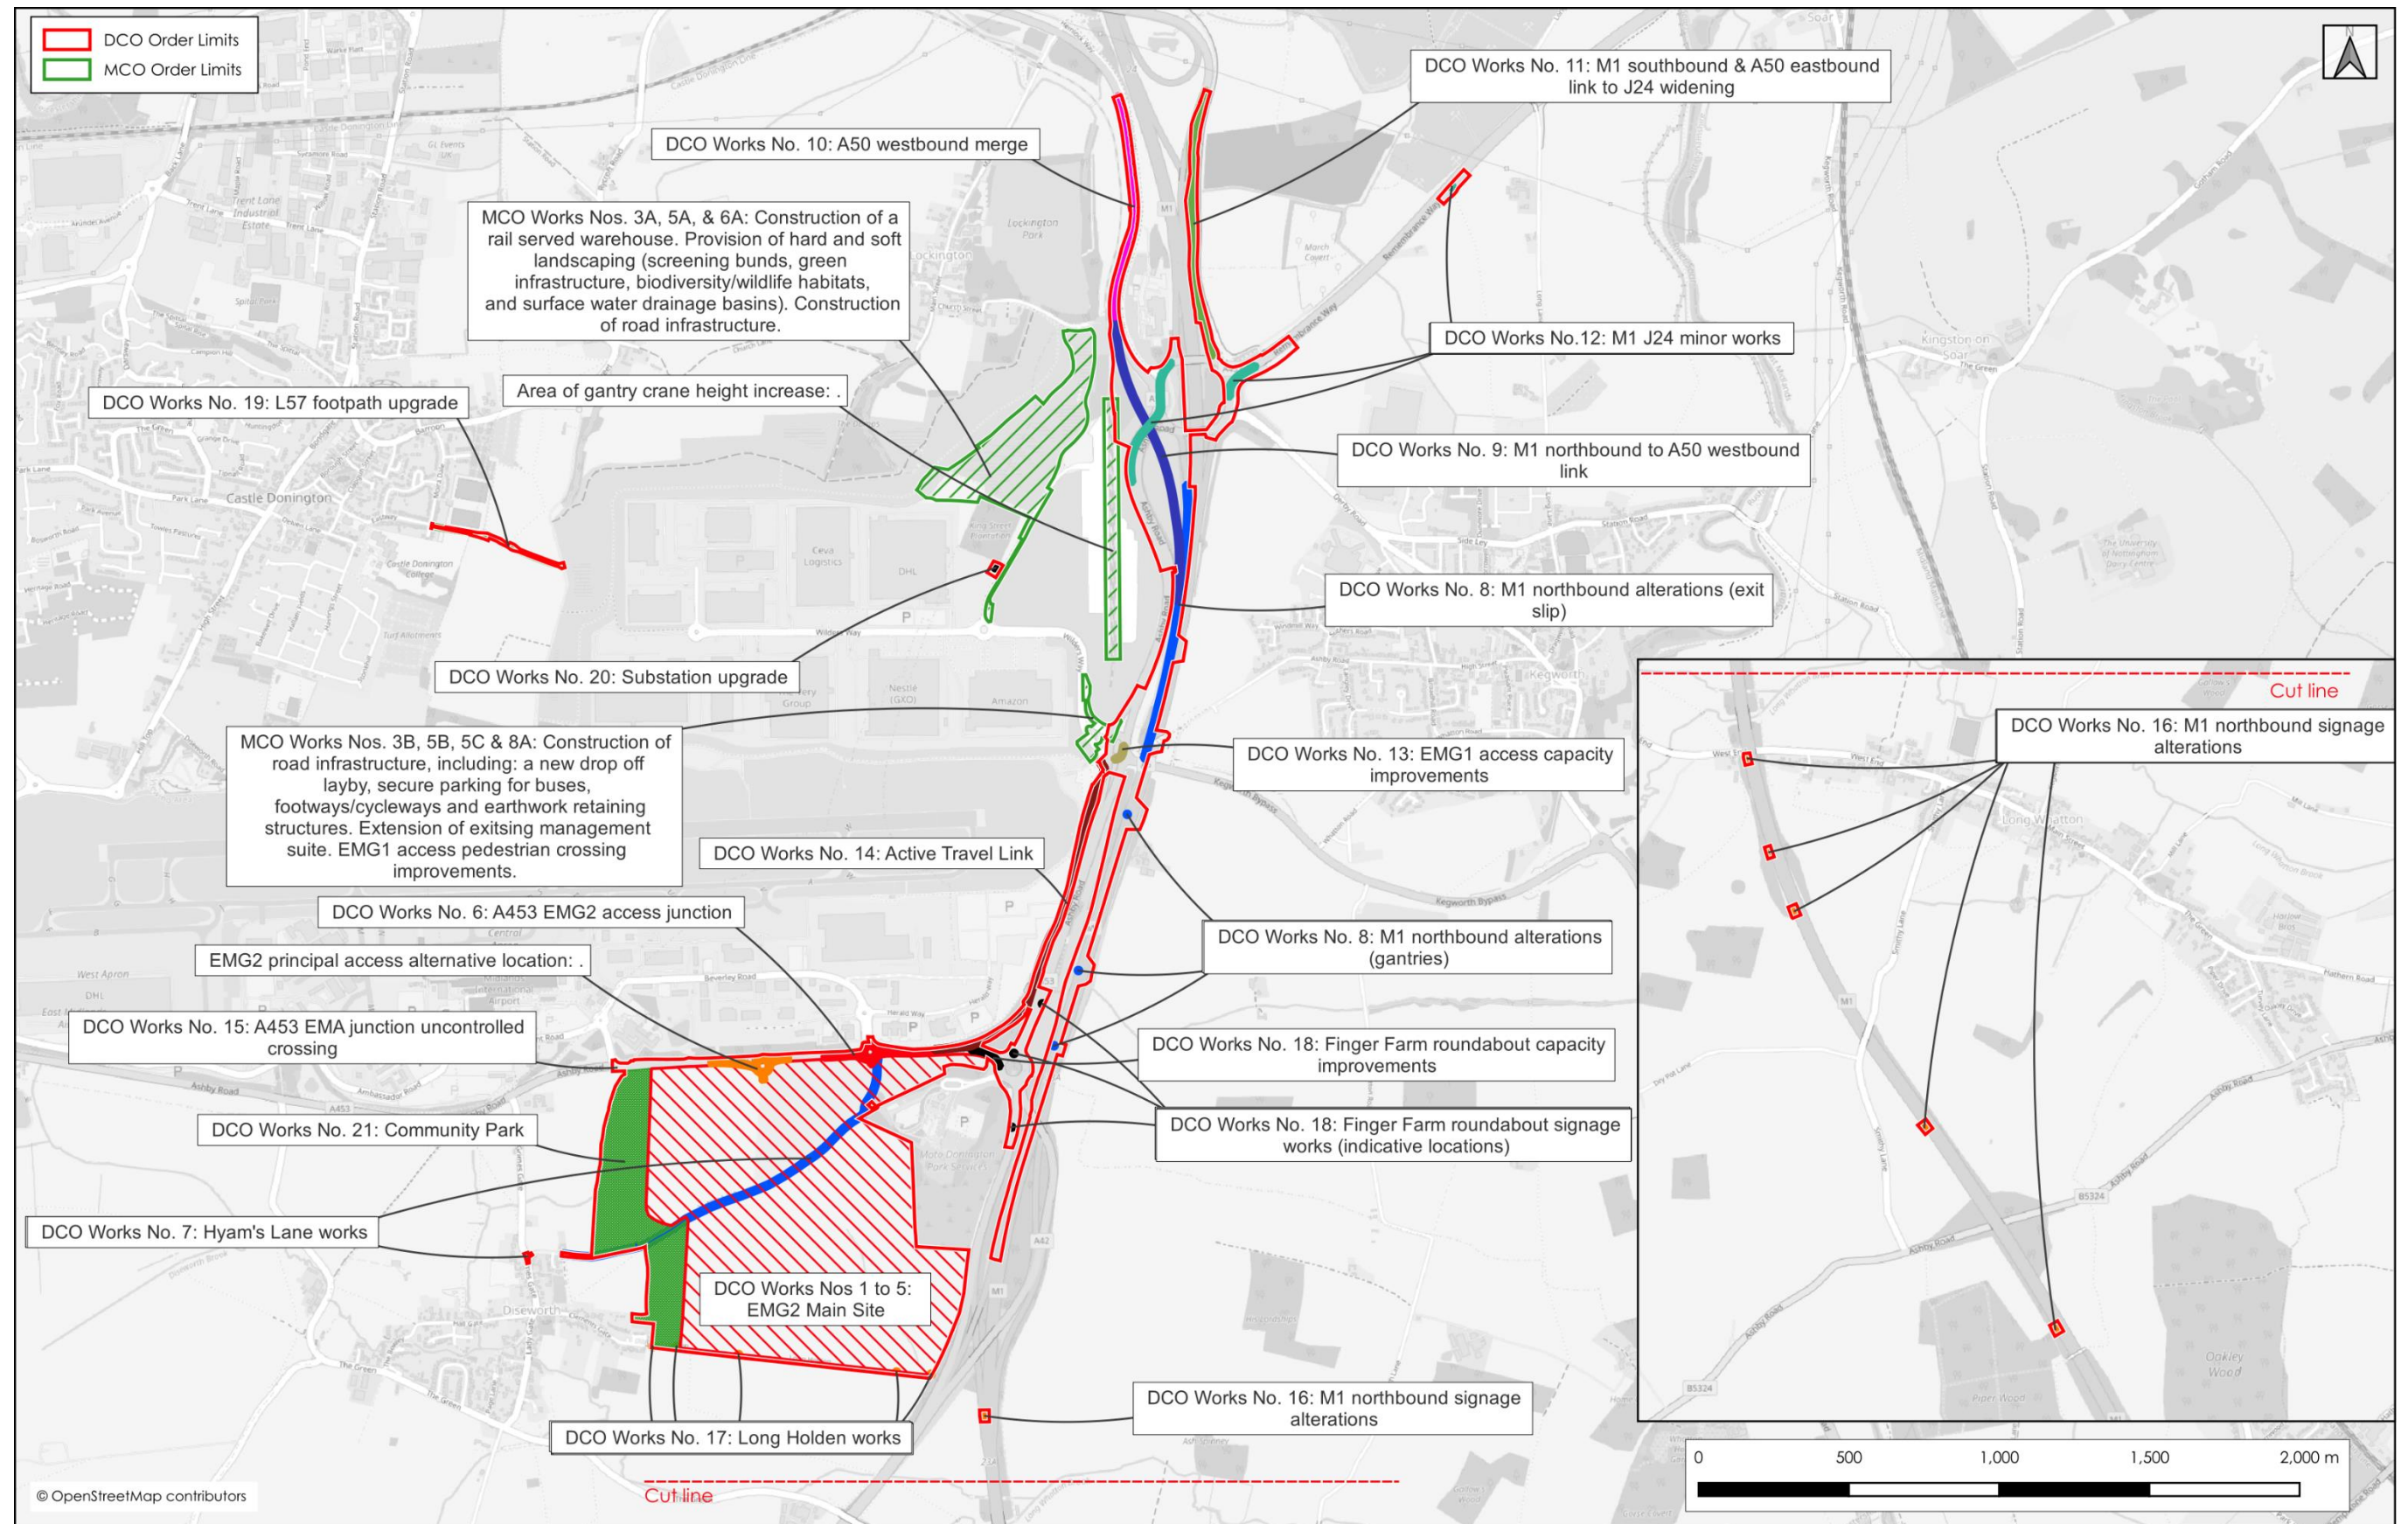


Figure 1.1: The EMG2 Project

- 1.9 This SDS has been prepared in relation to the 'EMG2 Main Site' and the adjacent area for the proposed Community Park (DCO Works No. 21), which are referred to as 'the site' throughout this report.
- 1.10 The EMG1 Works and Highway Works have been reviewed under separate cover (references: EMG2-BWB-ZZ-XX-RP-CD-0002_SDS (EMG1 Works) and EMG2-BWB-ZZ-XX-RP-CD-0003_SDS (Highways Works), respectively.
- 1.11 The proposed site parameters plan are presented within **Appendix 1**, with contextual information provided within **Table 1.1**.

Table 1.1: Site Details

Site Name	EMG2 Main Site & Community Park
NGR (approx.)	SK459250
Approximate Area (ha)	105.7 (approx.)
Proposed Contributing Area (ha)	69.16 (approx.)
Development Type	Class B8/B2 Office and Warehouse, community park
Lead Local Flood Authority	LCC
EA Area	East Midlands
Sewerage Undertaker	STW

Sustainable Drainage Guidance

Guidance Documents

- 1.12 This SDS and associated drainage strategy has been written with reference to the following guidance documents:
- LCC's Interim LLFA Guidance Note: Planning and Development in Leicestershire²;
 - The DEFRA Non-Statutory Technical Standards for SuDS³;
 - The National Policy Statement for National Networks⁴ (NPSNN);
 - The Department for Transport (DfT) and National Highways (NH) Strategic road network and the delivery of sustainable development guidance (reference: DfT Circular 01/2022)⁵; and
 - The CIRIA C753 SuDS Manual⁶.

² Interim LLFA Guidance Note: Planning and Development in Leicestershire -Rev A (Leicestershire County Council, October 2018)

³ 2015, DEFRA. Non-statutory technical standards for sustainable drainage systems

⁴ National Policy Statement for National Networks, Department for Transport, March 2024

⁵ Strategic road network and the delivery of sustainable development guidance (Department for Transport and National Highways, December 2022)

⁶ The SuDS Manual Version 6 (CIRIA, 2019)

Climate Change and Urban Creep Allowances

- 1.13 The site is located within the Soar Management Catchment within the Humber River Basin District. Table 2 from the EA's 'Flood risk assessments: climate change allowances', included as **Table 1.2**, shows the anticipated changes in peak rainfall intensity for the site.

Table 1.2: Soar Management Catchment Peak Rainfall Allowances

Soar Management Catchment Allowance	Total Potential Change Anticipated for the '2050s' (Lifetime up to 2060)	Total Potential Change Anticipated for the '2070s' (2061 to 2125)
1 in 30-Year Rainfall Event		
Upper End	35%	35%
Central	20%	25%
1 in 100-Year Rainfall Event		
Upper End	40%	40%
Central	20%	25%

- 1.14 The proposed development is anticipated to have a lifespan of up to 75 years, therefore the 2070's epoch central allowance will be used to assess the impacts of climate change for the proposed surface water drainage strategy. Sensitivity testing has been undertaken using the 2070's epoch upper end allowance to ensure that there is no increase in flood risk elsewhere and the built development will be safe from surface water flooding over the anticipated lifetime of the proposed development.
- 1.15 Based on the above guidance, an allowance of 25% will be applied to the 1 in 100-year return period within the drainage design calculations, with sensitivity testing using a 40% allowance to the 1 in 100-year return period. During the detailed design stage a 25% climate change allowance, with a 35% sensitivity test, should be applied to the 1 in 30-year return period within the drainage design calculations. As the development is built out, the latest EA climate change allowance should be reviewed and used for the detailed design calculations for each phase of the development.
- 1.16 Based on the proposed development use, no urban creep allowance has been applied to the drainage design calculations.

2. EXISTING CONDITIONS

- 2.1 The site is bound to the north by East Midlands International Airport (EMIA) beyond Ashby Road (A453). Donnington Park Services is located adjacent to the north-east. The site is bound to the east by the A42 and the M1, the south by Long Holden public byway with agricultural fields beyond, and to the west by agricultural fields. The village of Diseworth is located approximately 150m south-west of the site. A public byway, known as Hyam's Lane, bisects the site from south west to north east.
- 2.2 The generalised topography of the site is shown in **Figure 2.1** with a full topographical survey (reference: 34529A_T_REV1) included as **Appendix 2**. The site is generally split into two topographical catchments located to the north and south of Hyam's Lane. The northern catchment falls generally in a westerly direction (towards the Hall Brook) with levels ranging from approximately 92.7metres Above Ordnance Datum (mAOD) in the northeast to approximately 67.1mAOD in the southwest. The southern catchment falls generally in a southerly direction with levels ranging from approximately 91.0mAOD in the northeast to approximately 52.6mAOD in the southeast.

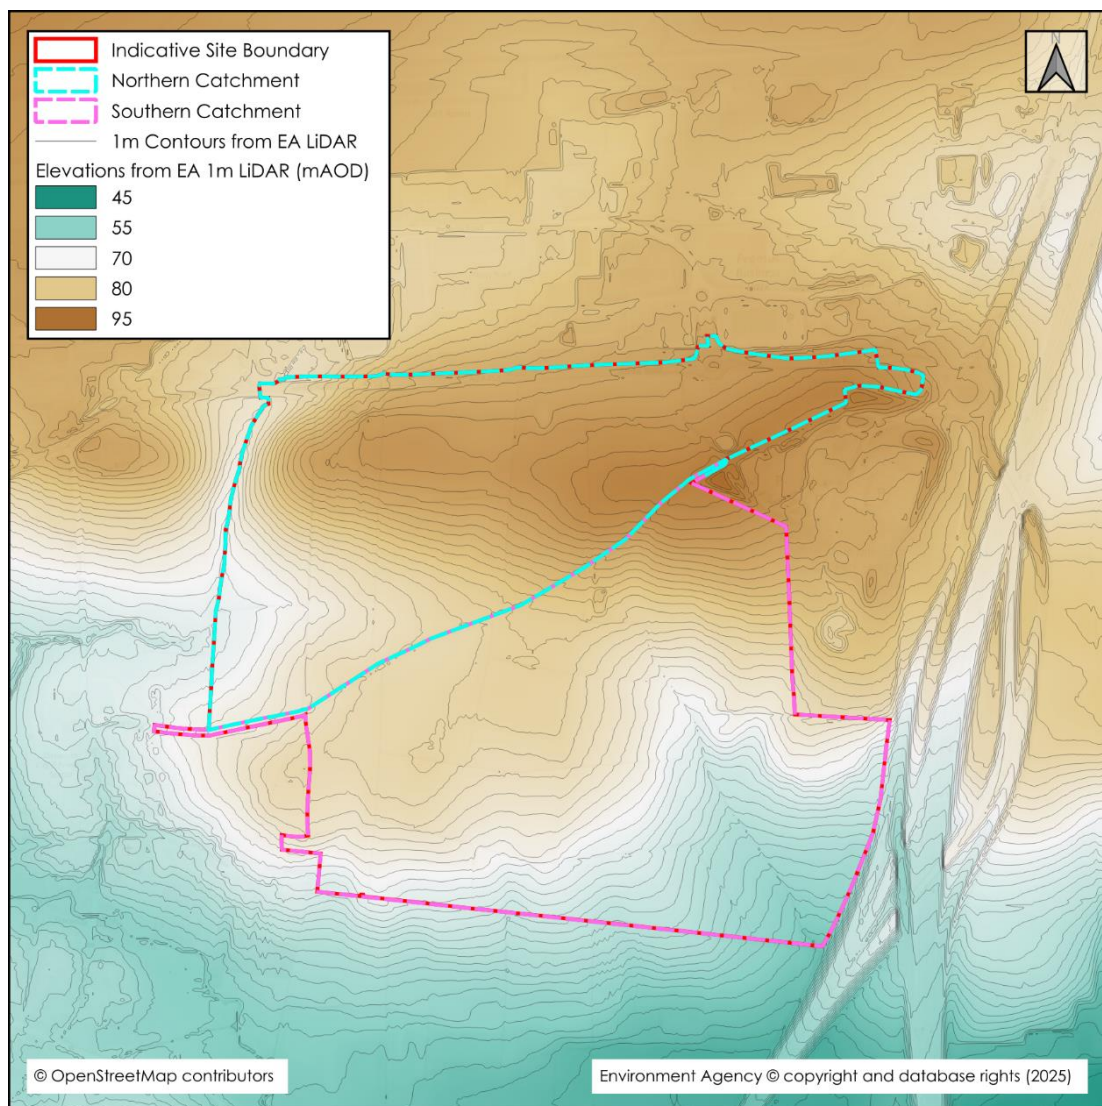


Figure 2.1: Existing Site Topography based on EA 1m LiDAR

- 2.3 The site is considered to be greenfield in nature and is currently utilised for agricultural practices. Hyam's Lane is made up of loose dirt and gravel.
- 2.4 The Hall Brook flows along a portion of the western boundary before flowing in a south-westerly direction to its confluence with the Diseworth Brook approximately 500m southeast of the site. A series of field ditches are present in the southeast corner of the site that drain via a piped connection (500mm diameter) which outfalls to larger pipe system (525mm to a 700mm diameter) which runs alongside the A42 and outfalls to the Diseworth Brook beneath the A42 road bridge.
- 2.5 STW sewer asset records (**Appendix 3**) show a public surface water sewer running parallel to the A42 culvert between the Donnington Services and the Diseworth Brook, outfalling just upstream of the A42 culvert. A public foul water rising main is shown to flow along Hyam's lane in a north-easterly direction. The rising main originates from a pumping station to the west off Grimes Lane and enters a public foul water gravity sewer to the north of the site beyond Ashby Road.
- 2.6 A Closed-Circuit Television (CCTV) survey (**Appendix 4**) shows the alignment of the existing piped system and surface water public sewer and confirm their ultimate outfall points into Diseworth Brook.
- 2.7 The site's location and local watercourse network are illustrated within **Figure 2.2**.

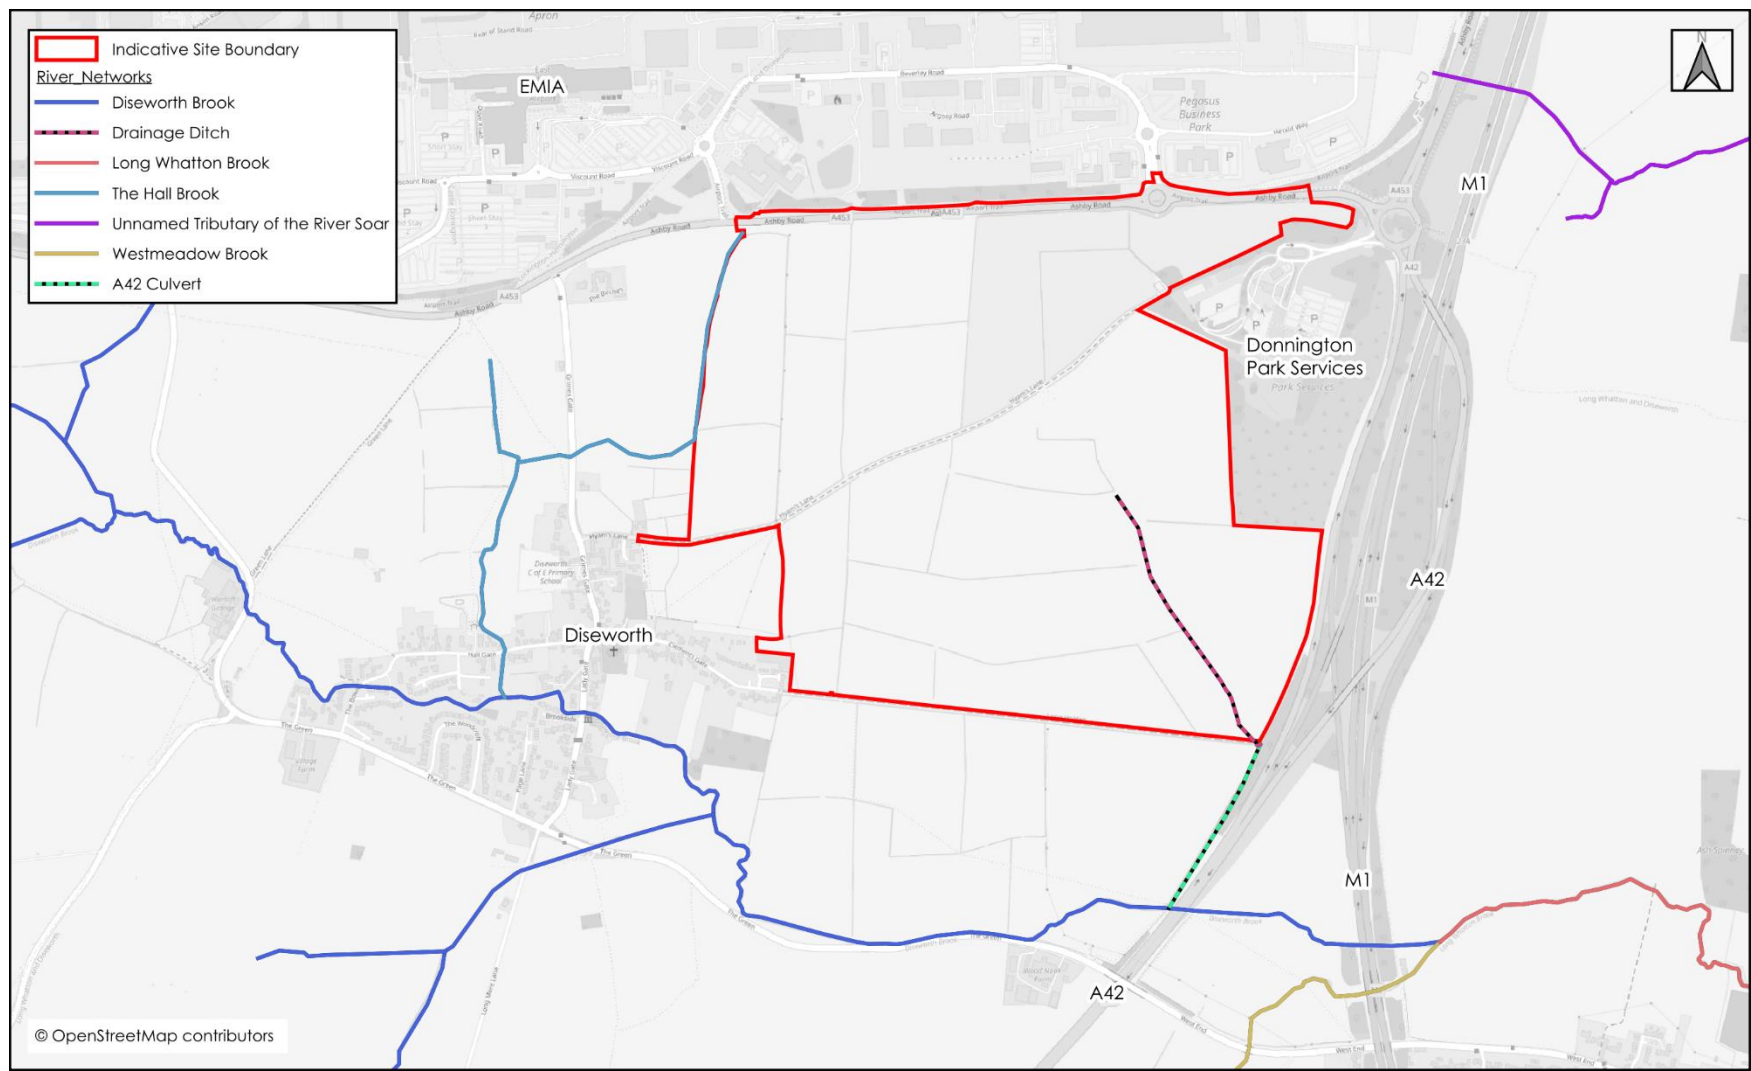


Figure 2.2: Site Location and Watercourse Network

- 2.8 British Geological Survey (BGS) mapping shows the site to be underlain predominantly by Gunthorpe Member – Mudstone, with thin bands of Gunthorpe Member – Siltstone, Dolomitic and Diseworth Sandstone. The bedrock geology is shown in **Figure 2.3**.

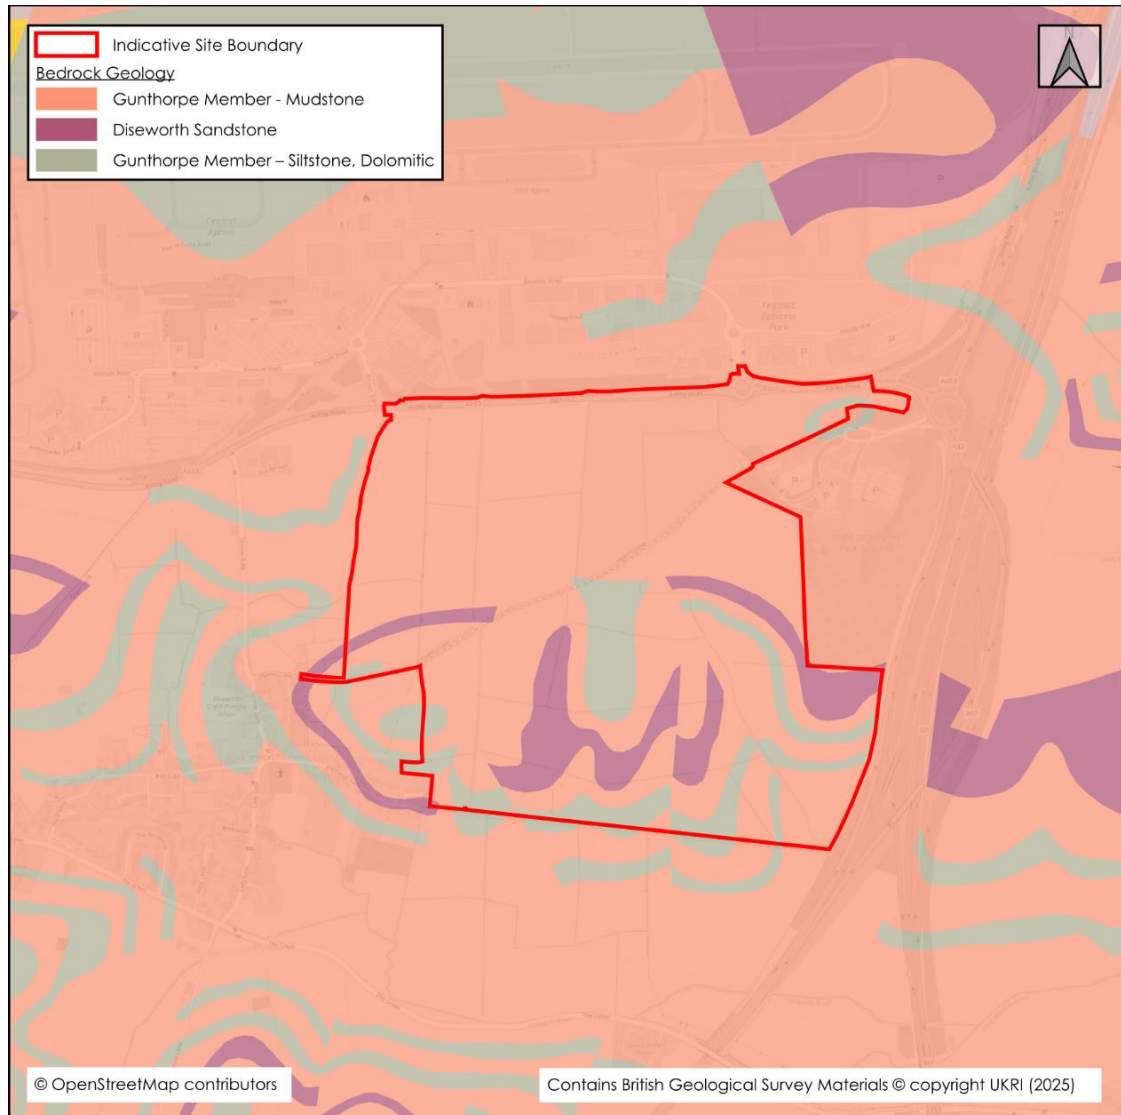


Figure 2.3: BGS Bedrock Map

- 2.9 Superficial deposits of Glaciofluvial Deposits, Mid Pleistocene – Sand and Gravel, Oadby Member – Diamicton and Head – Clay, Sand and Gravel are expected to be present within the site. The superficial deposits are shown in **Figure 2.4**.

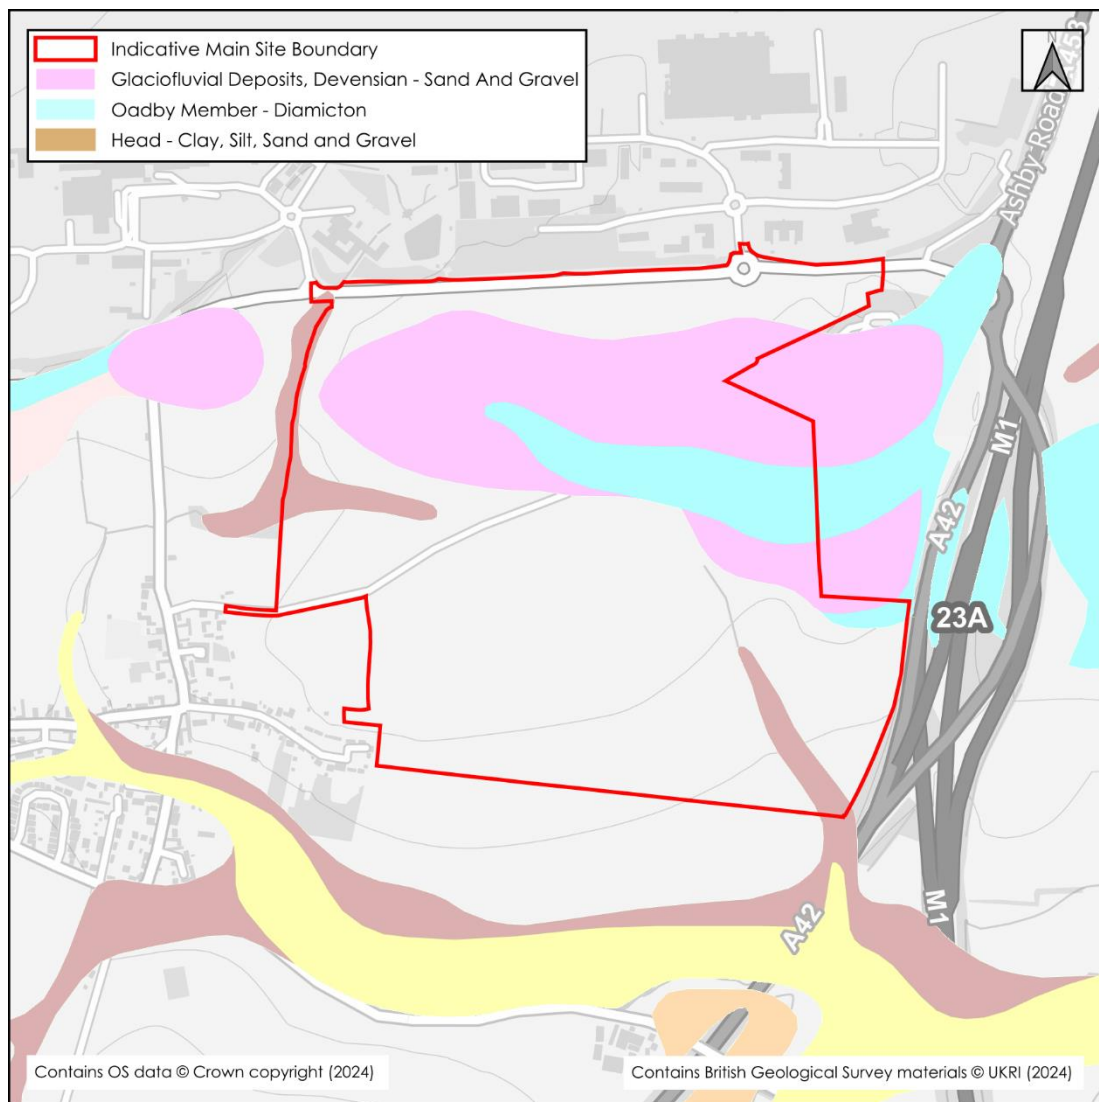


Figure 2.4: BGS Superficial Deposits

2.10 The Factual Ground Investigation Report (reference: 765514-01) prepared by Fairhurst outlines preliminary findings from intrusive ground investigations. This has confirmed the following ground conditions:

- Topsoil (proven from the surface to a maximum depth of between 0.10 m and 0.85 m bgl);
- Isolated occurrences of Made Ground (proven to a maximum depth of 0.20 m and 3.00 m bgl), with the deeper Made Ground encountered within the northern site area (location of anticipated historically infilled clay pits – TP08 and BH04);
- Superficial deposits of The Oadby Member and Glaciofluvial Deposits (proven to maximum depths of 16.40 m bgl and 17.30 m bgl, respectively); and
- Bedrock geology of The Gunthorpe Member and Diseworth Sandstone (proven to a maximum depth of 18.50 m bgl for the former, with the maximum depth of the latter not proven).

- 2.11 Groundwater monitoring suggested that two groundwater bodies are present between depths of 1.25m and 15.32m bgl (84.90m AOD and 52.7m AOD) within the Glaciofluvial, Weathered Gunthorpe Member and Gunthorpe Member. It was reported that the ground investigations found the ditch in the site to be dry throughout the works. Therefore, the watercourse is likely to be seasonally dry, with its main purpose to drain surface water runoff from the adjacent fields.
- 2.12 Based on the underlying geology across the site it is anticipated that there will be limited infiltration potential for surface water.
- 2.13 The accompanying FRA identifies that the site to be generally at low risk of flooding, although there are several potential surface water flow pathways that could form across the site. These potential flow paths are relatively shallow and generally originate from within the site itself. More details on the potential flood risk sources to the site and the proposed mitigation measures are outlined in the accompanying FRA.
- 2.14 It is understood that that the village of Diseworth to the southwest of the site is at risk of fluvial flooding associated with the Hall Brook and Diseworth Brook.
- 2.15 Based on the above information, the existing drainage regime at the site is for the northern catchment, as illustrated on **Figure 2.2**, to drain via surface runoff into the Hall Brook, before ultimately draining into Long Whatton Brook, via Diseworth Brook. The southern catchment drains via the existing A42 culvert, into Diseworth Brook and ultimately into Long Whatton Brook to the south east of the site.

Existing Runoff Rates

- 2.16 An assessment of the existing surface water runoff rates from the site has been undertaken on a litres per second per hectare basis. This is summarised within **Table 2.1**, with the associated calculations presented within **Appendix 5**.
- 2.17 The runoff rates have been estimated using the Flood Estimation Handbook (FEH) statistical method. This was undertaken using the UKSUDS Greenfield Runoff Rate Estimation Tool.

Table 2.1: Existing Runoff Rate per hectare from the Site

Return Period (Yrs.)	Runoff Rate (l/s/ha)
1	2.7
Mean Annual Flow Rate (QBAR)	3.3
30	6.6
100	8.4

Existing Runoff Volume

- 2.18 An assessment of the existing surface water runoff rates from the proposed contributing area used to inform the drainage design calculations has been made for a 1 in 100-year, 6 hour storm.
- 2.19 As the existing site is permeable, the runoff volume has been calculated using the pre-development discharge calculator in Causeway Flow to be 21,255m³, results are included within **Appendix 6**.
- 2.20 Per hectare this equates to a greenfield runoff volume of 307m³.

3. SURFACE WATER DRAINAGE STRATEGY

- 3.1 A Concept Drainage Strategy is presented as **Appendix 7**, with the supporting attenuation calculations provided within **Appendix 8**.
- 3.2 The proposed contributing impermeable areas have been measured from the proposed parameters plan, presented within **Appendix 1**. The following impermeable area assumptions have been used:
- Development plots and adjoining highways = 90%;
 - Embankments and bunds = 50%; and
 - Attenuating SuDS basins = 100%.
- 3.3 The assumed impermeable area for the proposed community park car park (100%) has been measured from the FPCR Illustrative Landscape Masterplan, which is enclosed on the Concept Drainage Strategy (**Appendix 7**) and is to be confirmed during the detailed design stage.
- 3.4 Based on the parameters plan, illustrative landscape masterplan and above impermeable area assumptions, the calculated contributing impermeable area is 69.16ha.
- 3.5 Given the nature of the DCO applications being approved based on the parameters plan, as the development is built out, the contributing areas may change and therefore the final attenuation requirements and discharge rates from the proposed development may differ from the calculations outlined within this SDS. The principles set out within this report should be carried through as the development is built out.

Drainage Hierarchy

- 3.6 The Planning Policy Guidance⁷ and the SuDS Manual⁸ identify that surface water runoff from a development should be disposed of as high up the following hierarchy as reasonably practicable:
- into the ground (infiltration);
 - to a surface water body;
 - to a surface water sewer, highway drain, or another drainage system;
 - to a combined sewer.
- 3.7 The aim of this approach is to manage surface water runoff close to where it falls and mimic natural drainage as closely as possible.

⁷ Planning Practice Guidance, <http://planningguidance.planningportal.gov.uk/>.

⁸ The SuDS Manual (C753). CIRIA 2015.

Infiltration

- 3.8 Based on the existing ground conditions observed on site during the preliminary ground investigation, soakaway drainage is not considered to be viable for the proposed development.

Surface water body

- 3.9 As described within **Section 2**, the existing northern drainage catchment drains into the Hall Brook along the west site boundary, with the southern catchment draining into the existing A42 culvert, with the entire site ultimately draining into the Long Whatton Brook to the south east.
- 3.10 Given the existing fluvial flood risk to the village of Diseworth, it is proposed that the entire site will via the A42 culvert, located at the southeast corner of the site; thus, reducing the contribution of flows to the Hall Brook prior to its course through Diseworth.
- 3.11 Given that the entire site ultimately drains into Long Whatton Brook, cross-catchment transfer is not a significant concern with the proposed outfall strategy. However, In accordance with the NH DfT Circular 01/2022 paragraph 59, flows from the entire development will be limited to the existing catchment rates that currently drain to the A42 culvert (i.e., the southern catchment, as illustrated on **Figure 2.1**).

- 3.12 Paragraph 59 of the NH DfT Circular 01/2022 reads:

To ensure the integrity of the highway drainage systems, no new connections into those systems from third party development and proposed drainage schemes will be accepted. Where there is already an existing informal or formal connection into the highway drainage system from a proposed development site, the right for a connection may be allowed to continue provided that the flow, rate and quality of the discharge into the highway drainage system remains unaltered or results in a betterment. The company may require a drainage management and maintenance agreement to be entered into to secure this requirement in perpetuity.*

** An informal connection refers to surface water run-off and a formal connection to an engineered connection.*

- 3.13 Based on the above NH guidance, the proposed approach is considered to be acceptable.
- 3.14 Additionally, post-development hydraulic modelling has been undertaken as part of the FRA to assess the impacts of the drainage proposals to both Diseworth and downstream of the site. More information relating to the post-development hydraulic modelling is outlined within the accompanying FRA.

Peak Flow Control

- 3.15 In order to comply with the Non-Statutory Technical Standards for Sustainable Drainage Systems S2-S3⁹, runoff from greenfield developments should not exceed the equivalent greenfield rates for the 1 and 100-year return period events. Additionally, to comply with the NH DfT Circular 01/2022, the existing flow rates from the southern catchment into the A42 culvert should not increase post-development.
- 3.16 Therefore, to comply with the above peak flow control criterion, it is proposed to restrict the maximum discharge rate from the proposed development to the equivalent 1 in 1-year rate for the contributing areas measured within the southern catchment for all events up to the 1 in 100-year + 40% critical storm event. This is summarised within **Table 3.2**.

Table 3.1: Existing Runoff Rates based on measured contributing areas

Catchment	Contributing Area (ha)	Return Period (Yr.)	Existing Runoff Rate (l/s)
Northern	26.78	1	72.3
		QBAR	88.4
		30	176.8
		100	225.0
Southern	42.38	1	114.4
		QBAR	139.8
		30	279.7
		100	256.0
Total	69.16	1	186.7
		QBAR	228.2
		30	456.5
		100	581.0

⁹ 2015, DEFRA. Non-statutory technical standards for sustainable drainage systems

Table 3.2: Existing & Proposed Runoff Rates from the proposed development

Return Period (Yr.)	Existing Runoff Rate (l/s)	Proposed Discharge Rate (l/s)	Betterment (%)
1	186.7	114.4	39%
QBAR	228.2		50%
30	456.5		75%
100	581.0		80%
100 + 40%	-		-

- 3.17 This approach fulfils the necessary peak runoff control criteria and provides a significant betterment to the existing runoff rates leaving the site post-development, particularly during the higher return periods.
- 3.18 A review of the capacity of the A42 culvert has been undertaken to confirm that the proposed outfall has sufficient capacity to review flows from the proposed development. Based on the proposed maximum discharge rates outlined within **Table 3.2**, the A42 shas sufficient capacity to receive flows from the proposed development. The supporting technical note for this review is provided within **Appendix 9**.

Drainage Catchments

- 3.19 Given the scale of the proposed development, the proposed drainage system has been split into a total of nine cascading sub-catchments, all of which ultimately drain to the A42 culvert in the southeast site corner. The proposed sub-catchments are illustrated on the Conceptual Drainage Strategy (**Appendix 7**), with catchment details provided in **Table 3.3**.

Table 3.3: Existing & Proposed Runoff Rates from the proposed development

Catchment	Contributing Area (ha)	Maximum Discharge Rate (l/s)	Outfall Location
1	23.25	89.3	Catchment 2
2	2.65	43.1	Catchment 3
3	20.18	33.4	Catchment 4
4	0.82	77.6	Catchment 5
5	0.48	78.4	Catchment 8
6	4.66	7.7	Catchment 5
7	15.35	25.4	Catchment 8
8	0.78	105.0	Catchment 9
9	0.99	114.4	A42 Culvert
Total	69.16	114.4*	

* Maximum discharge rate from final catchment to A42 culvert

Attenuated Storage

- 3.20 As the development proposals require a restricted runoff rate, it will be necessary to provide attenuated storage to balance the excess volume in a safe manner within the site.
- 3.21 The surface water storage should be located within the site in a position where it can receive runoff from the development and discharge from the site by gravity, and also in a position where it is hydraulically isolated from any fluvial floodplain or external surface water floodplain / overland flow route that may be present in the site.
- 3.22 Sufficient storage for events up to the 1 in 100-year storm with an allowance for climate change should be provided.
- 3.23 It is proposed that the majority of the attenuation for the proposed development will be provided within above ground attenuation basins located along the western and southern peripheries of the site. Where site constraints do not allow for enough space to utilise above ground attenuation, such as for Catchments 6 and 7, below ground cellular storage crates are proposed to provide the required attenuation volume on each respective plot.
- 3.24 Simulations have been run using Causeway Flow to identify the necessary storage provision for each catchment using FEH-22 rainfall data. The results are summarised in **Table 3.4** and calculations are included as **Appendix 8**.

Table 3.4: Attenuated Storage Requirements

Catchment	Critical Storm	Maximum Volume (m ³) – 1 in 100-year + 25%	Critical Storm	Maximum Volume (m ³) – 1 in 100-year + 40%*
1	720-min Winter	17,550	720-min Winter	19,800
2	7,200-min Winter	9,465	7,200-min Winter	9,475
3	1440-min Winter	16,655	1440-min Winter	18,815
4	720-min Winter	445	720-min Winter	550
5	1,440-min Winter	475	2,160-min Winter	530
6	1,440-min Winter	3,805	1,440-min Winter	4,300
7	960-min Winter	10,725	1,440-min Winter	12,100
8	960-min Winter	740	960-min Winter	850
9	720-min Winter	525	480-min Winter	585
Total	-	60,385	-	67,005

* Sensitivity test to ensure that necessary storage is provided for upper end climate change allowance within basin design freeboard

- 3.25 At this conceptual stage it is expected that a minimum of 60,385m³ of attenuated storage will be required to cater for the maximum anticipated runoff volume for all storm durations up to the 1 in 100-year return period storm, including a 25% climate change allowance, extending to 67,005m³ during the 1 in 100-year + 40% climate change critical storm, which will be provided within the basin freeboard above the design water level.
- 3.26 It is envisaged that the final required attenuated storage volume will be determined as development is built out following the approval of the DCO.

Runoff Volume Control

- 3.27 The Non-Statutory Technical Standards for Sustainable Drainage Systems S4-S6¹⁰ states that where reasonably practical the runoff volume from a development for the 1 in 100-year 6 hour rainfall event should not exceed the runoff volume prior to development or redevelopment. Additionally, if practicable on previously developed sites, the runoff volume should not exceed the equivalent greenfield runoff volume. Where it is not reasonably practicable to constrain the volume of runoff from a development at or below the existing volume, then the runoff must be discharged in a manner that does not adversely affect flood risk, i.e.:
- i. The additional runoff volume resulting from the development (the 'long term storage volume') should be discharged separately from the site at a rate of 2l/s/ha or less. Or,
 - ii. All the runoff volume from the development should be discharged at a rate equivalent to the mean annual flow rate (QBAR) rate under greenfield conditions or less. Or,
 - iii. All the runoff volume from the development should be discharged at a rate of 2l/s/ha or less.
- 3.28 Due to the increase in impermeable surfacing within the site post-development, the 1 in 100-year 6-hour runoff volume will increase. However, as the drainage strategy proposes to limit the maximum discharge rate from the site below the existing greenfield QBAR rate for all events up to the 1 in 100-year + 40% critical storm, the volume criterion is met and long-term storage is not required.

Sustainable Drainage Systems

- 3.29 The drainage strategy proposes to utilise a series of detention basins and conveyance swales along the site periphery to provide both attenuation and water quality treatment to surface water flows prior to discharge from the site.
- 3.30 Given the nature of the DCO application, the internal plot layouts, and therefore the potential on-plot SuDS options, are not confirmed. As the plots are built out, the following SuDS should be incorporated into the on-plot drainage system prior to discharging into the spine drainage network conveying flows towards the periphery SuDS:
- Filter Drains;
 - Permeable paving / bypass separator (for office parking areas); and
 - Full retention separators (for service yard areas).
- 3.31 The spine highway should utilise either roadside ditches / swales or silt traps and sump units for any highway gullies.

¹⁰ 2015, DEFRA. Non-statutory technical standards for sustainable drainage systems

- 3.32 It is proposed that a vortex separator (i.e., 'Downstream Defender' or similarly approved product) will be utilised downstream from the Catchment 9 vortex flow control to provide a final stage of surface water treatment as surface water is discharged from the site.
- 3.33 The detention basins and swales around the site periphery will be lined with an impermeable membrane to mitigate the risk of any potential pollutants infiltrating into the ground and contaminating the groundwater recharge in the vicinity of the site.
- 3.34 The detention basins will have a low flow channel and the incorporation of any ecological features will be confirmed at detailed design.
- 3.35 Based on the site's proximity to EMIA, the detention basins will be formed with a ridged base in a 'crinkle-cut' style to promote faster drain down times and discourage birds gathering during the lower return periods.

Water Quality

- 3.36 In accordance with the SuDS Manual a simple index approach to water quality risk management should be undertaken for the proposed development. This will be compiled to provide a comprehensive account of the water quality treatment provided by the proposed surface water drainage system.
- 3.37 The SuDS Manual Mitigation Index will be used to assess the treatment levels proposed in relation to the pollution hazard posed from the proposed land use(s). This methodology is adopted to ensure that surface water flows receive adequate treatment through all areas of the site prior to final outfall.
- 3.38 **Table 3.5** shows the pollution hazard indices for the land use classification(s) that are relevant to the proposed development, as described within table 26.2 in the SuDS Manual.

Table 3.5: Pollution Hazard Indices for Different Land Use Classifications

Land Use	Pollution Hazard Level	Total Suspended Solids (TSS)	Metals	Hydrocarbons
Industrial roofs	Low	0.3	0.2	0.05
Non-residential parking	Medium	0.7	0.6	0.7
Industrial sites	High	0.8	0.8	0.9

- 3.39 The SuDS Mitigation Indices that are relevant to the proposed development, at this stage, as described within table 26.3 of the SuDS Manual, are outlined in **Table 3.6**.

Table 3.6: SuDS Mitigation Indices

Type of SuDS Component	Mitigation Indices		
	TSS	Metals	Hydrocarbons
Swale	0.5	0.6	0.6
Permeable Pavement	0.7	0.6	0.7
Detention Basin	0.5	0.5	0.6
Bypass Separator*	0.8	0.6	0.9
Full Retention Separator*	0.8	0.6	0.9
Vortex Separator^	0.5	0.4	0.5

* Based on SPEL Enhanced Silt Retention bypass / full flow ¹¹ range (other products may vary)

^ Based on Hydro International Downstream Defender 'Advanced Vortex'¹² (other products may vary)

- 3.40 The sitewide SuDS treatment system (i.e., series of detention basins and swales located along the west and south periphery of the site) will provide the majority of the water quality mitigation for the proposed development. Given the proposed development use, appropriate SuDS / proprietary treatment systems, in the form of bypass or full retention separators, will be used on each plot as required to provide a first stage of treatment prior to connecting into the site wide drainage system.
- 3.41 At this stage, it is anticipated that in addition to the site wide SuDS treatment system, the following on plot SuDS treatment measures will be incorporated, as a minimum:
- Full retention separators – for service yards; and
 - Bypass separators or permeable block paving – for car parking areas;
- 3.42 The following SuDS treatment measures for each catchment land use is outlined within **Table 3.7**. Please note that Catchments 2, 5, 8 and 9 have been excluded from **Table 3.7**, as these catchments only include earthwork batters, which are considered to have no pollution hazard risk. These catchments also drain via the sitewide SuDS treatment system and will therefore receive treatment from a minimum of one detention basin and the vortex separator, with additional treated to the catchments located further upstream within the sitewide drainage system.

¹¹ SPEL Stormceptor Enhanced Silt Retention bypass (<https://spelproducts.co.uk/spel-esr-bypass/>) / full flow (<https://spelproducts.co.uk/spel-esr-full-flow/>) treatment system

¹² Hydro International Downstream Defender 'Advanced Vortex' (https://hydro-int.com/en/products/downstream-defender?gl=1*hp5mv1*up*MQ..*gs*MQ..&gbraid=0AAAAADz81nmuhOElzqh5sqGrEqmZFmatI)

Table 3.7: SuDS treatment measures for each catchment

Catchment	Land use	SuDS Treatment Measures
1	Commercial Roof	Detention basin (8no.) + Swale (2no.) + Vortex Separator
	Non-residential Parking	Bypass Separator / Permeable Paving + Detention basin (8no.) + Swale (2no.) + Vortex Separator
	Service Yards	Full Retention Separator + Detention basin (8no.) + Swale (2no.) + Vortex Separator
	Highways	Detention basin (8no.) + Swale (2no.) + Vortex Separator
3	Commercial Roof	Detention basin (7no.) + Swale (2no.) + Vortex Separator
	Non-residential Parking	Bypass Separator / Permeable Paving + Detention basin (7no.) + Swale (2no.) + Vortex Separator
	Service Yards	Full Retention Separator + Detention basin (7no.) + Swale (2no.) + Vortex Separator
	Highways	Detention basin (7no.) + Swale (2no.) + Vortex Separator
4	Non-residential Parking	Detention basin (4no.) + Swale (2no.) + Vortex Separator
6	Commercial Roof	Detention basin (3no.) + Swale (2no.) + Vortex Separator
	Non-residential Parking	Bypass Separator / Permeable Paving + Detention basin (3no.) + Swale (2no.) + Vortex Separator
	Service Yards	Full Retention Separator + Detention basin (3no.) + Swale (2no.) + Vortex Separator
	Highways	Detention basin (3no.) + Swale (2no.) + Vortex Separator
7	Commercial Roof	Detention basin (2no.) + Swale (2no.) + Vortex Separator
	Non-residential Parking	Bypass Separator / Permeable Paving + Detention basin (2no.) + Swale (2no.) + Vortex Separator
	Service Yards	Full Retention Separator + Detention basin (2no.) + Swale (2no.) + Vortex Separator
	Highways	Detention basin (2no.) + Swale (2no.) + Vortex Separator

- 3.43 The pollution hazard rating and proposed SuDS Mitigation Index for each drainage Catchment is compared within **Table 3.8**. Where more than one SuDS component is proposed, a factor of 0.5 has been applied to the downstream (i.e., secondary and/or tertiary) treatment stages to account for the reduced performance due to reduced inflow concentrations.

Table 3.8: Comparison of Pollution Hazard Rating against Proposed Mitigation Index

Catchment	Land use	Pollution Hazard Rating			Proposed Mitigation Index			Sufficient Treatment Provided?
		TSS	Metals	Hydrocarbons	TSS	Metals	Hydrocarbons	
1	Commercial Roof	0.3	0.2	0.05	3.00	3.05	3.55	✓
	Non-residential Parking	0.7	0.6	0.7	3.45	3.40	3.95	✓
	Service Yards	0.8	0.8	0.9	3.55	3.40	4.15	✓
	Highways	0.8	0.8	0.9	3.55	3.40	4.15	✓
3	Commercial Roof	0.3	0.2	0.05	2.75	2.80	3.25	✓
	Non-residential Parking	0.7	0.6	0.7	3.20	3.15	3.65	✓
	Service Yards	0.8	0.8	0.9	3.30	3.15	3.85	✓
	Highways	0.8	0.8	0.9	3.30	3.15	3.85	✓
4	Non-residential Parking	0.7	0.6	0.7	2.00	2.05	2.35	✓
6	Commercial Roof	0.3	0.2	0.05	1.75	1.80	2.30	✓
	Non-residential Parking	0.7	0.6	0.7	2.20	2.15	2.70	✓
	Service Yards	0.8	0.8	0.9	2.30	2.15	2.90	✓
	Highways	0.8	0.8	0.9	2.30	2.15	2.90	✓
7	Commercial Roof	0.3	0.2	0.05	1.50	1.55	2.05	✓
	Non-residential Parking	0.7	0.6	0.7	1.95	1.90	2.45	✓
	Service Yards	0.8	0.8	0.9	2.05	1.90	2.65	✓
	Highways	0.8	0.8	0.9	2.05	1.90	2.65	✓

- 3.44 **Table 3.8** demonstrates that the proposed drainage system will provide significant treatment to surface water prior to discharge from the proposed development. It should be noted that for the on-plot non-residential parking water quality assessment, to provide a robust assessment, it is assumed that permeable paving will be used as this SuDS treatment measure provides a lesser pollution mitigation index score compared to bypass separators.
- 3.45 A Construction Environmental Management Plan (CEMP) will be prepared to support the DCO application and to ensure that the surrounding watercourses are not adversely affected during the construction stages.

Residual Risk and Designing for Exceedance

- 3.46 It is recommended that the final layout uses the proposed road infrastructure to provide drainage exceedance (overland flood flow) routes through the development and towards the periphery SuDS for events in excess of the capacity of the drainage system.
- 3.47 The detention basins have been designed to not flood during the 1 in 100-year + 40% critical storms, with additional freeboard provided above the sensitivity test events. In the event that the outfall for a basin becomes blocked, each detention basin flow control chamber will have a weir wall set above the anticipated 1 in 100-year +40% climate change critical storm water level, to provide a controlled location for water to overtop and drain into the downstream network, to be attenuated in the next detention basin, rather than immediately exceeding onto surrounding land.
- 3.48 If the Catchment 9 basin becomes blocked, exceedance flows will overtop and drain into the A42 culvert, as per the current conditions at the site.
- 3.49 The plots located within Catchments 6 and 7 should be designed such that any exceedance flows in the event of system blockage is kept on-plot and pools within the car parking and/or service yard areas.
- 3.50 In addition to the volume of storage provided within the main attenuation, there will be capacity within upstream pipes and manholes which has not been accounted for at this stage and a further level of redundancy to the network will therefore be provided.

4. MAINTENANCE

- 4.1 A management company will be appointed to maintain the SuDS features, including vegetation maintenance, trash screen clearing and regular outfall inspections. The inlet to the A42 culvert within the site boundary will also be included within the inspection and maintenance regime for the site.
- 4.2 Requirements for ongoing maintenance of the drainage network should form part of the Operation and Maintenance manual for the site and should be undertaken by the site management. Any specialist or proprietary products that are specified at detailed design should have a manufacturer specific maintenance regime which should be included within the document.
- 4.3 It is envisaged that the Operation and Maintenance manual will be developed at the detailed design stage, but some examples for the proposed detention basin, swales, and inlet to the A42 are provided below in **Table 4.1**, **Table 4.2** and **Table 4.3**, respectively.

Table 4.1: The SuDS Manual Typical Maintenance Schedule for Swales

Maintenance Schedule	Typical Frequency	Required Action
Regular Maintenance	Monthly	<ul style="list-style-type: none"> Inspect inlets, outlets and overflows for blockages, and clear if required.
	Monthly (or as required)	<ul style="list-style-type: none"> Remove litter and debris; and Inspect infiltration surfaces for ponding, compaction, silt accumulation, record areas where water is ponding for > 48 hours.
	Monthly (during growing season), or as required	<ul style="list-style-type: none"> Cut grass – to retain grass height within specified design range.
	Monthly for first year then as required	<ul style="list-style-type: none"> Manage other vegetation and remove nuisance plants.
	Monthly for 6 months, quarterly for 2 years, then half yearly	<ul style="list-style-type: none"> Inspect vegetation coverage.
	Half yearly	<ul style="list-style-type: none"> Inspect inlets and facility surface for silt accumulation, establish appropriate silt removal frequencies.
Occasional Maintenance	As required or if bare soil is exposed over > 10% of the swale treatment area	<ul style="list-style-type: none"> Reseed areas of poor vegetation growth, alter plant types to better suit conditions, if required.
Remedial Action	As required	<ul style="list-style-type: none"> Repair erosion or other damage by re-turfing or reseeding; Relevel uneven surfaces and reinstate design levels; Scarify and spike topsoil layer to improve infiltration performance, break up silt deposits and prevent compaction of the soil surface; Remove build-up of sediment on upstream gravel trench, flow spreader or at top of filter strip; and Remove and dispose of oils or petrol residues using safe standard practices.

Table 4.2: The SuDS Manual Typical Maintenance Schedule for Detention Basins

Maintenance Schedule	Typical Frequency	Required Action
Regular Maintenance	Monthly	<ul style="list-style-type: none"> Remove litter and debris; Inspect inlets, outlets and overflows for blockages, and clear if required; and Inspect banksides, structures, pipework etc for evidence of physical damage.
	Monthly (during growing season, or as required)	<ul style="list-style-type: none"> Cut grass – for spillways and access routes.
	Monthly for first year, then annually or as required	<ul style="list-style-type: none"> Inspect inlets and facility surface for silt accumulation. Establish appropriate silt removal frequencies.
	Monthly at start, then as required	<ul style="list-style-type: none"> Manage other vegetation and remove nuisance plants.
	Half yearly (spring – before nesting season, and autumn)	<ul style="list-style-type: none"> Cut grass – meadow grass in and around basin.
	Annually	<ul style="list-style-type: none"> Check any penstocks and other mechanical devices; Tidy all dead growth before start of growing season; and Manage wetland plants in outlet pool – where provided.
	Annually or as required	<ul style="list-style-type: none"> Remove sediment from inlets, outlet and forebay.
Occasional Maintenance	As required	<ul style="list-style-type: none"> Reseed areas of poor vegetation growth.
	Every 2 years, or as required	<ul style="list-style-type: none"> Prune and trim any trees and remove cuttings.
	Every 5 years, or as required	<ul style="list-style-type: none"> Remove sediment from inlets, outlets, forebay and main basin when required.
Remedial Action	As required	<ul style="list-style-type: none"> Repair/rehabilitation of inlets, outlets and overflows; and Relevel uneven surfaces and reinstate design levels.

Table 4.3: Typical Maintenance Schedule for the A42 Inlet Headwall

Maintenance Schedule	Typical Frequency	Required Action
Regular Maintenance	Monthly	<ul style="list-style-type: none"> Undertake inspection of grating to ensure it is securely fixed without blockages.
	Monthly (during growing season)	<ul style="list-style-type: none"> Strim vegetation 1m min. surround to structures and keep hard aprons free from silt and debris.
	Annually, after major storm event, or as required	<ul style="list-style-type: none"> Inspect surface structures removing obstructions and silt as necessary. Check there is no physical damage
	As required	<ul style="list-style-type: none"> Undertake inspection of headwall after leaf fall in autumn.
Occasional Maintenance	As required	<ul style="list-style-type: none"> Repair physical damage if necessary. Remove and dispose of oils or petrol residues using safe standard practices.
Monitoring	Monthly / after large storm events	<ul style="list-style-type: none"> Inspect structures for evidence of poor operation.
	Half yearly	<ul style="list-style-type: none"> Inspect silt accumulation rates and establish appropriate removal, frequencies.

5. FOUL WATER DRAINAGE

- 5.1 Foul water will be drained from the proposed development separately to surface water.
- 5.2 Based on level constraints within the site and the location of the nearby public sewerage infrastructure, foul flows from the entire development cannot drain via gravity. Therefore, it is proposed that foul flows will be collected and conveyed through the development towards a Type 3 pumping station, to be located towards the southern extent of the development.
- 5.3 It is proposed to pump flows back through the development to the north and into the existing foul public sewer network located within the A453 in the northwest site boundary.
- 5.4 An alternative foul outfall is within the verge of the A453 to the east of the proposed site access point.
- 5.5 A pre-development enquiry with STW (**Appendix 10**) anticipates that the local sewerage network does not currently have capacity to accept flows from the proposed development and hydraulic modelling is required to determine what improvements to the network are necessary.
- 5.6 The final foul outfall location is to be confirmed; however, a proposed pumping station and potential outfall locations are illustrated on the Conceptual Drainage Strategy within **Appendix 7**.

6. SUMMARY

- 6.1 This statement and supporting appendices demonstrate that the drainage design for the development will comply with the relevant local and national standards, specifically the hierarchy of discharge, runoff rate and volume criterion.
- 6.2 This SDS is intended to support a DCO and as such the level of detail included is commensurate and subject to the nature of the proposals.


Table 6.1: Sustainable Drainage Statement Summary

		Existing Site	Proposed Development
Approximate Site Area (Ha)		105.7 (approx.)	
Impermeable Area (Ha)		0	69.16 (approx.)
Outfall Location		Watercourse	Watercourse
Peak Runoff Rate (l/s)	1 in 1-Year	186.7	114.4
	QBAR	228.2	
	1 in 30-Year	456.5	
	1 in 100-Year	581.0	
	1 in 100-Year + CC	-	
Volume Control		-	Discharge rate limited below QBAR
Proposed Storage Volume		-	60,385m ³
Flow Control Type		-	Vortex
SuDS Features		-	Detention Basins, Swales and Downstream Defender
Maintenance Responsibility		-	Management Company

- 6.3 It is envisaged that the final drainage strategy will be determined during the detailed design stage, as the development layout is finalised.

APPENDICES

Appendix 1: Proposed Parameters Plan

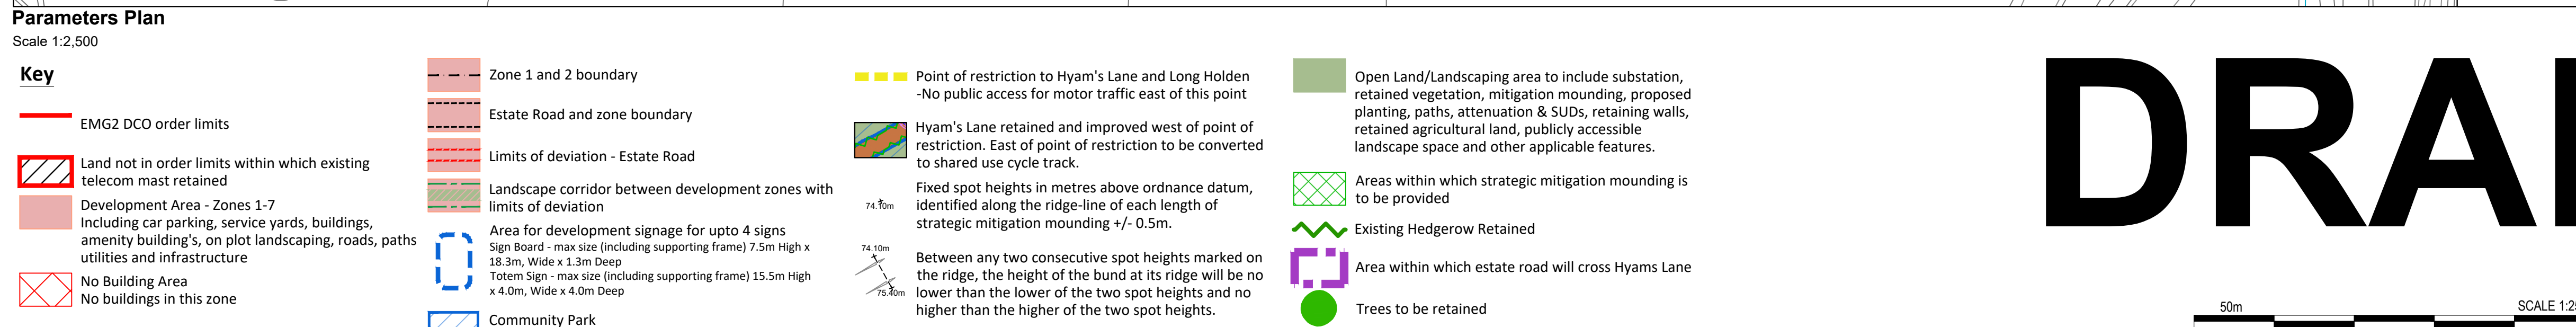

P11	19.06.05	Titleblock amended	LM	MS
P10	30.05.25	Minor amendments to key and plan	LM	MS
P9	30.05.25	Minor amendments to key and plan	LM	MS
P8	28.05.25	Country Park boundary added	LM	MS
P7	20.05.25	Boundary and schedule amended	LM	MS
P6	12.05.25	Schedule updated	LM	MS
P5	25.04.25	Signage area amended to north of zone 7	LM	MS
P4	15.04.25	Levels, tree retention and plot boundaries updated	LM	MS
P3	28.01.25	Title block changes	LM	MS
P2	28.01.25	Minor amendments to key and plan	LM	MS
Rev	Date	Details of issue / revision	Draw	Rev



THE EAST MIDLANDS GATEWAY PHASE 2 AND HIGHWAY ORDER 2021

Drawing Title

**PARAMETERS PLAN
EMG2 MAIN SITE AND
COMMUNITY PARK**

Scale	1:2500	Drawn	LM
Size	A1	Reviewed	MS
Regulation		Document	
5(2) (o)		DCO 2.5	
Drawing Status			
CONSULTATION DRAFT			
Drawing No.			Revision
EMG2-UMC-SI-01-DR-A-0088			P11


Appendix 2: Topographical Survey

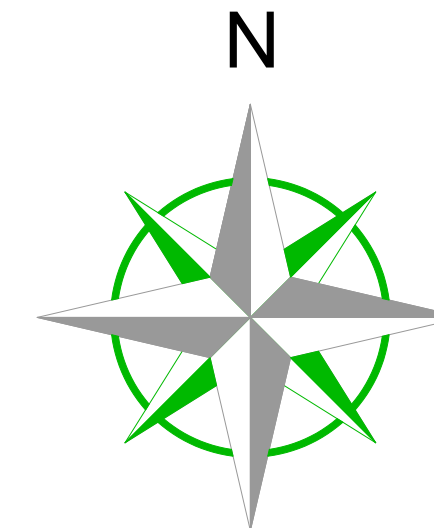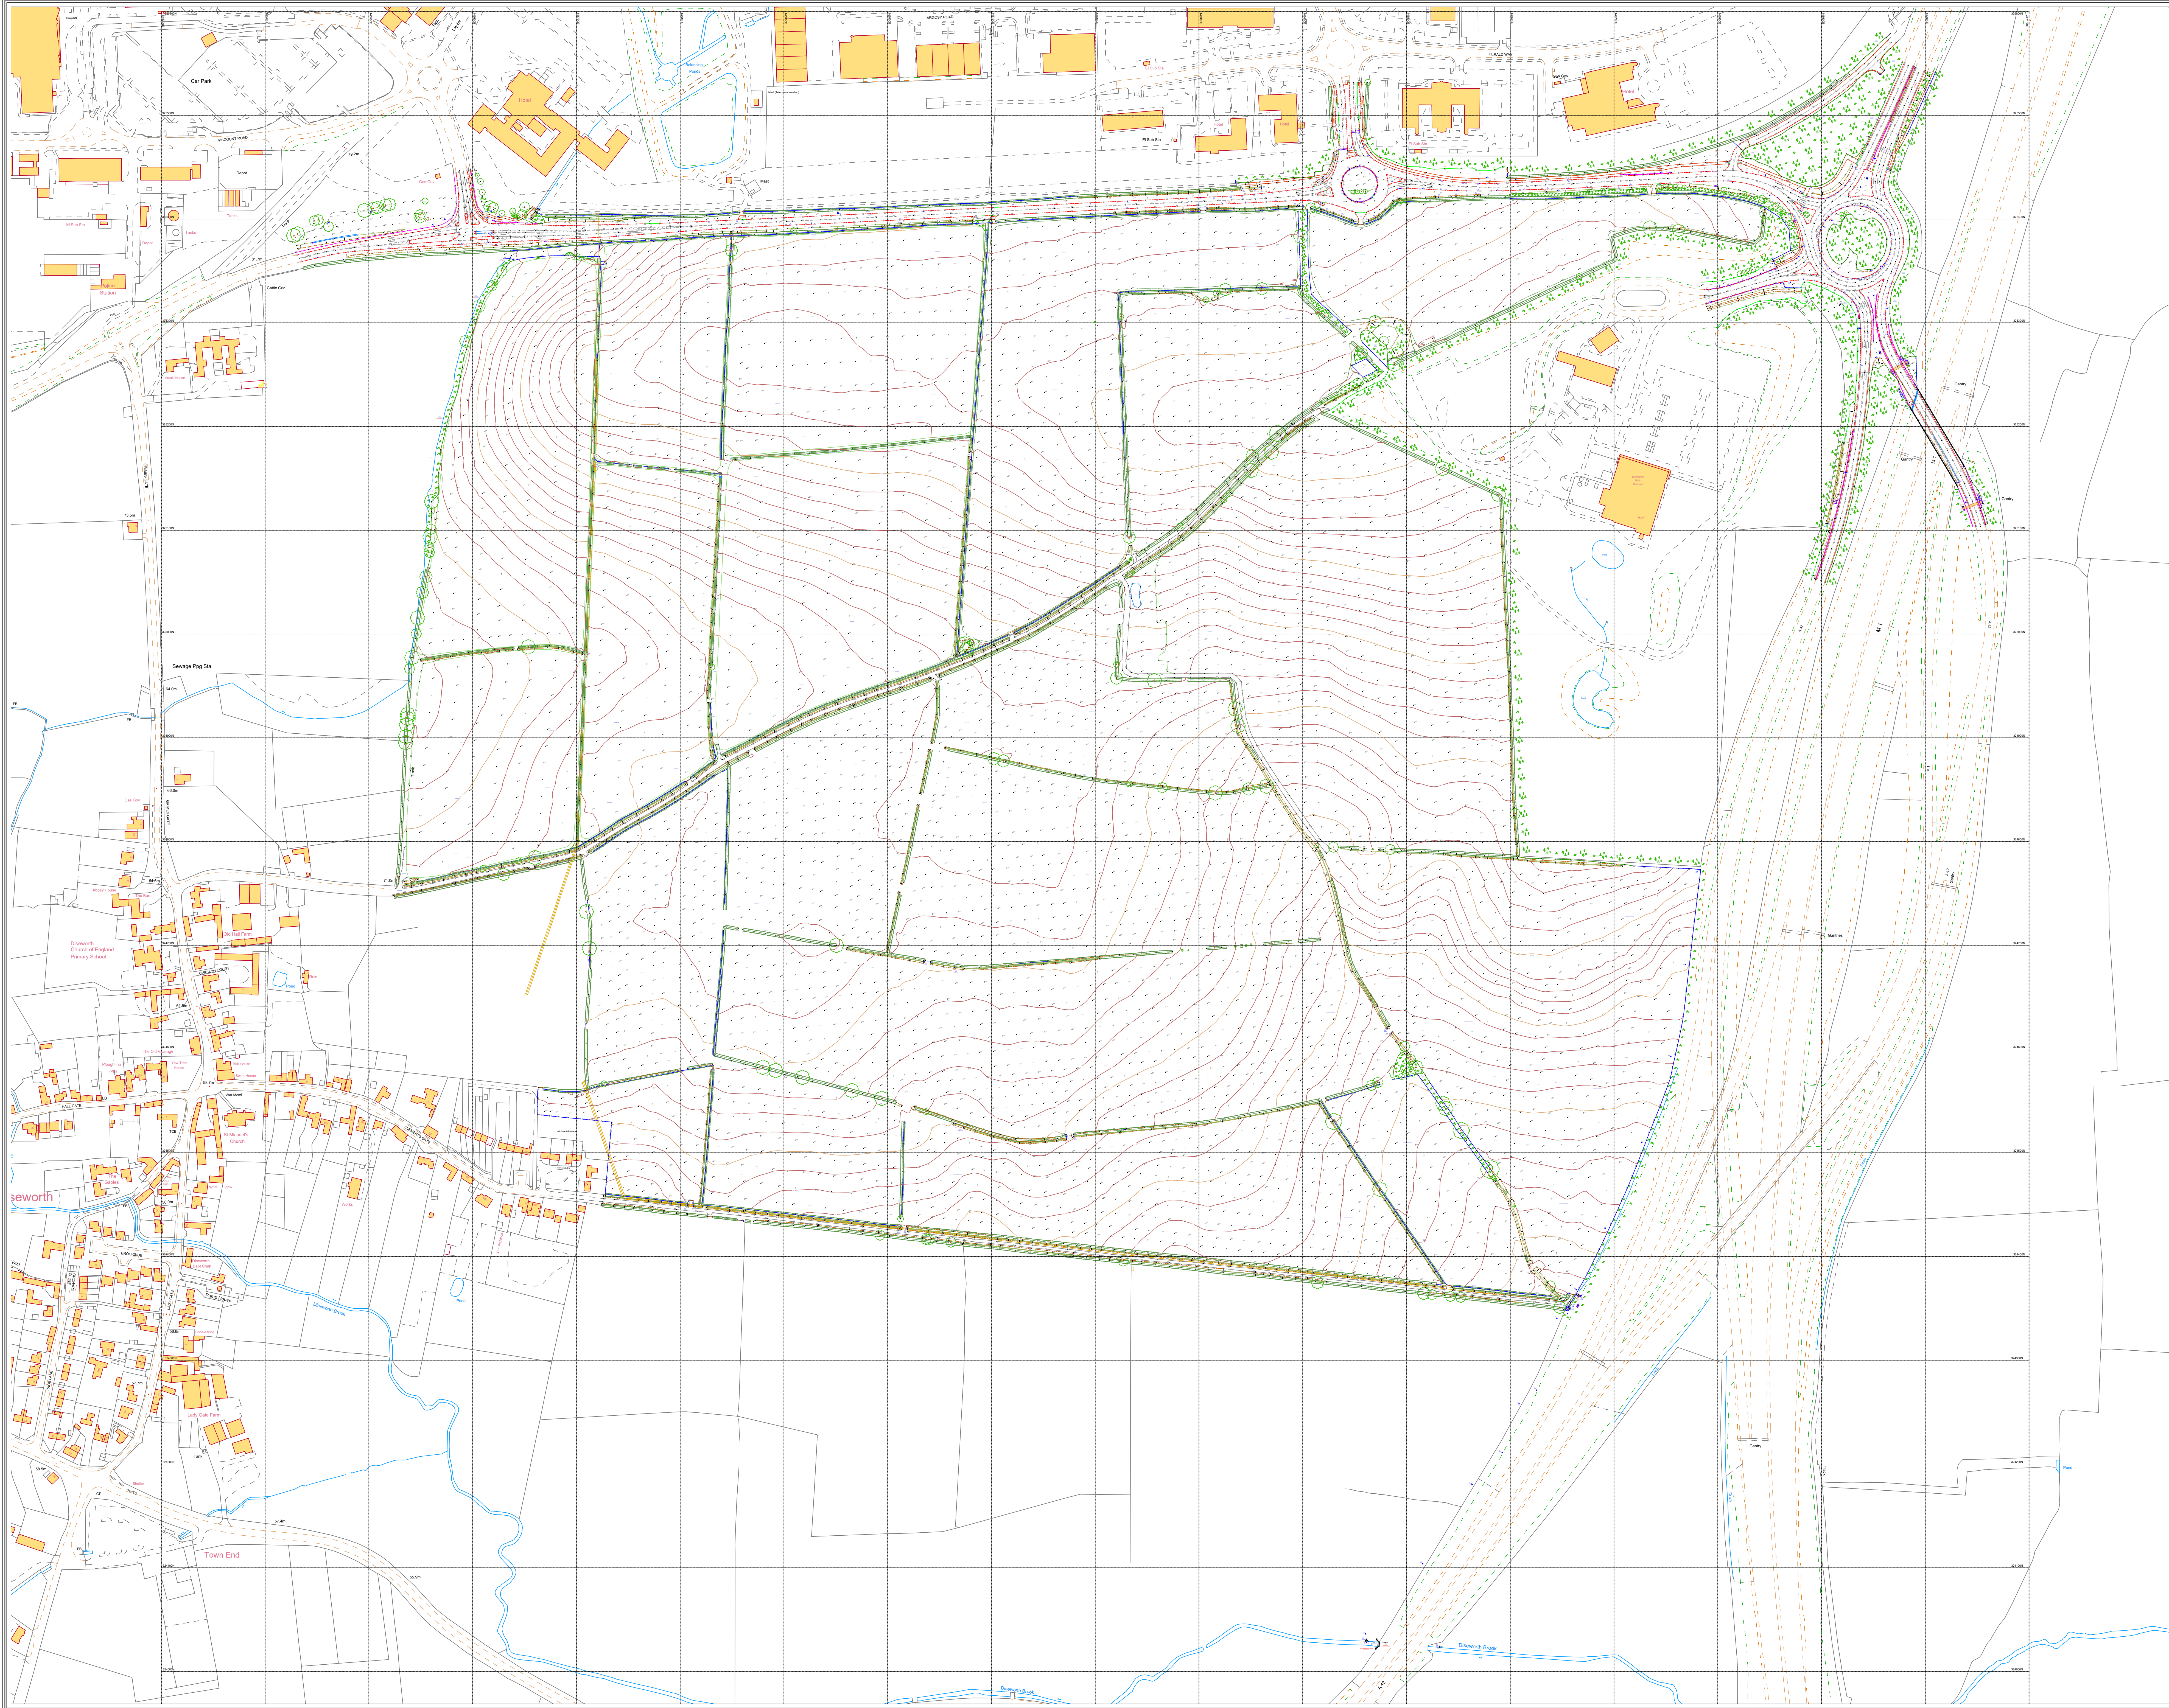

Station Information:

Station	Easting (m)	Northing (m)	Level (m)
D1	446495.174	325438.125	87.825
D2	446600.470	325437.555	88.362
D3	446736.974	325453.074	88.872
D4	446866.060	325436.925	86.081
D5	446878.948	325372.322	85.201
D6	446947.121	325448.280	84.444
GH2	446110.602	325402.684	84.812
GH3	445856.595	325399.844	81.922
N2	446987.475	325220.991	83.873
R1	445582.903	325381.661	75.930
R2	445469.850	325374.391	79.274
SA1	446415.699	325424.224	87.303

OS Note:
Some services may have been omitted due to parked vehicles.
The Ordnance Survey tile is to be used as a guide only.

OS Buildings  Surveyed Buildings 

This survey has been orientated to the Ordnance Survey (O.S.) National Grid OSG36(15) via Global Navigation Satellite Systems (GNSS) and the O.S. Active Network (OS Net).































A true OSG36 coordinate has been established near to the site centre via a transformation using the OSTN15GB & OSGM15GB transformation models.

The survey has been correlated to this point and a further one or more OSG36(15) points established to create a true O.S. bearing for angle orientation.

No scale factor has been applied to the survey therefore the coordinates shown are arbitrary & not true O.S. Coordinates which have a scale factor applied.

Please refer to Survey Station Table to enable establishment of the on-site grid and datum

Legend:

	Shielding	IC	Interatomic interaction	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin
	Tube	PI	Polarization	ES	Electron spin

1	30.08.22	Additional survey	TC	GH146
<i>Rev</i>	<i>Date</i>	<i>Description</i>	<i>Drawn</i>	<i>Q. Re</i>



<ul style="list-style-type: none"> <input type="checkbox"/> Topographical Surveys <input type="checkbox"/> Site Engineering <input type="checkbox"/> Utility / CCTV Surveys 	<ul style="list-style-type: none"> <input type="checkbox"/> Measured Building Surveys <input type="checkbox"/> 3D Laser Scanning <input type="checkbox"/> Revit & BIM Models
<p>Rowan House Duffield Road Little Eaton Derby DE21 5DR</p>	
<p>Tel (01332) 830044 Fax (01332) 830055 admin@greenhatch-group.co.uk www.greenhatch-group.co.uk</p>	

St Albans Unit B, The Courtyard Alban Park St Albans Hertfordshire AL4 0LA t. (01727) 854481	Newcastle 24 Riverside Studios Amethyst Road Newcastle Bus, Park Newcastle-U-Tyne NE4 7YL t. (01912) 736391	London 27, Cornwall Terrace New Regents Park London NW1 5LL t. (02072) 241806
---	--	--

CLIENT	SEGRO PLC
--------	-----------

PROJECT
EMG Phase 2 (Freeport)
Hyam's Lane, Diseworth
Derby, DE74 2QD

TITLE	Topographical Survey
-------	-------------------------

SCALE A0@ 1: 2000	DATE 19.04.22
DRAWN JM	QUALITY REF GH13710

Level datum	See note
Grid orientation	See note
Job number	34529A


Drawing No.	Rev.
34529A_T	1

Comments
This plan should only be used for its original purpose. Greenhatch Group accepts no responsibility for this plan if supplied to any party other than the original client.

Drainage information (where applicable) has been visually inspected from the surface and therefore should be treated as approximate only.

Notes:

Appendix 3: Sewer Asset Records

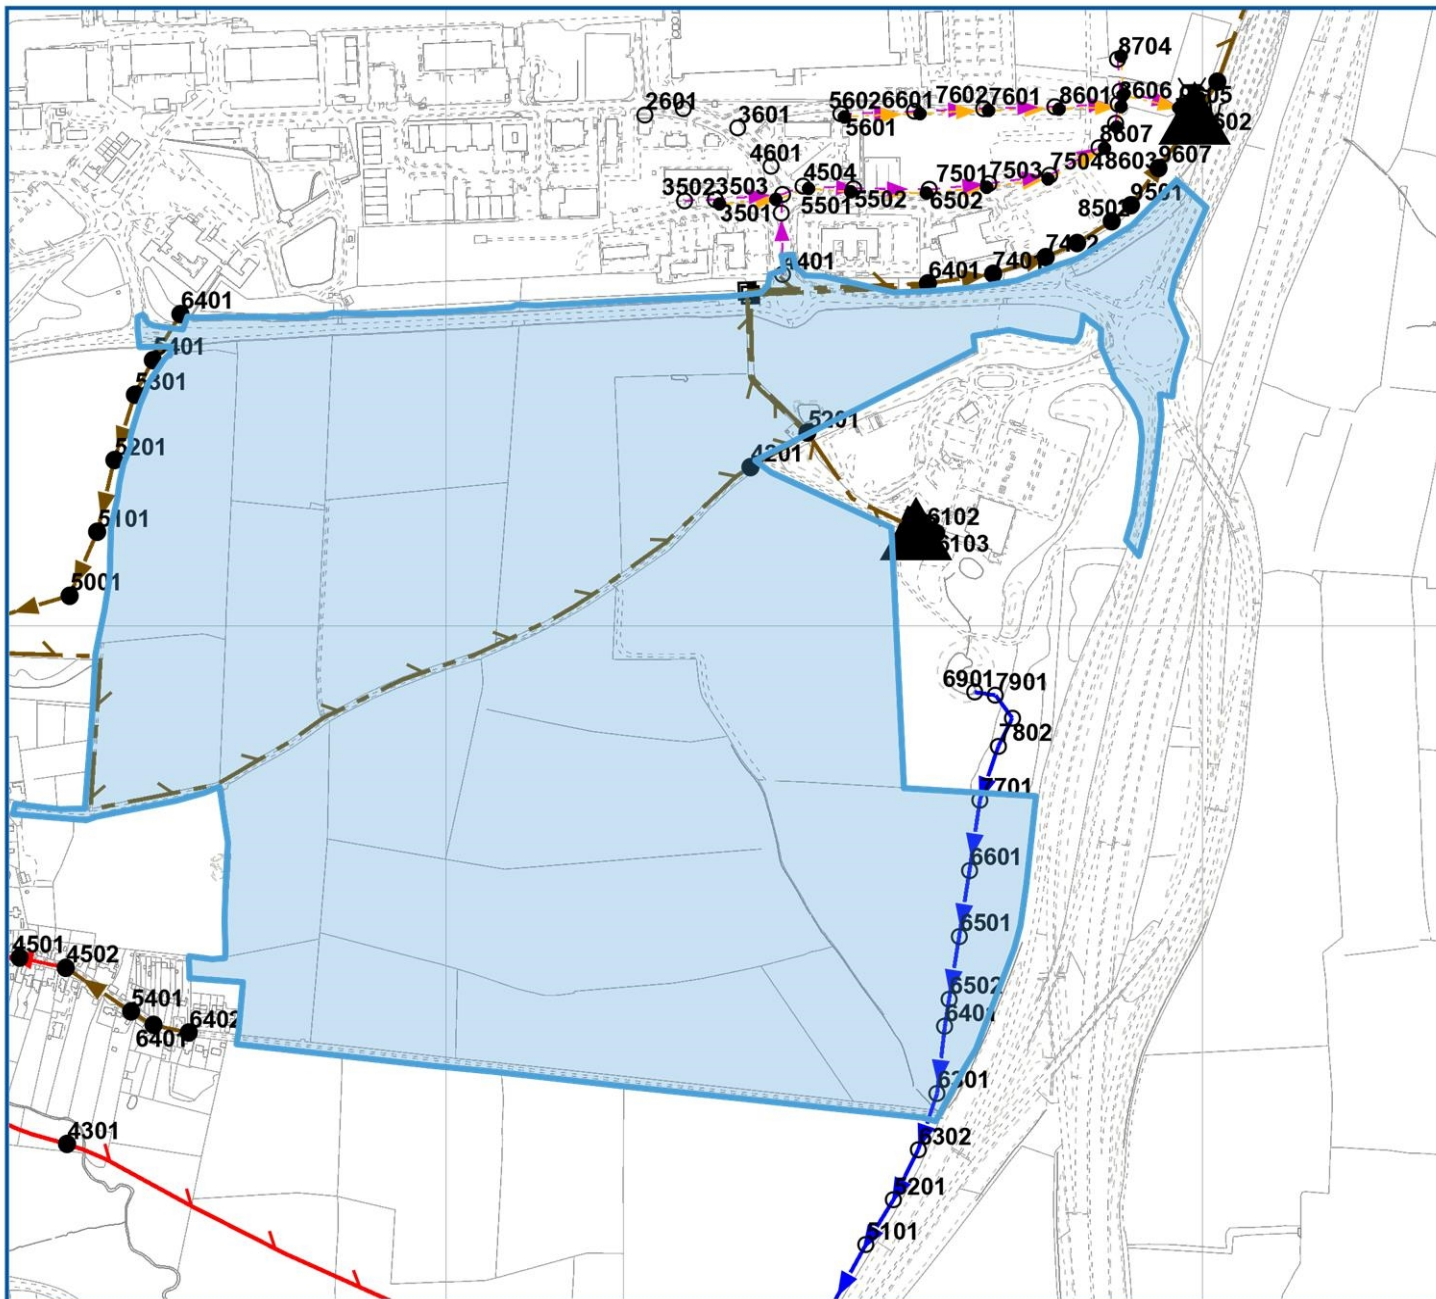

LEGEND			
Operational Site			
Waste Water Pump	Gravity Sewer Pipe	S104 Foul Vacuum Sewer	Scalway
Transferred Asset	Foul Gravity Sewer	Private Surface Water Vacuum Sewer	Overflow
S24	Combined Gravity Sewer	Private Combined Vacuum Sewer	Fitting
S104	Surface Water Gravity Sewer	Private Foul Vacuum Sewer	Blind Shaft
S102	S104 Surface Water Gravity Sewer	Surface Water Siphon	Facility Connector
Null Private	S104 Combined Gravity Sewer	Combined Siphon	Head Node
Null	S104 Foul Gravity Sewer	Private Surface Water Siphon	Lamp Hole
None	Private Combined Gravity Sewer	Private Combined Siphon	Sewerage Air Valve
Highway Drain	Private Foul Gravity Sewer	Private Foul Siphon	Sewerage Chemical Injection Point
Adopted Sewer	Surface Water Unserved Pipe	S104 Surface Water Siphon	Sewerage Hatch Box
Storage	Combined Unserved Pipe	S104 Combined Siphon	Sewerage Pressure Washout
Disposal Site	Foul Unserved Pipe	Surface Water Unserved Pipe	Vent Column
Off-Line Waste Water Storage	Transferred Surface Water Sewer	Combined Unserved Pipe	Waste Water Outfall
On-Line Waste Water Storage	Transferred Combined Sewer	Foul Unserved Pipe	Control Valve
Wet Well	Transferred Foul Sewer	Disposal Pipe	Hydrocable
Waste Water Process Structure	Disposal Pipe	Service Pipe	Penstock
Sewage Treatment Point	Overflow Pipe	Surface Water Lateral Drain	Sewerage Isolation Valve
Sewage Treatment Structure	Culverted Water Course	Combined Lateral Drain	Sewerage Non Return Valve
Sludge Treatment Point	Waste Internal Site Pipe	Foul Lateral Drain	Manhole Annotation
Sludge Treatment Structure	Sewer Service Connection	S104 Surface Water Lateral Drain	Print 1000m Line
Manhole	Gravity Sewer Others	S104 Foul Lateral Drain	
Foul/Bifurcation Manhole	Pressure Sewer Pipe	S104 Combined Lateral Drain	
Combined Bifurcation Manhole	Surface Water Pressure Sewer	S104 Foul Lateral Drain	
Surface Water Bifurcation Manhole	Combined Pressure Sewer	Private Surface Water Lateral Drain	
Dual Manhole	Foul Pressure Sewer	Private Combined Lateral Drain	
Foul Single Manhole	S104 Surface Water Pressure Sewer	Private Foul Lateral Drain	
Combined Single Manhole	S104 Combined Pressure Sewer	Transferred Surface Water Lateral Drain	
Surface Water Single Manhole	S104 Foul Pressure Sewer	Transferred Combined Lateral Drain	
Twin Manhole	Private Surface Water Pressure Sewer	Transferred Foul Lateral Drain	
Foul Adopted Manhole	Private Combined Pressure Sewer		
Combined Adopted Manhole	Private Foul Pressure Sewer		
Surface Adopted Manhole	Surface Water Vacuum Sewer		
Transferred Manhole	Foul Vacuum Sewer		
Unserved Manhole	Combined Vacuum Sewer		
	S104 Surface Water Vacuum Sewer		
	S104 Combined Vacuum Sewer		
	Ancillary		
	Balancing Lagoon		
	Grease Trap		
	Interceptor		
	Screen		
	Chamber		
	Flushing Chamber		

Severn Trent Water Limited
 Asset Data Management
 PO Box 5344
 Coventry
 CV3 9FT
 Telephone: 0345 601 6616

SEWER RECORD

O/S Map Scale: 1:10,000

This map is centred upon:

Date of Issue: 25-11-24

X: 446366.46 **Y:** 324962.64

Disclaimer Statement:
1 Do not scale off this Map.
 2 This plan and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this plan and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of SEVERN TRENT WATER assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems.
 3 On 1 October 2011 most private sewers and private lateral drains in Severn Trent Water's sewerage area, which were connected to a public sewer as at 1 July 2011, Transferred to the ownership of Severn Trent Water and became public sewers and public lateral drains. A further transfer takes place on 1 October 2012. Private pumping stations, which form part of these sewers or lateral drains, will transfer to ownership of Severn Trent Water on or before 1 October 2016. Severn Trent Water does not possess complete records of these assets. These assets may not be displayed on the map.
 4 Reproduction by permission of Ordnance Survey on behalf of HMSO. Crown Copyright and database right 2004. All rights reserved.
 5 Ordnance Survey licence number: 100031673
 6 Document users other than SEVERN TRENT WATER business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.

Sewer Node

Sewer Pipe Data

Reference	Cover Level	Invert Level Upstream	Invert Level Downstream	Purpose	Material	Pipe Shape	Max Size	Min Size	Gradient	Year Laid
SK46238704	49.185	47.76	47.48	S	CO	C	525	<UNK>	57.71	31/12/1899 00:00:00
SK46246501	69.188	66.45	63.58	S	CO	C	375	<UNK>	29.31	31/12/1899 00:00:00
SK46259608	81.716	80.09	<UNK>	F	VC	C	300	<UNK>	0.35	31/12/1899 00:00:00
SK46258702	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46244001	56.3829	54.65	54.67	S	CO	C	375	<UNK>	<UNK>	31/12/1899 00:00:00
SK46255602	<UNK>	<UNK>	<UNK>	S	CO	C	450	<UNK>	0	31/12/1899 00:00:00
SK46239706	50.45	49.52	48.93	S	CO	C	300	<UNK>	23.05	31/12/1899 00:00:00
SK46254501	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46258501	91.01	88.72	85.49	F	VC	C	300	<UNK>	16.41	31/12/1899 00:00:00
SK46239704	50.525	48.9	48.668	C	CO	C	<UNK>	<UNK>	<UNK>	17/01/2022 00:00:00
SK45255401	73.564	70.564	70.477	F	VC	C	300	<UNK>	577.44	31/12/1899 00:00:00
SK45255001	69.938	68.038	67.704	F	VC	C	300	<UNK>	356.36	31/12/1899 00:00:00
SK46254502	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46254505	<UNK>	<UNK>	<UNK>	S	CO	C	450	<UNK>	0	31/12/1899 00:00:00
SK45243504	59.2299	57.46	57.18	C	VC	C	225	<UNK>	13.39	31/12/1899 00:00:00
SK46247801	87.207	83.77	83.05	S	CO	C	375	<UNK>	57.58	31/12/1899 00:00:00
SK46256502	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46255501	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46258601	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46259603	80.16	<UNK>	<UNK>	F	<UNK>	C	300	<UNK>	0	31/12/1899 00:00:00
SK47231703	50.8499	48.15	48.174	C	CO	C	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SK46254201	<UNK>	<UNK>	<UNK>	F	<UNK>	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SK46239701	49.2449	47.68	44.98	S	CO	C	600	<UNK>	39.51	31/12/1899 00:00:00
SK46254401	<UNK>	<UNK>	<UNK>	S	VC	C	300	<UNK>	0	31/12/1899 00:00:00
SK46246401	63.02	60.58	58.58	S	CO	C	375	<UNK>	45.06	31/12/1899 00:00:00
SK47231701	50.844	48.154	47.92	C	CO	C	<UNK>	<UNK>	351.78	31/12/1899 00:00:00
SK46245101	57.1629	55.62	55.18	S	CO	C	375	<UNK>	228.91	31/12/1899 00:00:00
SK46256103	<UNK>	<UNK>	88.34	F	<UNK>	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SK46238702	52.235	49.32	49.09	C	CO	C	<UNK>	<UNK>	339.83	31/12/1899 00:00:00
SK47232701	51.22	47.9	47.765	C	CO	C	<UNK>	<UNK>	603.43	31/12/1899 00:00:00
SK45255201	71.732	69.532	68.964	F	VC	C	300	<UNK>	171.81	31/12/1899 00:00:00
SK45253001	68.804	67.704	63.25	F	VC	C	<UNK>	<UNK>	22.29	31/12/1899 00:00:00
SK46246302	59.6199	57.49	56.78	S	CO	C	375	<UNK>	102.99	31/12/1899 00:00:00
SK46258701	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46245001	56.3079	55.16	54.71	S	CO	C	375	<UNK>	196.53	31/12/1899 00:00:00
SK45245401	65.3399	63.31	61.51	F	VC	C	150	<UNK>	58.03	31/12/1899 00:00:00
SK46238703	52.095	50.44	47.73	S	CO	C	525	<UNK>	13.14	31/12/1899 00:00:00
SK47231704	50.895	48.5	48.2	C	CO	C	<UNK>	<UNK>	196.83	31/12/1899 00:00:00
SK46253501	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46258603	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK47233701	50.71	47.76	47.51	C	CO	C	<UNK>	<UNK>	301.16	31/12/1899 00:00:00

Sewer Node

Sewer Pipe Data



Reference	Cover Level	Invert Level Upstream	Invert Level Downstream	Purpose	Material	Pipe Shape	Max Size	Min Size	Gradient	Year Laid
SK46257401	<UNK>	<UNK>	90.62	F	VC	C	<UNK>	<UNK>	<UNK>	31/12/1899 00:00:00
SK46259607	83.6419	81.74	80.12	F	VC	C	300	<UNK>	34.57	31/12/1899 00:00:00
SK46258704	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46257501	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46255502	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46256102	93.1679	88.33	87.63	F	VC	C	225	<UNK>	19.51	31/12/1899 00:00:00
SK45246402	66.2699	64.41	64.02	F	VC	C	150	<UNK>	123.13	31/12/1899 00:00:00
SK46258608	<UNK>	<UNK>	<UNK>	S	CO	C	750	<UNK>	0	31/12/1899 00:00:00
SK46258607	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46245201	58.755	56.78	55.66	S	CO	C	375	<UNK>	62.32	31/12/1899 00:00:00
SK46257402	92.5179	90.58	88.77	F	VC	C	300	<UNK>	24.86	31/12/1899 00:00:00
SK46258502	87.8349	85.49	83.93	F	VC	C	300	<UNK>	20.51	31/12/1899 00:00:00
SK46256601	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46246502	65.302	63.54	60.6	S	CO	C	375	<UNK>	12.57	31/12/1899 00:00:00
SK46259602	80.16	<UNK>	<UNK>	F	<UNK>	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SK46253502	<UNK>	<UNK>	<UNK>	S	CO	C	375	<UNK>	0	31/12/1899 00:00:00
SK45255301	73.177	70.477	69.532	F	VC	C	300	<UNK>	95.53	31/12/1899 00:00:00
SK45244301	55.0999	<UNK>	<UNK>	C	PE	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SK46257602	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46246301	60.332	58.56	57.5	S	CO	C	375	<UNK>	74.13	31/12/1899 00:00:00
SK45244501	61.7599	59.75	57.48	C	VC	C	225	<UNK>	36.22	31/12/1899 00:00:00
SK46255601	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46256602	<UNK>	<UNK>	<UNK>	S	CO	C	525	<UNK>	0	31/12/1899 00:00:00
SK46258605	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46254503	<UNK>	<UNK>	<UNK>	S	CO	C	525	<UNK>	0	31/12/1899 00:00:00
SK46258604	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK45246401	65.3499	64.01	63.32	F	VC	C	150	<UNK>	49.86	31/12/1899 00:00:00
SK47250701	80.0309	<UNK>	88.8	F	<UNK>	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SK46257502	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46259606	80.16	<UNK>	<UNK>	F	<UNK>	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00
SK46246901	85.5559	84.43	84.21	S	CO	C	375	<UNK>	126.36	31/12/1899 00:00:00
SK46258602	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46256501	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46254504	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46257503	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
SK46259501	86.0569	83.9	81.76	F	VC	C	300	<UNK>	28.97	31/12/1899 00:00:00
SK46247802	84.507	82.91	76.01	S	CO	C	375	<UNK>	10.91	31/12/1899 00:00:00
SK46259605	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46258703	<UNK>	<UNK>	<UNK>	S	CO	C	1200	<UNK>	0	31/12/1899 00:00:00
SK46258606	<UNK>	<UNK>	<UNK>	S	CO	C	1200	<UNK>	0	31/12/1899 00:00:00
SK46246601	72.0059	69.76	66.49	S	CO	C	375	<UNK>	26.93	31/12/1899 00:00:00
SK46255201	99.359	97.94	<UNK>	F	PVC	<UNK>	<UNK>	<UNK>	0	31/12/1899 00:00:00

Sewer Node

Sewer Pipe Data

Reference	Cover Level	Invert Level Upstream	Invert Level Downstream	Purpose	Material	Pipe Shape	Max Size	Min Size	Gradient	Year Laid
SK46256401	95.2419	93.64	<UNK>	F	VC	C	300	<UNK>	0.93	31/12/1899 00:00:00
SK46239703	50.805	49.08	48.91	C	CO	C	<UNK>	<UNK>	276.53	31/12/1899 00:00:00
SK46239702	30.43	27.71	47.75	S	CO	C	600	<UNK>	<UNK>	31/12/1899 00:00:00
SK46253503	<UNK>	<UNK>	<UNK>	S	CO	C	450	<UNK>	0	31/12/1899 00:00:00
SK45255101	70.8639	68.964	68.038	F	VC	C	300	<UNK>	99.44	31/12/1899 00:00:00
SK46247901	86.9759	84.2	83.81	S	CO	C	375	<UNK>	95.85	31/12/1899 00:00:00
SK47230700	<UNK>	48.668	48.51	C	CO	C	<UNK>	<UNK>	<UNK>	17/01/2022 00:00:00
SK46257601	<UNK>	<UNK>	<UNK>	F	VC	C	225	<UNK>	0	31/12/1899 00:00:00
SK46247701	77.507	74.86	69.81	S	CO	C	375	<UNK>	18.46	31/12/1899 00:00:00
SK45256401	74.7939	70.794	70.564	F	VC	C	300	<UNK>	307.52	31/12/1899 00:00:00
SK45244502	63.33	61.46	59.76	C	VC	C	150	<UNK>	35.89	31/12/1899 00:00:00
SK46257504	<UNK>	<UNK>	<UNK>	S	CO	C	600	<UNK>	0	31/12/1899 00:00:00
<UNK>	<UNK>	<UNK>	<UNK>	F	VC	<UNK>	<UNK>	<UNK>	<UNK>	01/12/2020 00:00:00

Appendix 4: CCTV Survey

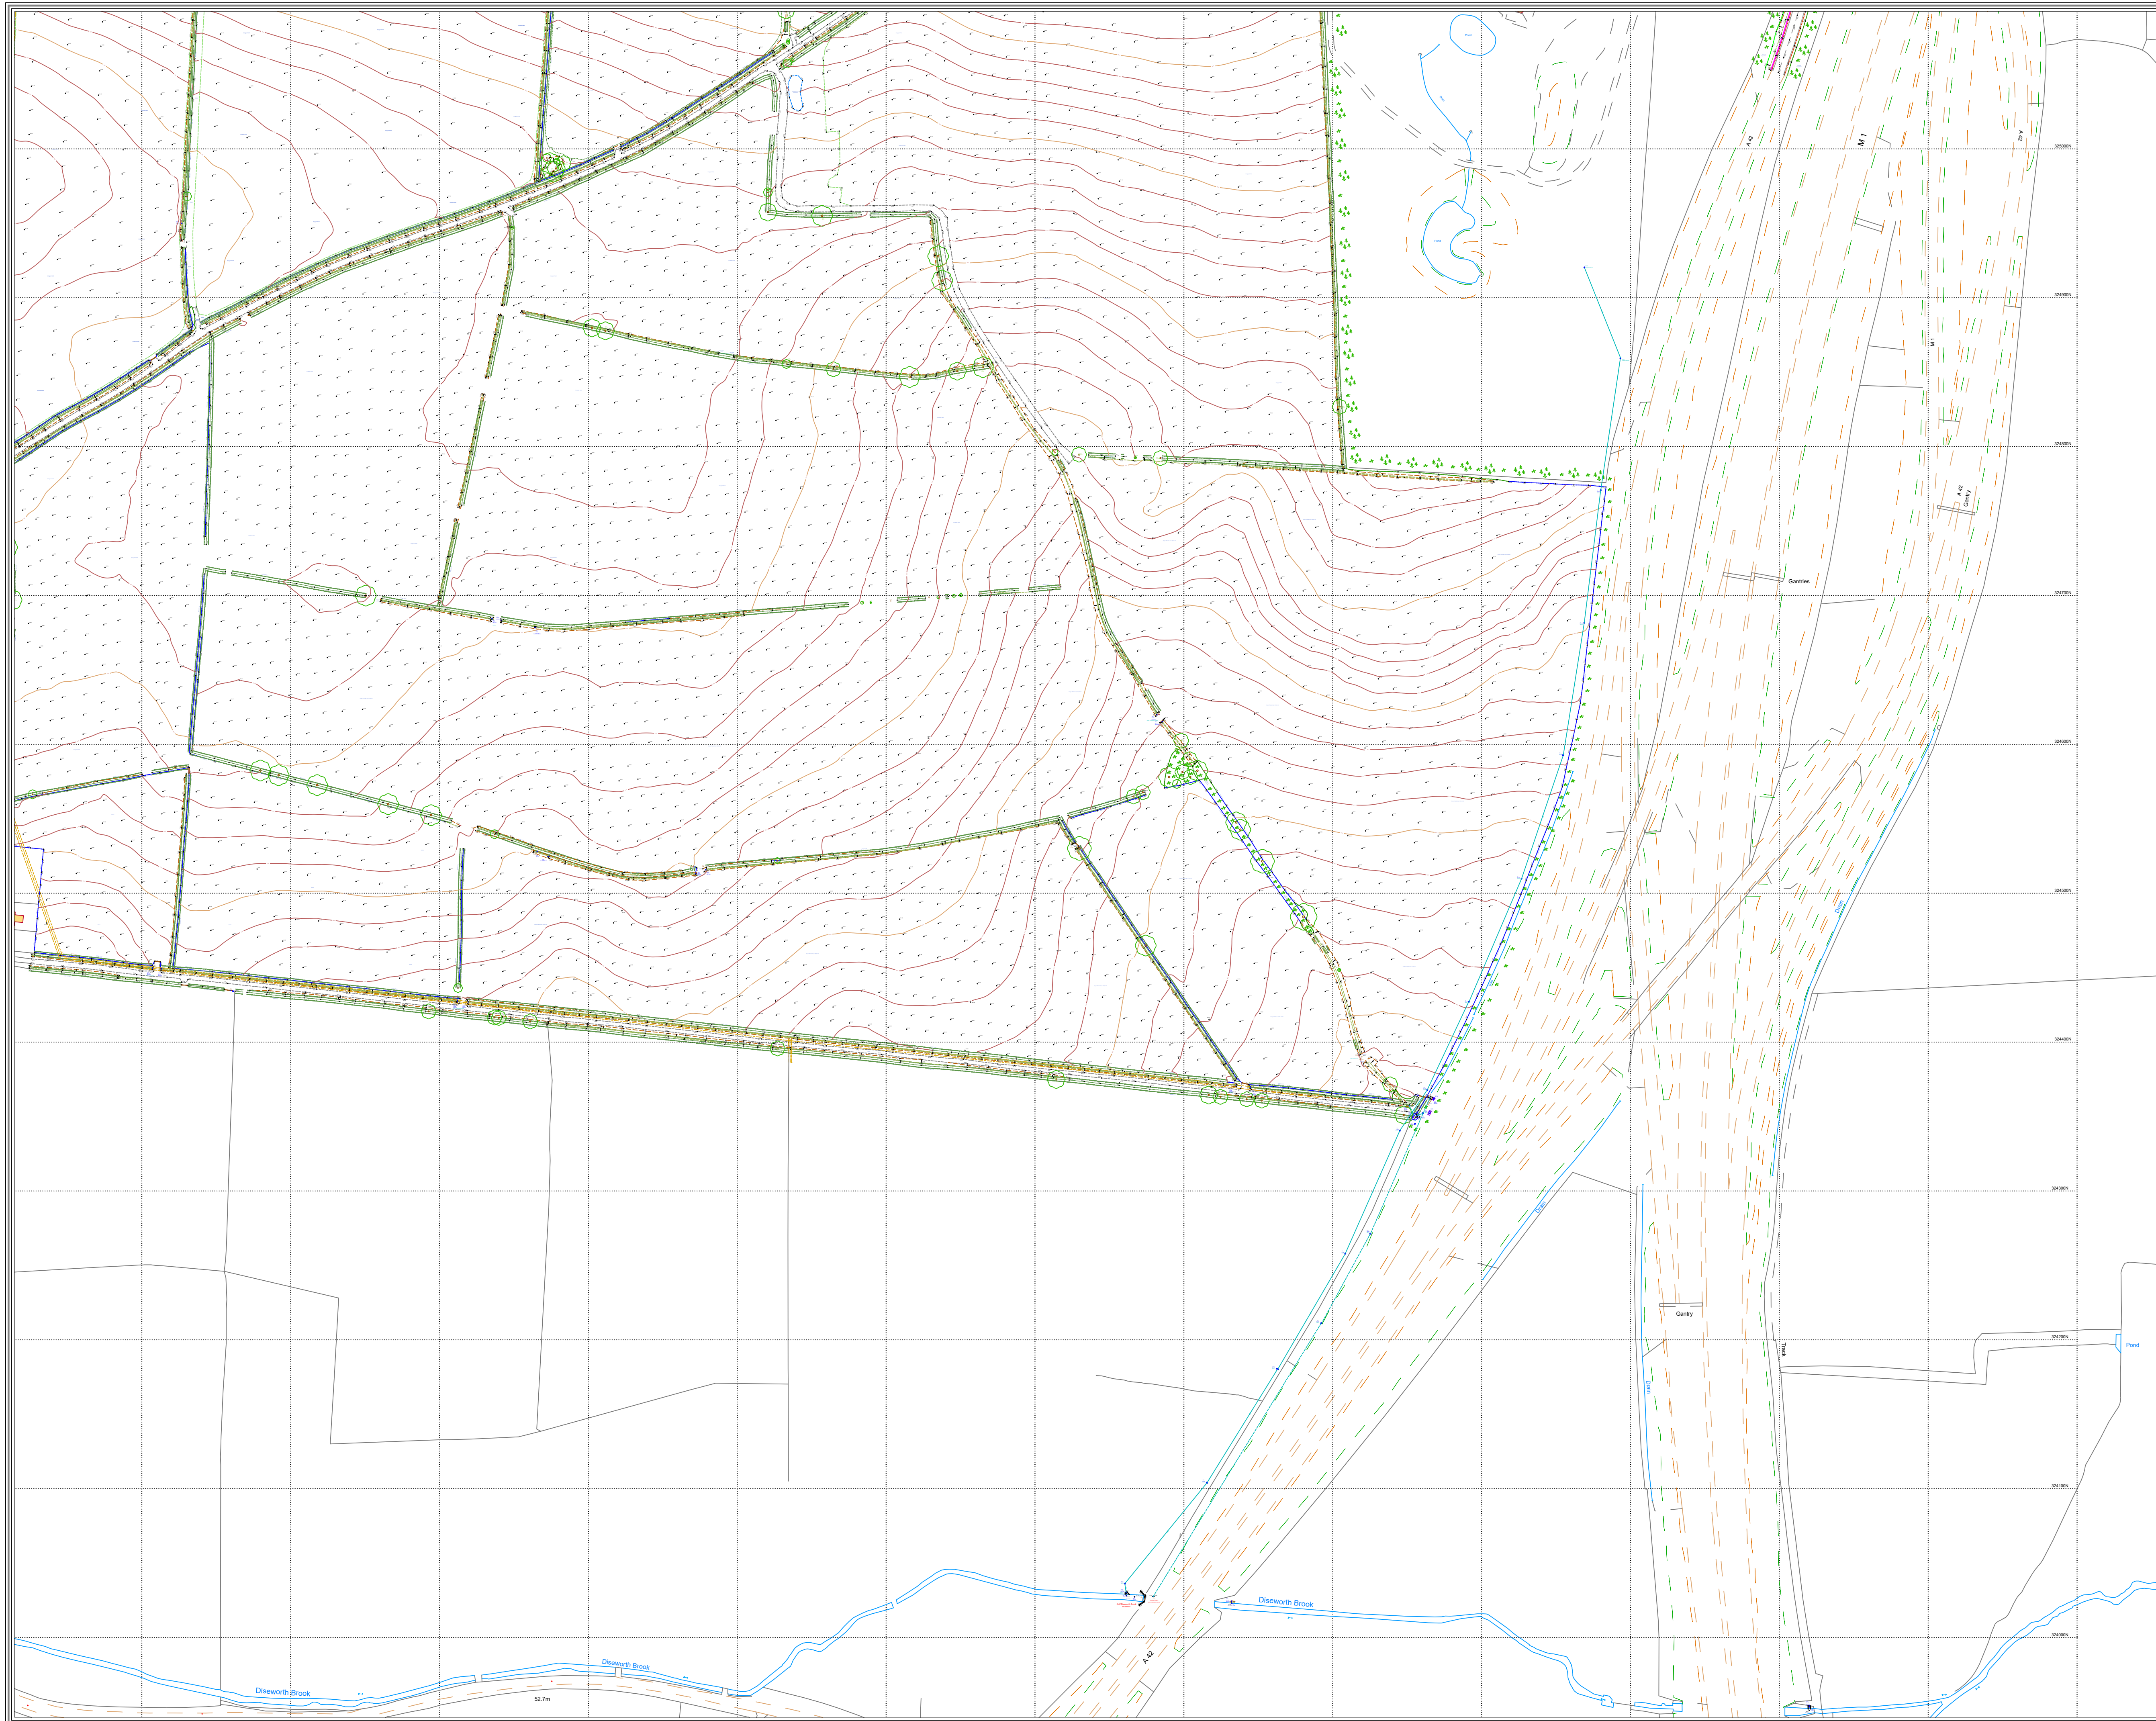

CCTV KEY

- Surface Water
 - - - Assumed Surface Water
 — Foul Water
 - - - Assumed Foul Water
 — Combined W
 - - - Assumed Combined W

ABBREVIATION

- | | | | |
|-------|-------------------------------------|-----|---|
| B | Sewer branch at this point | NCA | No camera access |
| BS | Breaker joint | MH | Mainline |
| C | Circular/canal | CJ | Clean joint medium |
| CCP | Circular/canal pipe section | OSP | Obstruction (external pipe or cable) |
| CPR | Cover, cover in place | REM | Removal observation at this point with exposure |
| CPP | Cover, cover in place | RFL | Root free line |
| CM | Multiple crosses | RMI | Rumms man at joint |
| CMU | Curbside multiple on joint | RE | Re-rodging eye |
| CN | CN | RT | Root trap |
| D | Lined or loose (at) | SW | Surface Water |
| CI/CV | Cement (concrete) | SW | Survey Abandoned |
| CLD | Lined or loose (Cement under water) | UTL | Unable to locate |
| CW | Combined water | UTL | Unable to locate |
| CD | Conductor defective | UTL | Unable to survey |
| CU | Coupling | WL | Water Line |
| DC | Diameter of pipe changes | XG | Collapsing to pipe |
| DEC | Settled deposits but not compacted | | |
| DEE | Excavation water light | | |
| DES | Excavation light at joint | | |
| DET | Detrital nodules | | |
| DSB | Disinfectant | | |
| DES | Detrital soil | | |
| DD | Overturned deposits | | |
| DE | Other alternative deposits | | |
| FC | Fraction circumferential | | |
| FCI | Fraction circumferential on joint | | |
| FI | Fraction longitudinal | | |
| FM | Fraction multiple | | |
| FR | Find water | | |
| G | Go | | |
| H | Hold | | |
| HJ | Hook at joint | | |
| J | Joint | | |
| IB | Infiltration running | | |
| IM | Infiltration stopping | | |
| JN | Joint displaced | | |
| JN | Joint | | |
| JND | Joint Nodules | | |
| JND | Joint Nodules effective | | |
| LD | Line down | | |
| LL | Line left | | |
| LR | Line right | | |
| LS | Line stop | | |

DISCLAIMER

Whilst every effort has been taken in the preparation of the drawing, the original hand marks/apparatus configuration may have been altered since the survey/drawing was produced. The owner shall make further enquiries and investigations to satisfy himself as to the accuracy of this drawing. The position of the apparatus shall be the location of the apparatus should be verified by the use of suitable detection devices and safe guarding practices in accordance with the further instructions of the competent authority. This drawing should be recommended by the owner. No representation is made by Greenhatch Group, its agents or servants as to the accuracy, completeness, and sufficiency or otherwise of this drawing and the position of the apparatus.

All apparatus shall be treated as live unless proved otherwise by the owner. It is the users responsibility to ensure that the information on the location of apparatus is correct and that all personnel (labour or contractors) working in proximity to the apparatus.

Rev	Date	Description	Drawn	Q
-----	------	-------------	-------	---



- Topographical Surveys
- Site Engineering
- Utility / CCTV Surveys
- Measured Building Surveys
- 3D Laser Scanning
- Revit & BIM Models

Rowan House
Duffield Road
Little Eaton
Derby
DE21 5DR

Tel (01332) 830044 Fax (01332) 830055
admin@greenhatch-group.co.uk
www.greenhatch-group.co.uk

St Albans Unit B, The Courtyard Alban Park St Albans Hertfordshire AL4 0LA t. (01727) 854481	Newcastle 24 Riverside Studios Amethyst Road Newcastle Bus. Park Newcastle-U-Tyne NE4 7YL t. (01912) 736391	Poland ul. Panewnicksa 91 40-761 Katowice Poland t. 0048 32 202 225
--	---	---

CLIENT

SEGRO PLC

PROJECT

EMG Phase 2(Freeport)
Hyam's Lane, Diseworth
Derby, DE74 2QD

TITLE	CCTV Survey
-------	------------------------

SCALE A1@ 1: 2000	DATE 14/09/2022
DRAWN AB	QUALITY REF SB

Level datum	Drawing supplied by client
Grid orientation	Drawing supplied by client

Job number	34528
------------	-------

Drawing No. **34529A CCTV**

Comments

This plan should only be used for its original purpose. Greenhatch Group accepts no responsibility for this plan if supplied to any party other than the original client.

All dimensions should be checked on site prior to design and construction.

Drainage information (where applicable) has been visually inspected from the surface and therefore should be treated as approximate only.

Notes

[illegible]

CCTV Drainage Survey

East Midlands Gateway, Longholden.

CCTV DRAINAGE SURVEY REPORT





Table of Contents

Project Name site	Project Number 1	Project Date 30/08/2022
----------------------	---------------------	----------------------------

Project Information	P-1
Section Item 1: MH01 > MH02 (MH01X)	1
Section Item 2: MH02 > MH03 (MH02X)	3
Section Item 3: MH04 > MH01 (MH04X)	5
Section Item 4: MH05 > MH04 (MH05X)	7
Section Item 5: MH03 > MH06 (MH03X)	9
Section Item 6: MH06 > MH07 (MH06X)	11
Section Item 7: MH07 > MH08 (MH07X)	12
Section Item 8: MH08 > MH09 (MH08X)	14
Section Item 9: MH09 > MH10 (MH09X)	16
Section Item 10: MH11 > MH12 (MH11X)	18
Section Item 11: MH10 > MH11 (MH10X)	20
Section Item 12: MH12 > MH13 (MH12X)	22
Section Item 13: MH13 > OUTLET1	24
Section Item 14: INLET > MH14	26



Project Information

Project Name
site**Project Number**
1**Project Date**
30/08/2022

Client

Company: Greenhatch Group
Contact: Adam Sneddon
Department: Associate Director
Street: Rowan House, Duffield Road
Town or City: Little Eaton, Derby
Post Code: DE21 5DR
Phone: 01332 830044
Email: utilities@greenhatch-group.co.uk

Site

Contact: Adam Sneddon
Department: Associate Director
Street: East Midlands Gateway
Town or City: Longholden
Phone: 01332 830044
Email: utilities@greenhatch-group.co.uk

Contractor

Company: Sewer Surveys UK Ltd
Contact: Andrew Froggatt/ Simon Bennett
Department: Directors
Street: 14B Orgreave Close
Town or City: Sheffield
Post Code: S13 9NP
Phone: 0114 251 3481
Mobile: 07837 768649/07808 220160
Email: info@sewersurveysuk.co.uk



Section Inspection - 06/09/2022 - MH01X

Section 1	Inspection 1	Date 06/09/22	Time 15:16	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH01X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 1

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH01	
Road: Long Holden (Off)		Inspected Length: 89.73 m		Upstream Pipe Depth:	
Location:		Total Length: 89.73 m		Downstream Node NAMS Ref: MH02	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:
Recommendations:

Scale: 1:777	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH01</div> <div>0.00</div> <div>0.00</div> <div>16.50</div> <div>89.73</div> <div>MH02</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH01	00:04:32		
	0.00	WL	Water level 0 % height/diameter	00:04:38		
	16.50	REM	General remark: GENERAL PHOTO	00:05:04	_393a61b3-f6db-40e-e-b008-51	
	89.73	MHF	Finish node type, manhole	00:14:17		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH01X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
1	Downstream	MH01X	1	



_393a61b3-f6db-40ee-b008-516be3f87a8c.jpg, 00:05:04,
16.50 m

General remark, GENERAL PHOTO



Section Inspection - 06/09/2022 - MH02X

Section 2	Inspection 1	Date 06/09/22	Time 15:16	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH02X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 2

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH02	
Road:	Long Holden (Off)	Inspected Length: 90.35 m		Upstream Pipe Depth:	
Location:		Total Length: 90.35 m		Downstream Node NAMS Ref: MH03	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use:	Surface water	Pipe Shape:		C	
Type of Pipe:		Dia/Height:		450 mm	
Flow Control:		Pipe Material:		Concrete	
Year Constructed:	Not Specified	Lining Type:		No Lining	
Inspection Purpose:	Routine inspection of condition	Lining Material:		No Lining	
Comments:	WRONG SIZE ON RECORDING				
Recommendations:					

Scale: 1:783	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH02</div> <div>0.00</div> <div>0.00</div> <div>90.35</div> <div>MH03</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH02	00:00:08		
	0.00	WL	Water level 0 % height/diameter	00:00:14	_3791dc5 5-d929-46 18-bb2e-0	
	90.35	MHF	Finish node type, manhole	00:12:10		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH02X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
2	Downstream	MH02X	1	



_3791dc55-d929-4618-bb2e-0e758fedf0dd.jpg, 00:00:14, 0.00

m
Water level 0 % height/diameter



Section Inspection - 06/09/2022 - MH04X

Section 3	Inspection 1	Date 06/09/22	Time 15:16	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH04X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 3

Town or Village:		Inspection Direction: Upstream		Upstream Node NAMS Re MH04	
Road: Long Holden (Off)		Inspected Length: 89.04 m		Upstream Pipe Depth:	
Location:		Total Length: 89.04 m		Downstream Node NAMS Ref: MH01	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:771	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH01</div> <div>0.00</div> <div>0.00</div> <div>1.64</div> <div>30.07</div> <div>89.04</div> <div>MH04</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH04	00:00:08		
	0.00	WL	Water level 0 % height/diameter	00:00:16		
	1.64	CN	Connection at 06 o'clock, dia 350 mm: BACKDROP	00:01:16		
	30.07	GP	General Condition photograph	00:05:17	_65dd77e6-3518-4ae3-b96e-6	
	89.04	MHF	Finish node type, manhole	00:12:26		

Construction Features

Structural Defects

Miscellaneous Features

Service & Operational Observations

STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH04X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
3	Upstream	MH04X	1	



_65dd77e6-3518-4ae3-b96e-6d0e2b6ca48d.jpg, 00:05:17,
30.07 m
General Condition photograph



Section Inspection - 06/09/2022 - MH05X

Section 4	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH05X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 4

Town or Village:		Inspection Direction: Upstream		Upstream Node NAMS Re MH05	
Road: Long Holden (Off)		Inspected Length: 65.09 m		Upstream Pipe Depth:	
Location:		Total Length: 65.09 m		Downstream Node NAMS Ref: MH04	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:
Recommendations:

Scale: 1:564	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH04</div> <div>0.00</div> <div>0.00</div> <div>31.36</div> <div>65.09</div> <div>MH05</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH05	00:00:13		
	0.00	WL	Water level 0 % height/diameter	00:00:18		
	31.36	GP	General Condition photograph	00:05:20	_9bc4a412-f72a-40bc-90e6-bc	
	65.09	MHF	Finish node type, manhole	00:09:52		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH05X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
4	Upstream	MH05X	1	



_9bc4a412-f72a-40bc-90e6-bc7fab42619.jpg, 00:05:20,
31.36 m
General Condition photograph



Section Inspection - 06/09/2022 - MH03X

Section 5	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH03X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 5

Town or Village:		Inspection Direction: Upstream		Upstream Node NAMS Re MH03	
Road: Long Holden (Off)		Inspected Length: 87.86 m		Upstream Pipe Depth:	
Location:		Total Length: 87.86 m		Downstream Node NAMS Ref: MH06	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:
Recommendations:

Scale: 1:761	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH06</div> <div>0.00</div> <div>0.90</div> <div>30.52</div> <div>87.86</div> <div>MH03</div> <div>Depth: m</div> </div>						
		MH	Start node, manhole, reference: MH03	00:00:14		
		WL	Water level 0 % height/diameter	00:00:18		
		GP	General Condition photograph	00:03:47	_f72338c4-c7ce-444e-ab20-4d	
		MHF	Finish node type, manhole	00:10:07		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH03X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
5	Upstream	MH03X	1	



_f72338c4-c7ce-444e-ab20-4d2f6b493fe3.jpg, 00:03:47, 30.52
m

General Condition photograph



Section Inspection - 06/09/2022 - MH06X

Section 6	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH06X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 6

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH06	
Road: Long Holden (Off)		Inspected Length: 90.10 m		Upstream Pipe Depth:	
Location:		Total Length: 90.10 m		Downstream Node NAMS Ref: MH07	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:
Recommendations:

Scale: 1:781	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH06</div> <div>0.00</div> <div>0.00</div> <div>41.93</div> <div>90.10</div> <div>MH07</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH06	00:00:07		
	0.00	WL	Water level 0 % height/diameter	00:00:11		
	41.93	GP	General Condition photograph	00:05:50		
	90.10	MHF	Finish node type, manhole	00:10:51		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Inspection - 06/09/2022 - MH07X

Section 7	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref 1	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH07X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 7

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH07	
Road: Long Holden (Off)		Inspected Length: 65.27 m		Upstream Pipe Depth:	
Location:		Total Length: 65.27 m		Downstream Node NAMS Ref: MH08	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:566	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH07</div> <div>0.00</div> <div>0.01</div> <div>15.15</div> <div>32.95</div> <div>54.13</div> <div>65.27</div> <div>MH08</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH07	00:00:41		
	0.01	WL	Water level 5 % height/diameter	00:00:43		
	15.15	GP	General Condition photograph	00:02:51	_47d42bd8-e68a-4e2a-90c6-4	
	32.95	GP	General Condition photograph	00:05:07	_30785355-44ad-45cd-aeeb-8	
	54.13	GP	General Condition photograph	00:07:36	_68d97c09-de87-401e-bf68-54	
	65.27	MHF	Finish node type, manhole	00:09:09		

Construction Features

Structural Defects

Miscellaneous Features

Service & Operational Observations

STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH07X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
7	Downstream	MH07X	1	



_47d42bd8-e68a-4e2a-90c6-400fcb21c963.jpg, 00:02:51,
15.15 m
General Condition photograph



_30785355-44ad-45cd-aeeb-84b5ac5cf1b2.jpg, 00:05:07,
32.95 m
General Condition photograph



_68d97c09-de87-401e-bf68-5477b2e16760.jpg, 00:07:36,
54.13 m
General Condition photograph



Section Inspection - 06/09/2022 - MH08X

Section 8	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH08X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 8

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH08	
Road: Long Holden (Off)		Inspected Length: 33.60 m		Upstream Pipe Depth:	
Location:		Total Length: 33.60 m		Downstream Node NAMS Ref: MH09	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:291	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH08</div> <div>0.00</div> <div>0.01</div> <div>15.33</div> <div>33.60</div> <div>MH09</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH08	00:00:03		
	0.01	WL	Water level 5 % height/diameter	00:00:05		
	15.33	GP	General Condition photograph	00:02:21	_e4bb61a 4-ab0a-46 7d-93a4-6	
	33.60	MHF	Finish node type, manhole	00:05:02		

Construction Features

Structural Defects

Miscellaneous Features

Service & Operational Observations

STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH08X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
8	Downstream	MH08X		



_e4bb61a4-ab0a-467d-93a4-65bbdad6d939.jpg, 00:02:21,
15.33 m
General Condition photograph



Section Inspection - 06/09/2022 - MH09X

Section 9	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH09X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 9

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH09	
Road: Long Holden (Off)		Inspected Length: 90.25 m		Upstream Pipe Depth:	
Location:		Total Length: 90.25 m		Downstream Node NAMS Ref: MH10	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:
Recommendations:

Scale: 1:782	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH09</div> <div> <div>0.00</div> <div>0.01</div> <div>15.66</div> <div>32.66</div> <div>90.25</div> </div> <div> <div>MH</div> <div>WL</div> <div>GP</div> <div>GP</div> <div>MHF</div> </div> <div> <div>Start node, manhole, reference: MH09</div> <div>Water level 5 % height/diameter</div> <div>General Condition photograph</div> <div>General Condition photograph</div> <div>Finish node type, manhole</div> </div> <div> <div>00:00:00</div> <div>00:00:00</div> <div>00:03:03</div> <div>00:05:45</div> <div>00:11:14</div> </div> <div> <div></div> <div></div> <div>_390ca381-15d0-418f-a45c-e2</div> <div>_96ce8c79-5e2d-478d-bf0e-58d</div> <div></div> </div> </div>						

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH09X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
9	Downstream	MH09X		



_390ca381-15d0-418f-a45c-e2b560419aa3.jpg, 00:03:03,
15.66 m
General Condition photograph



_96ce8c79-5e2d-478d-bf0e-58d48171529f.jpg, 00:05:45,
32.66 m
General Condition photograph



Section Inspection - 06/09/2022 - MH11X

Section 10	Inspection 1	Date 06/09/22	Time 15:17	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH11X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 10

Town or Village:		Inspection Direction: Upstream		Upstream Node NAMS Re MH11	
Road: Long Holden (Off)		Inspected Length: 89.59 m		Upstream Pipe Depth:	
Location:		Total Length: 89.59 m		Downstream Node NAMS Ref: MH12	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:776	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH12</div> <div>0.00</div> <div>0.00</div> <div>20.03</div> <div>50.15</div> <div>89.59</div> <div>MH11</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH11	00:00:19		
	0.00	WL	Water level 0 % height/diameter	00:00:23		
	20.03	GP	General Condition photograph	00:02:44	_c52f416b -4ec1-4efa -af89-8528	
	50.15	GP	General Condition photograph	00:05:17	_612b8f39 -a50e-414 9-ade1-68	
	89.59	MHF	Finish node type, manhole	00:08:35		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH11X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
10	Upstream	MH11X		



_c52f416b-4ec1-4efa-af89-8528181f16d6.jpg, 00:02:44, 20.03
m
General Condition photograph



_612b8f39-a50e-4149-ade1-68436daa23fc.jpg, 00:05:17,
50.15 m
General Condition photograph



Section Inspection - 06/09/2022 - MH10X

Section 11	Inspection 1	Date 06/09/22	Time 15:18	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH10X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 11

Town or Village:		Inspection Direction: Upstream		Upstream Node NAMS Re MH10	
Road: Long Holden (Off)		Inspected Length: 89.68 m		Upstream Pipe Depth:	
Location:		Total Length: 89.68 m		Downstream Node NAMS Ref: MH11	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:777	Position [m]	Code	Observation	MPEG	Photo	Grade
Depth: m MH11						
	0.00	MH	Start node, manhole, reference: MH10	00:00:09		
	0.00	WL	Water level 0 % height/diameter	00:00:13		
	21.16	GP	General Condition photograph	00:02:40	_b9f9db0a -aa81-41f0 -8fe2-300d	
	49.57	GP	General Condition photograph	00:05:13	_6d3894c 7-fb04-44b 7-aa8c-0f8	
	89.68	MHF	Finish node type, manhole	00:09:08		
MH10 Depth: m						

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0



Section Pictures - 06/09/2022 - MH10X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
11	Upstream	MH10X		



_b9f9db0a-aa81-41f0-8fe2-300d445328ad.jpg, 00:02:40,
21.16 m
General Condition photograph



_6d3894c7-fb04-44b7-aa8c-0f877416d629.jpg, 00:05:13,
49.57 m
General Condition photograph



Section Inspection - 06/09/2022 - MH12X

Section 12	Inspection 1	Date 06/09/22	Time 15:18	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR MH12X
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 12

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH12	
Road: Long Holden (Off)		Inspected Length: 86.73 m		Upstream Pipe Depth:	
Location:		Total Length: 86.73 m		Downstream Node NAMS Ref: MH13	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:751	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH12</div> <div>0.00</div> <div>0.00</div> <div>24.64</div> <div>60.31</div> <div>86.73</div> <div>MH13</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH12	00:00:07		
	0.00	WL	Water level 0 % height/diameter	00:00:11		
	24.64	GP	General Condition photograph	00:02:50	_03a2ace7-3884-44ee-9bcc-2	
	60.31	GP	General Condition photograph	00:05:21	_f22a16c7-2dd7-4872-a5fb-448	
	86.73	MHF	Finish node type, manhole	00:08:03		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	0	0.0	0.0	0.0	1.0




Section Pictures - 06/09/2022 - MH12X

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
12	Downstream	MH12X		



_03a2ace7-3884-44ee-9bcc-249d12e54f09.jpg, 00:02:50,
24.64 m
General Condition photograph

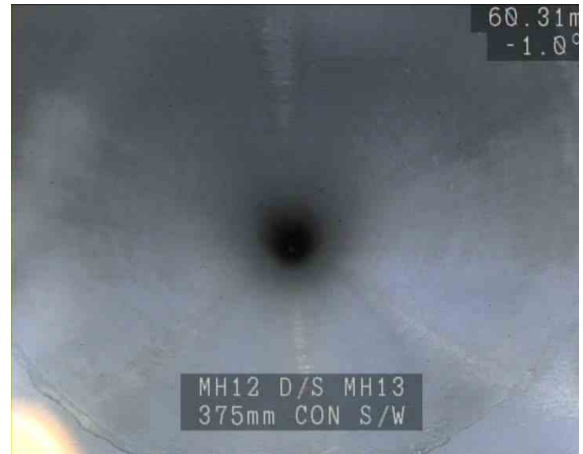

_f22a16c7-2dd7-4872-a5fb-448f33d4f7f3.jpg, 00:05:21, 60.31
m
General Condition photograph



Section Inspection - 31/08/2022

Section 13	Inspection 1	Date 31/08/22	Time 14:56	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR Not Specified
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 13

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re MH13	
Road: Long Holden (Off)		Inspected Length: 5.60 m		Upstream Pipe Depth:	
Location:		Total Length: 5.60 m		Downstream Node NAMS Ref: OUTLET1	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 375 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:
Recommendations:

Scale: 1:50	Position [m]	Code	Observation	MPEG	Photo	Grade
<div> <div>Depth: m</div> <div>MH13</div> <div>0.00</div> <div>0.01</div> <div>0.90</div> <div>3.08</div> <div>5.12</div> <div>5.60</div> <div>OUTLET1</div> <div>Depth: m</div> </div>						
	0.00	MH	Start node, manhole, reference: MH13	00:00:06		
	0.01	WL	Water level 0 % height/diameter	00:00:11		
	0.90	S1 DES	Settled deposits fine 5 % cross-sectional area loss, Start	00:01:28		
	3.08	F1 DES	Settled deposits fine 5 % cross-sectional area loss, Finish	00:02:15		1
	5.12	JDM	Joint displaced medium	00:03:01	_59d4ae3 c-aae6-4fc e-aa25-b8	1
	5.60	OFF	Finish node type, outfall	00:03:53		

Construction Features					Miscellaneous Features				
Structural Defects					Service & Operational Observations				
STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
1	1.0	0.2	1.0	1.0	1	0.0	0.0	0.0	1.0



Section Pictures - 31/08/2022

Section	Inspection Direction	PLR	Client's Job Ref	Contractor's Job Ref
13	Downstream			



_59d4ae3c-aae6-4fce-aa25-b87ad489547b.jpg, 00:03:01, 5.12
m
Joint displaced medium



Section Inspection - 01/09/2022

Section 14	Inspection 1	Date 01/09/22	Time 8:22	Client's Job Ref Not Specified	Weather No Rain Or Snow	Pre Cleaned Not Specified	PLR Not Specified
Operator SBY		Vehicle YR67 VYO		Camera Forward View	Preset Length Not Specified	Legal Status Not Specified	NAMS ID 14

Town or Village:		Inspection Direction: Downstream		Upstream Node NAMS Re INLET	
Road: Long Holden (Off)		Inspected Length: 3.24 m		Upstream Pipe Depth:	
Location:		Total Length: 3.24 m		Downstream Node NAMS Ref: MH14	
Surface Type:		Joint Length: 2.50 m		Downstream Pipe Depth:	
Use: Surface water		Pipe Shape: C			
Type of Pipe:		Dia/Height: 525 mm			
Flow Control:		Pipe Material: Concrete			
Year Constructed: Not Specified		Lining Type: No Lining			
Inspection Purpose: Routine inspection of condition		Lining Material: No Lining			

Comments:

Recommendations:

Scale: 1:50 Position [m] Code Observation MPEG Photo Grade

Depth: m

INLET



0.00

OC

Start node, other special chamber, reference: INLET

00:00:07

0.90

WL

Water level 5 % height/diameter

00:00:14

0.91

S1

DES

Settled deposits fine 5 % cross-sectional area loss, Start

00:00:27

3.24

F1

DES

Settled deposits fine 5 % cross-sectional area loss, Finish

00:01:30

1

3.24

MHF

Finish node type, manhole

00:01:58

MH14

Depth: m

Construction Features

Structural Defects

Miscellaneous Features

Service & Operational Observations

STR No. Def	STR Peak	STR Mean	STR Total	STR Grade	SER No. Def	SER Peak	SER Mean	SER Total	SER Grade
0	0.0	0.0	0.0	1.0	1	0.0	0.0	0.0	1.0



Section Profile

Project Name
site

Project Number
1

Project Date
30/08/2022

C, 375 mm

Section	Upstream Node NAMS Ref	Downstream Node NAMS Ref	Date	Road	Pipe Material	Total Length	Inspected Length
1	MH01	MH02	06/09/2022	LONG HOLDEN (OFF)	Concrete	89.73 m	89.73 m
3	MH04	MH01	06/09/2022	LONG HOLDEN (OFF)	Concrete	89.04 m	89.04 m
4	MH05	MH04	06/09/2022	LONG HOLDEN (OFF)	Concrete	65.09 m	65.09 m
5	MH03	MH06	06/09/2022	LONG HOLDEN (OFF)	Concrete	87.86 m	87.86 m
6	MH06	MH07	06/09/2022	LONG HOLDEN (OFF)	Concrete	90.10 m	90.10 m
7	MH07	MH08	06/09/2022	LONG HOLDEN (OFF)	Concrete	65.27 m	65.27 m
8	MH08	MH09	06/09/2022	LONG HOLDEN (OFF)	Concrete	33.60 m	33.60 m
9	MH09	MH10	06/09/2022	LONG HOLDEN (OFF)	Concrete	90.25 m	90.25 m
10	MH11	MH12	06/09/2022	LONG HOLDEN (OFF)	Concrete	89.59 m	89.59 m
11	MH10	MH11	06/09/2022	LONG HOLDEN (OFF)	Concrete	89.68 m	89.68 m
12	MH12	MH13	06/09/2022	LONG HOLDEN (OFF)	Concrete	86.73 m	86.73 m
13	MH13	OUTLET1	31/08/2022	LONG HOLDEN (OFF)	Concrete	5.60 m	5.60 m

Total: 12 Inspections x C 375 mm = 882.54 m Total Length and 882.54 m Inspected Length

C, 450 mm

Section	Upstream Node NAMS Ref	Downstream Node NAMS Ref	Date	Road	Pipe Material	Total Length	Inspected Length
2	MH02	MH03	06/09/2022	LONG HOLDEN (OFF)	Concrete	90.35 m	90.35 m

Total: 1 Inspection x C 450 mm = 90.35 m Total Length and 90.35 m Inspected Length

C, 525 mm

Section	Upstream Node NAMS Ref	Downstream Node NAMS Ref	Date	Road	Pipe Material	Total Length	Inspected Length
14	INLET	MH14	01/09/2022	LONG HOLDEN (OFF)	Concrete	3.24 m	3.24 m

Total: 1 Inspection x C 525 mm = 3.24 m Total Length and 3.24 m Inspected Length

Total: 14 Inspections = 976.13 m Total Length and 976.13 m Inspected Length



Scoring Summary

Project Name
siteProject Number
1Project Date
30/08/2022

Structural Defects

Section	PLR	Grade	Description
All inspected pipes are in an acceptable structural condition (< grade 3).			

Service / Operational Condition

Section	PLR	Grade	Description
All inspected pipes are in an acceptable service condition (< grade 3).			

Abandoned Surveys

Section	PLR	Description
All inspections complete, none are abandoned.		

Information

These scoring summaries are based on the SRM grading from the WRc.

Job Number:

Survey By: SBY

Grid Ref:

Node Number: MH01

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: MH

Survey Date: 30/08/22

Manufacturer:

Grating:

COVER

Shape: DT

Hinged: /

Lockable: /

Duty: M

Size:610/610

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses: 4

Depth: 600

Size:600/600

Vermin:

CHAMBER

Soffit Type:/

No. of Step Irons: 6

No. of Ladders:

No. of Landings:

Size: 1200/1200

Const'n Code: CO

Depth of Flow:

Depth of Silt:


H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH04	C	375		CO		1.49	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH02	C	375		CO		2.67	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

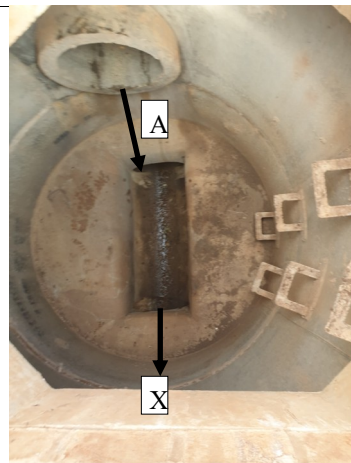

Job Number:

Survey By: SBY

Grid Ref:

Node Number: MH02

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: MH

Survey Date: 30/08/22

Manufacturer:

Grating:

COVER

Shape: DT

Hinged: /

Lockable: /

Duty: M

Size:620/620

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses: 5

Depth: 680

Size:600/600

Vermin:

CHAMBER

Soffit Type:/

No. of Step Irons: 5

No. of Ladders:

No. of Landings:

Size: 1200/1200

Const'n Code: CO

Depth of Flow:

Depth of Silt:


H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH01	C	375		CO		2.20	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH03	C	375		CO		2.26	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

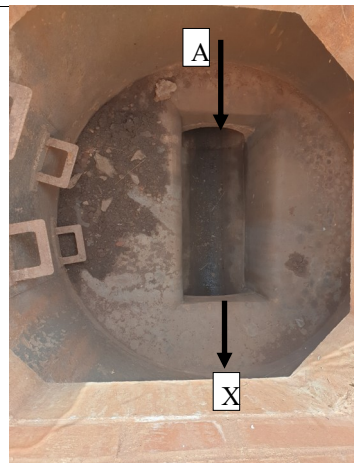

Job Number: Survey By: SBY

Grid Ref: Node Number: MH03 Cover Level:

Location: East Midlands Gateway

Year Laid: Z Status: PU Function: SW Node Type: MH Survey Date: 30/08/22

Manufacturer: Grating:

COVER Shape: DT Hinged: / Lockable: / Duty: M Size:610/610 Toxic atmos:

SHAFT Side Entry: / Regulating Courses: 2 Depth: 450 Size:600/600 Vermin:

CHAMBER Soffit Type:/ No. of Step Irons: 7 No. of Ladders: No. of Landings:

Size: 1200/1200 Const'n Code: CO Depth of Flow: Depth of Silt: H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH02	C	375		CO		2.70	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH06	C	375		CO		2.73	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:



Job Number:

Survey By: SBY

Grid Ref:

Node Number: MH06

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: MH

Survey Date: 30/08/22

Manufacturer:

Grating:

COVER

Shape: DT

Hinged: /

Lockable: /

Duty: M

Size: 610/610

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses: 2

Depth: 450

Size: 600/600

Vermis:

CHAMBER

Soffit Type: /

No. of Step Irons: 3

No. of Ladders:

No. of Landings:

Size: 1200/1200

Const'n Code: CO

Depth of Flow:

Depth of Silt:


H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH03	C	375		CO		1.73	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH07	C	375		CO		1.75	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

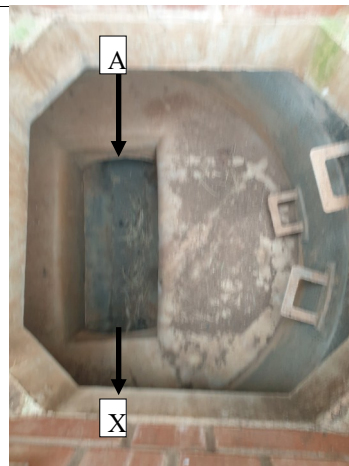

Job Number:

Survey By: SBY

Grid Ref:

Node Number: MH07

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: MH

Survey Date: 30/08/22

Manufacturer:

Grating:

COVER

Shape: DT

Hinged: /

Lockable: /

Duty: M

Size: 610/610

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses: 2

Depth: 480

Size: 600/600

Vermin:

CHAMBER

Soffit Type: /

No. of Step Irons: 3

No. of Ladders:

No. of Landings:

Size: 1350/1350

Const'n Code: CO

Depth of Flow:

Depth of Silt:


H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH06	C	375		CO		2.46	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH08	C	375		CO		2.48	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

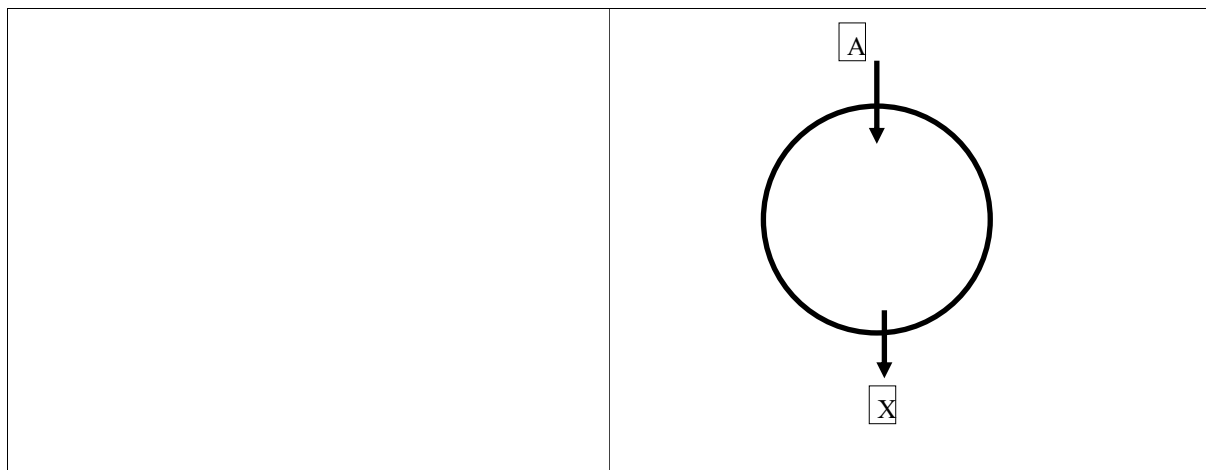

Job Number: Survey By: SBY

Grid Ref: Node Number: MH08 Cover Level:

Location: East Midlands Gateway

Year Laid: Z Status: PU Function: SW Node Type: MH Survey Date: 31/08/22

Manufacturer: Grating:

COVER Shape: DT Hinged: / Lockable: / Duty: M Size: 610/610 Toxic atmos:

SHAFT Side Entry: / Regulating Courses: 2 Depth: 470 Size: 600/600 Vermin:

CHAMBER Soffit Type: / No. of Step Irons: 3 No. of Ladders: No. of Landings:

Size: 1350/1350 Const'n Code: CO Depth of Flow: Depth of Silt: H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH07	C	375		CO		1.74	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH09	C	375		CO		1.77	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:



Job Number:

Survey By: SBY

Grid Ref:

Node Number: MH09

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: MH

Survey Date: 31/08/22

Manufacturer:

Grating:

COVER

Shape: SQ

Hinged: /

Lockable: /

Duty: M

Size: 620/620

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses: 4

Depth: 640

Size: 610/610

Vermis:

CHAMBER

Soffit Type: SL

No. of Step Irons: 4

No. of Ladders:

No. of Landings:

Size: 1350/1350

Const'n Code: CO

Depth of Flow: 5

Depth of Silt:

H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH8	C	375		CO		2.15	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH10	C	375		CO		1.77	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:



Job Number:	Survey By: SBY
-------------	----------------

Grid Ref:	Node Number: MH10	Cover Level:
-----------	-------------------	--------------

Location: East Midlands Gateway

Year Laid: Z	Status: PU	Function: SW	Node Type: MH	Survey Date: 31/08/22
--------------	------------	--------------	---------------	-----------------------

Manufacturer:	Grating:
---------------	----------

COVER	Shape: SQ	Hinged: /	Lockable: /	Duty: H	Size: 620/620	Toxic atmos:
-------	-----------	-----------	-------------	---------	---------------	--------------

SHAFT	Side Entry: /	Regulating Courses: 5	Depth:	Size: 610/610	Vermis:
-------	---------------	-----------------------	--------	---------------	---------

CHAMBER	Soffit Type: SL	No. of Step Irons: 3	No. of Ladders:	No. of Landings:
---------	-----------------	----------------------	-----------------	------------------

Size: 1350/1350	Const'n Code: CO	Depth of Flow: 5	Depth of Silt:	H of S:
-----------------	------------------	------------------	----------------	---------

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH9	C	375		CO		1.99	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH11	C	375		CO		2.01	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:



Job Number:	Survey By: SBY
-------------	----------------

Grid Ref:	Node Number: MH11	Cover Level:
-----------	-------------------	--------------

Location: East Midlands Gateway

Year Laid: Z	Status: PU	Function: SW	Node Type: MH	Survey Date: 31/08/22
--------------	------------	--------------	---------------	-----------------------

Manufacturer:	Grating:
---------------	----------

COVER	Shape: SQx2	Hinged: /	Lockable: /	Duty: H	Size: 690/690	Toxic atmos:
-------	-------------	-----------	-------------	---------	---------------	--------------

SHAFT	Side Entry: /	Regulating Courses: 2	Depth: 480	Size: 1300/750	Vermin:
-------	---------------	-----------------------	------------	----------------	---------

CHAMBER	Soffit Type: SL	No. of Step Irons: 2	No. of Ladders:	No. of Landings:
---------	-----------------	----------------------	-----------------	------------------

Size: 1350/1350	Const'n Code: CO	Depth of Flow: 5	Depth of Silt:	H of S:
-----------------	------------------	------------------	----------------	---------

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH10	C	375		CO		1.53	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH12	C	375		CO		1.55	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:



Job Number:	Survey By: SBY
-------------	----------------

Grid Ref:	Node Number: MH12	Cover Level:
-----------	-------------------	--------------

Location: East Midlands Gateway

Year Laid: Z	Status: PU	Function: SW	Node Type: MH	Survey Date: 31/08/22
--------------	------------	--------------	---------------	-----------------------

Manufacturer:	Grating:
---------------	----------

COVER	Shape: SQ	Hinged: /	Lockable: /	Duty: H	Size: 750/750	Toxic atmos:
-------	-----------	-----------	-------------	---------	---------------	--------------

SHAFT	Side Entry: /	Regulating Courses: 1	Depth: 430	Size: 760/760	Vermin:
-------	---------------	-----------------------	------------	---------------	---------

CHAMBER	Soffit Type: SL	No. of Step Irons: 1	No. of Ladders:	No. of Landings:
---------	-----------------	----------------------	-----------------	------------------


Size: 1350/1350	Const'n Code: CO	Depth of Flow: 5	Depth of Silt:	H of S:
-----------------	------------------	------------------	----------------	---------

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH11	C	375		CO		1.15	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	MH13	C	375		CO		1.18	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

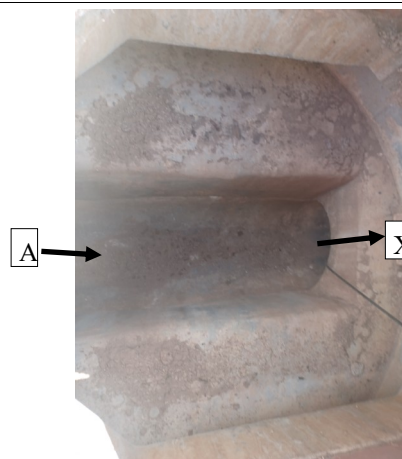

Job Number: Survey By: SBY

Grid Ref: Node Number: MH13 Cover Level:

Location: East Midlands Gateway

Year Laid: Z Status: PU Function: SW Node Type: MH Survey Date: 31/08/22

Manufacturer: Grating:

COVER Shape: SQ Hinged: / Lockable: / Duty: H Size: 620/620 Toxic atmos:

SHAFT Side Entry: / Regulating Courses: 5 Depth: 700 Size: 630/630 Vermin:

CHAMBER Soffit Type: SL No. of Step Irons: No. of Ladders: No. of Landings:


Size: 1350/1350 Const'n Code: CO Depth of Flow: 5 Depth of Silt: H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH12	C	375		CO		1.71	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	Outfall	C	375		CO		1.74	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

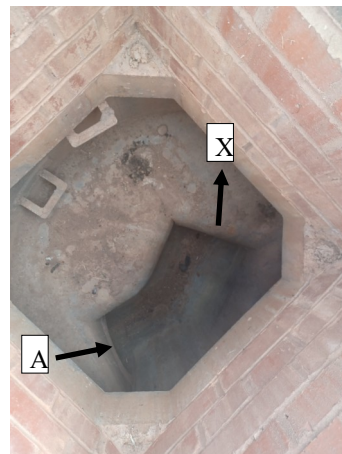

Job Number: Survey By: SBY

Grid Ref: Node Number: MH14 Cover Level:

Location: East Midlands Gateway

Year Laid: Z Status: PU Function: SW Node Type: MH Survey Date: 31/08/22

Manufacturer: Grating:

COVER Shape:DT Hinged: / Lockable: / Duty: M Size:610/610 Toxic atmos:

SHAFT Side Entry: / Regulating Courses: 3 Depth:540 Size:600/600 Vermin:

CHAMBER Soffit Type: No. of Step Irons:6 No. of Ladders: No. of Landings:


Size: 2100/2100 Const'n Code: CO Depth of Flow: Depth of Silt: H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size			Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	Inlet1	C	525				CO		1.77	
	B	Unknown	C	150				VC		1.46	
	C	Inlet1	C	525				CO		1.67	
	D										
	E										
	F										
OUTGOING PIPES	X	Unknown	C	700				CO		1.93	
	Y										

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks: Catchpit overall depth 2.20

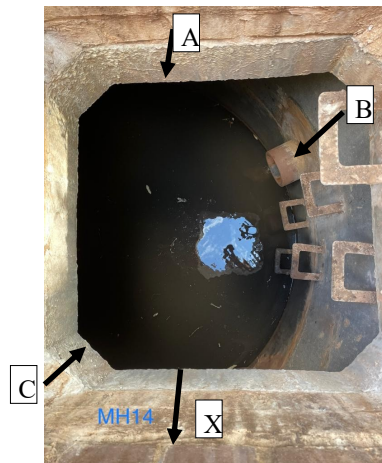

Job Number:

Survey By: SBY

Grid Ref:

Node Number: MH15

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: MH

Survey Date: 31/08/22

Manufacturer:

Grating:

COVER

Shape:DT

Hinged: /

Lockable: /

Duty: M

Size:610/610

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses: 1

Depth:370

Size:600/600

Vermin:

CHAMBER

Soffit Type:

No. of Step Irons:5

No. of Ladders:

No. of Landings:

Size: 2100/2100

Const'n Code: CO

Depth of Flow:

Depth of Silt:


H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size			Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH14	C	525				CO		1.98	
	B	Unknown	C	150				CO		1.75	
	C										
	D										
	E										
	F										
OUTGOING PIPES	X	MH16	C	700				CO		2.00	
	Y										

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

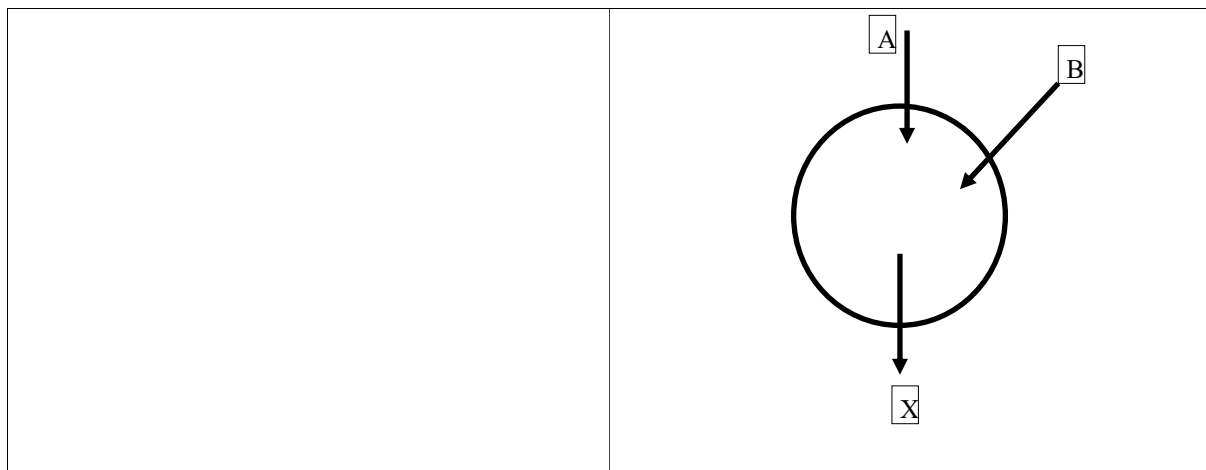

Job Number: Survey By: SBY

Grid Ref: Node Number: MH16 Cover Level:

Location: East Midlands Gateway

Year Laid: Z Status: PU Function: SW Node Type: MH Survey Date: 01/09/22

Manufacturer: Grating:

COVER Shape:DT Hinged: / Lockable: / Duty: M Size:610/610 Toxic atmos:

SHAFT Side Entry: / Regulating Courses: 2 Depth:450 Size:600/600 Vermin:

CHAMBER Soffit Type: No. of Step Irons:5 No. of Ladders: No. of Landings:


Size: 2100/2100 Const'n Code: CO Depth of Flow: Depth of Silt: H of S:

	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A	MH15	C	700		CO		1.98	
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	Brook	C	700		CO		2.20	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks: Overall depth 2.32

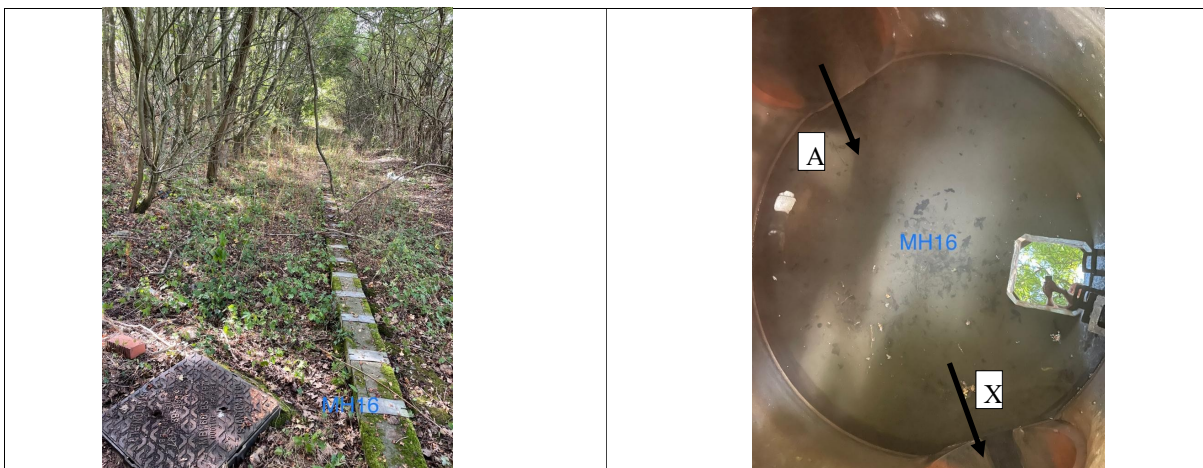

Job Number:

Survey By: SBY

Grid Ref:

Node Number: Inlet

Cover Level:

Location: East Midlands Gateway

Year Laid: Z

Status: PU

Function: SW

Node Type: Inlet

Survey Date: 01/09/22

Manufacturer:

Grating:

COVER

Shape:

Hinged: /

Lockable: /

Duty:

Size:

Toxic atmos:

SHAFT

Side Entry: /

Regulating Courses:

Depth:

Size:

Vermin:

CHAMBER

Soffit Type:

No. of Step Irons:

No. of Ladders:

No. of Landings:

Size:

Const'n Code:

Depth of Flow:

Depth of Silt:

H of S:

Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
------	------------------------	-------	-----------	-------------------	---------------	-----------------	----------------------	------------------

INCOMING PIPES	A							
	B							
	C							
	D							
	E							
	F							

OUTGOING PIPES	X		C	525		CO		
	Y							

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:



Job Number:	Survey By: SBY
-------------	----------------

Grid Ref:	Node Number: Outlet1	Cover Level:
-----------	----------------------	--------------

Location: East Midlands Gateway

Year Laid: Z	Status: PU	Function: SW	Node Type: Outlet	Survey Date: 01/09/22
--------------	------------	--------------	-------------------	-----------------------

Manufacturer:	Grating:
---------------	----------

COVER	Shape:	Hinged: /	Lockable: /	Duty:	Size:	Toxic atmos:
--------------	--------	-----------	-------------	-------	-------	--------------

SHAFT	Side Entry: /	Regulating Courses:	Depth:	Size:	Vermin:
--------------	---------------	---------------------	--------	-------	---------

CHAMBER	Soffit Type:	No. of Step Irons:	No. of Ladders:	No. of Landings:
----------------	--------------	--------------------	-----------------	------------------

Size:	Const'n Code:	Depth of Flow:	Depth of Silt:	H of S:
-------	---------------	----------------	----------------	---------



	Pipe	U/S D/S node Reference	Shape	Pipe Size	Backdrop Diameter	Pipe Material	Lining Material	Depth from Cover (M)	Invert Level (M)
INCOMING PIPES	A								
	B								
	C								
	D								
	E								
	F								
OUTGOING PIPES	X	mMH13	C	375		CO		1.22	
	Y								

CONDITION INFORMATION Enter Y if attention required. Use Remarks to clarify

Cover	Irons/Ladders	Shaft	Chamber	Benching	Other
-------	---------------	-------	---------	----------	-------

Remarks:

--	--



Appendix 5: Greenfield Runoff Rate Calculations


This is an estimation of the greenfield runoff rates that are used to meet normal best practice criteria in line with Environment Agency guidance “Rainfall runoff management for developments”, SC030219 (2013), the SuDS Manual C753 (CIRIA, 2015) and the non-statutory standards for SuDS (Defra, 2015). This information on greenfield runoff rates may be the basis for setting consents for the drainage of surface water runoff from sites.

Project details

Date	24/03/2025
Calculated by	Robin Green
Reference	EMG2
Model version	0.6.5

Location

Site name	Main Site
Site location	Diseworth

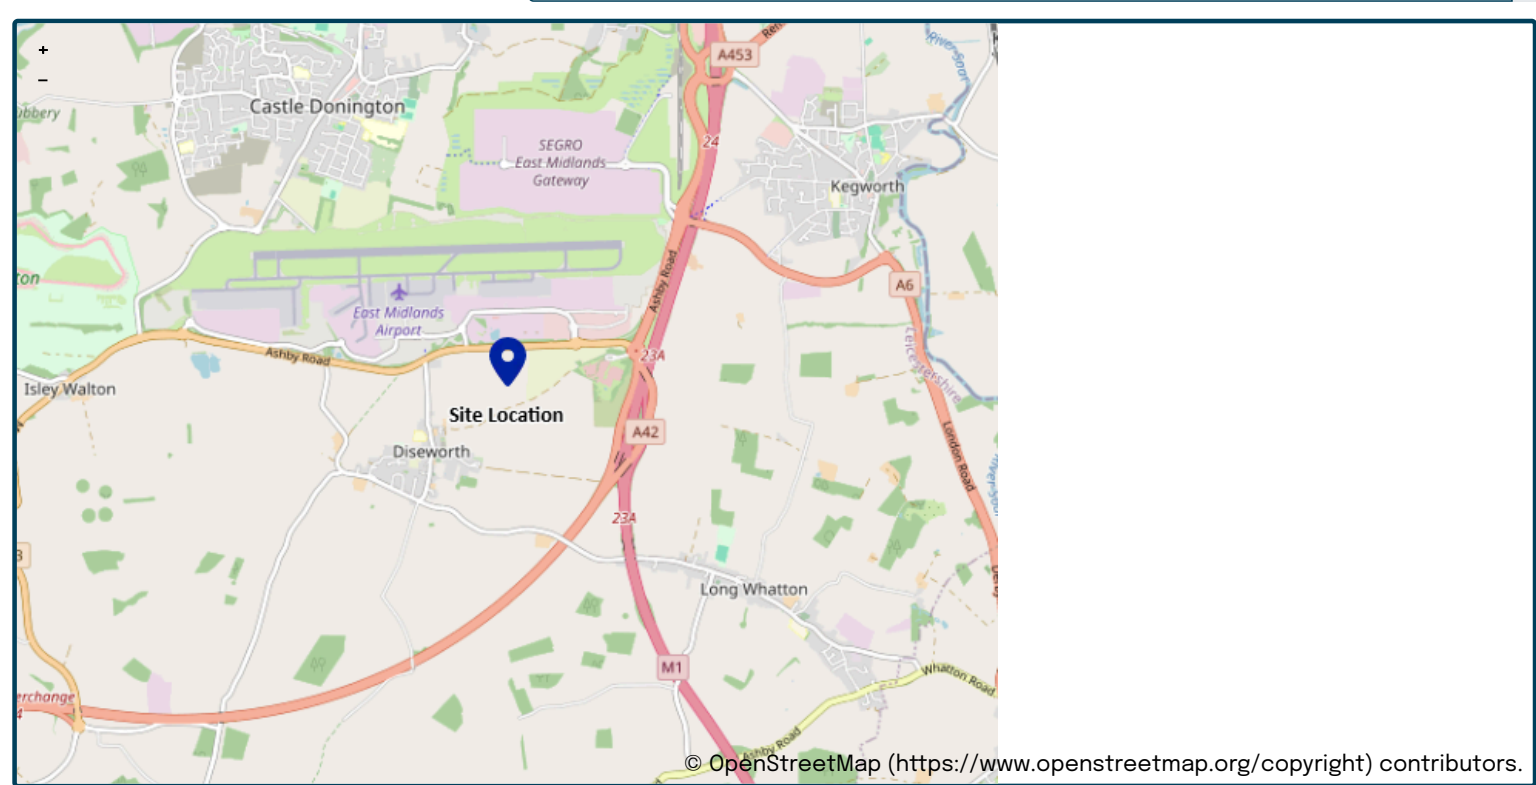

Site easting	445919
Site northing	324921

Site details

Total site area (ha)	1	ha
----------------------	---	----

Greenfield runoff

Method

Method	FEH statistical
--------	-----------------

FEH statistical

	<u>My value</u>		<u>Map value</u>
SAAR (mm)	<input type="text" value="635"/>	mm	<input type="text" value="635"/>
BFIHOST	<input type="text" value="0.403"/>		
QMed-QBar conversion	<input type="text" value="1.124"/>		<input type="text" value="1.124"/>
QMed (l/s)	<input type="text" value="2.92"/>	l/s	
QBar (FEH statistical) (l/s)	<input type="text" value="3.3"/>	l/s	

Growth curve factors

	<u>My value</u>		<u>Map value</u>
Hydrological region	<input type="text" value="4"/>		<input type="text" value="4"/>
1 year growth factor	<input type="text" value="0.83"/>		
2 year growth factor	<input type="text" value="0.89"/>		
10 year growth factor	<input type="text" value="1.49"/>		
30 year growth factor	<input type="text" value="2"/>		
100 year growth factor	<input type="text" value="2.57"/>		
200 year growth factor	<input type="text" value="3.04"/>		

Results

Method	FEH statistical	
Flow rate 1 year (l/s)	<input type="text" value="2.7"/>	l/s
Flow rate 2 year (l/s)	<input type="text" value="2.9"/>	l/s
Flow rate 10 years (l/s)	<input type="text" value="4.9"/>	l/s
Flow rate 30 years (l/s)	<input type="text" value="6.6"/>	l/s
Flow rate 100 years (l/s)	<input type="text" value="8.4"/>	l/s
Flow rate 200 years (l/s)	<input type="text" value="10"/>	l/s

Disclaimer

This report was produced using the Greenfield runoff rate estimation tool (0.6.5) developed by HR Wallingford and available at uksuds.com (<https://www.uksuds.com/>).

The use of this tool is subject to the UK SuDS terms and conditions and licence agreement, which can both be found at [uksuds.com/terms-conditions](https://www.uksuds.com/terms-conditions) (<https://www.uksuds.com/terms-conditions>). The outputs from this tool have been used to estimate Greenfield runoff rates. The use of these results is the responsibility of the users of this tool. No liability will be accepted by HR Wallingford, the Environment Agency, Centre for Ecology and Hydrology, Wallingford Hydrosolutions or any other organisation for the use of these data in the design or operational characteristics of any drainage scheme.

Appendix 6: Greenfield Runoff Volume Calculation

Design Settings

Rainfall Methodology	FEH-22	Maximum Time of Concentration (mins)	30.00	Preferred Cover Depth (m)	1.200
Return Period (years)	100	Maximum Rainfall (mm/hr)	50.0	Include Intermediate Ground	✓
Additional Flow (%)	0	Minimum Velocity (m/s)	1.00	Enforce best practice design rules	x
CV	0.750	Connection Type	Level Soffits		
Time of Entry (mins)	5.00	Minimum Backdrop Height (m)	0.200		

Simulation Settings

Rainfall Methodology	FEH-22	Winter CV	0.840	Drain Down Time (mins)	240	Check Discharge Rate(s)	x
Rainfall Events	Singular	Analysis Speed	Normal	Additional Storage (m³/ha)	20.0	Check Discharge Volume	✓
Summer CV	0.750	Skip Steady State	x	Starting Level (m)		100 year 360 minute (m³)	21256

Storm Durations


15	60	180	360	600	960	2160	4320	7200	10080
30	120	240	480	720	1440	2880	5760	8640	

Return Period (years)	Climate Change (CC %)	Additional Area (A %)	Additional Flow (Q %)	Return Period (years)	Climate Change (CC %)	Additional Area (A %)	Additional Flow (Q %)
100	25	0	0	100	40	0	0

Pre-development Discharge Volume

Site Makeup	Greenfield	Soil Index	4	Return Period (years)	100	Betterment (%)	0
Greenfield Method	FSR/FEH	SPR	0.45	Climate Change (%)	0	PR	0.428
Positively Drained Area (ha)	69.160	CWI	95.852	Storm Duration (mins)	360	Runoff Volume (m³)	21256


Appendix 7: Concept Drainage Strategy

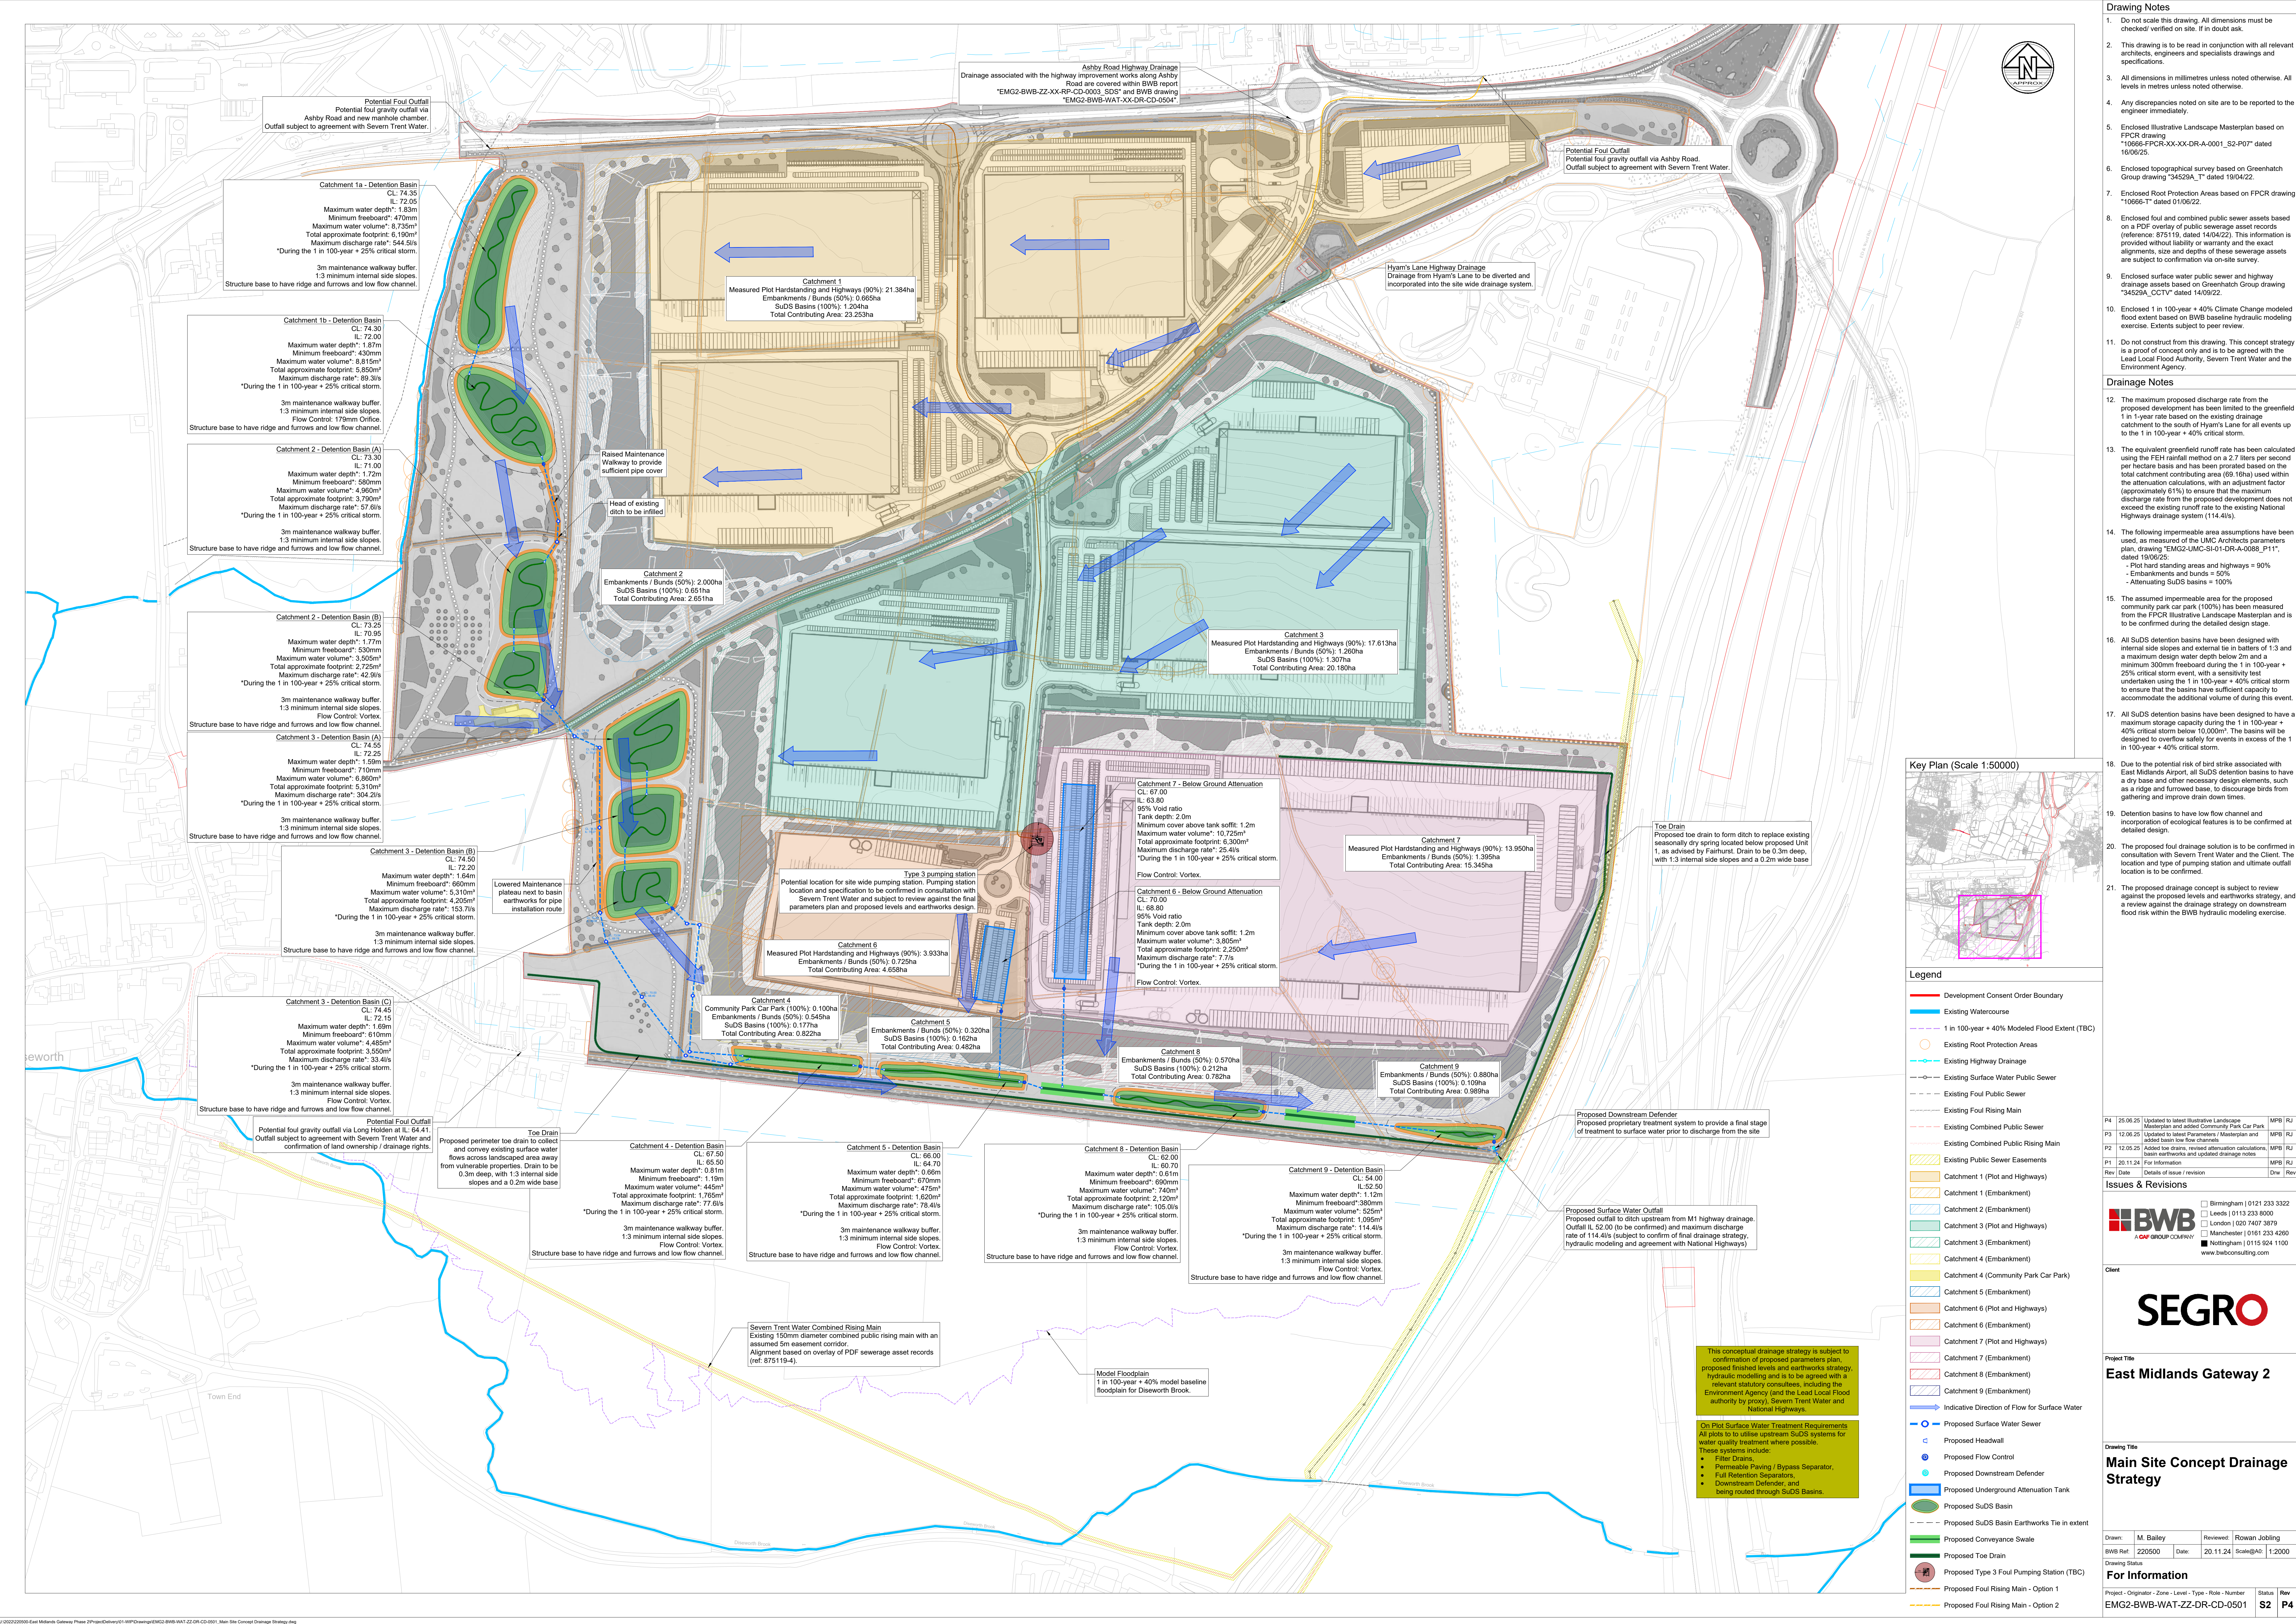

- ### Drawing Notes
1. Do not scale this drawing. All dimensions must be checked/verified on site. If in doubt ask.
 2. This drawing is to be read in conjunction with all relevant architects, engineers and specialists drawings and specifications.
 3. All dimensions in millimetres unless noted otherwise. All levels in metres unless noted otherwise.
 4. Any discrepancies noted on site are to be reported to the engineer immediately.
 5. Enclosed Illustrative Landscape Masterplan based on FPCR drawing "10666-FPCR-XX-XX-DR-A-0001_S2-P07" dated 16/06/25.
 6. Enclosed topographical survey based on Greenhatch Group drawing "34529A_T" dated 19/04/22.
 7. Enclosed Root Protection Areas based on FPCR drawing "10666-T" dated 01/06/22.
 8. Enclosed foul and combined public sewer assets based on a PoD overlay of public sewerage asset records (reference: 875119, dated 14/04/22). This information is provided without liability or warranty and the exact alignments, size and depths of these sewerage assets are subject to confirmation via on-site survey.
 9. Enclosed surface water public sewer and highway drainage assets based on Greenhatch Group drawing "34529A_CCTV" dated 14/09/22.
 10. Enclosed 1 in 100-year + 40% Climate Change modeled flood extent based on BWB baseline hydraulic modeling exercise. Extents subject to peer review.
 11. Do not construct from this drawing. This concept strategy is a proof of concept only and is to be agreed with the Lead Local Flood Authority, Severn Trent Water and the Environment Agency.

- ### Drainage Notes
12. The maximum proposed discharge rate from the proposed development has been limited to the greenfield 1 in 1-year rate based on the existing drainage catchment to the south of Hyam's Lane for all events up to the 1 in 100-year + 40% critical storm.
 13. The equivalent greenfield runoff rate has been calculated using the FEH rainfall method on a 2.7 litres per second per hectare basis and has been prorated based on the total catchment contributing area (89.16ha) used within the attenuation calculations, with an adjustment factor (approximately 61%) to ensure that the maximum discharge rate from the proposed development does not exceed the existing runoff rate to the existing National Highways drainage system (114.4ils).
 14. The following impermeable area assumptions have been used, as measured of the UMC Architects parameters plan, drawing "EMG2-UMC-SLO-1-DR-A-0088_P11", dated 19/06/25:
 - Plot hard standing areas and highways = 90%
 - Embankments and bunds = 50%
 - Attenuating SuDS basins = 100%
 15. The assumed impermeable area for the proposed community park car park (100%) has been measured from the FPCR Illustrative Landscape Masterplan and is to be confirmed during the detailed design stage.
 16. All SuDS detention basins have been designed with internal side slopes and external tie in batters of 1:3 and a maximum design water depth below 2m and a minimum 300mm freeboard during the 1 in 100-year + 25% critical storm event, with a sensitivity test undertaken using the 1 in 100-year + 40% critical storm to ensure that the basins have sufficient capacity to accommodate the additional volume of during this event.
 17. All SuDS detention basins have been designed to have a maximum storage capacity during the 1 in 100-year + 40% critical storm below 10,000m³. The basins will be designed to overflow safely for events in excess of the 1 in 100-year + 40% critical storm.
 18. Due to the potential risk of bird strike associated with East Midlands Airport, all SuDS detention basins to have a dry base and other necessary design elements, such as a ridge and furrowed base, to discourage birds from gathering and improve drain down times.
 19. Detention basins to have low flow channel and incorporation of ecological features is to be confirmed at detailed design.
 20. The proposed foul drainage solution is to be confirmed in consultation with Severn Trent Water and the Client. The location and type of pumping station and ultimate outfall location is to be confirmed.
 21. The proposed drainage concept is subject to review against the proposed levels and earthworks strategy, and a review against the drainage strategy on downstream flood risk within the BWB hydraulic modeling exercise.

Key Plan (Scale 1:50000)

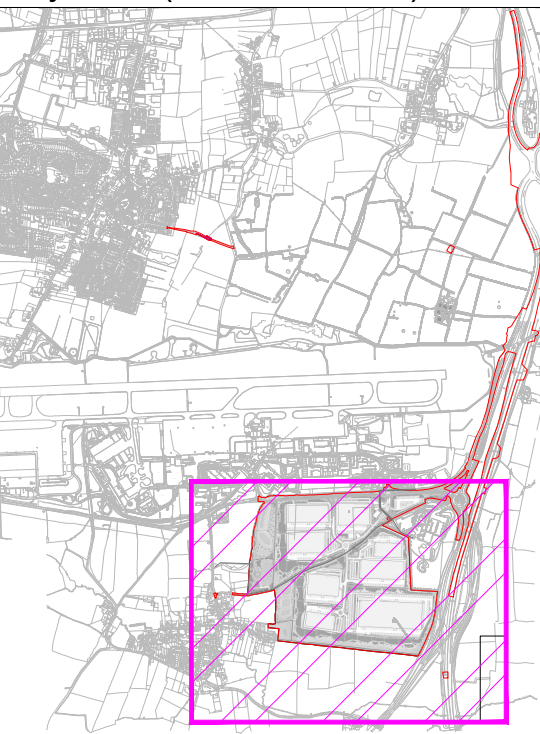

Legend

- Development Consent Order Boundary
- Existing Watercourse
- 1 in 100-year + 40% Modeled Flood Extent (TBC)
- Existing Root Protection Areas
- Existing Highway Drainage
- Existing Surface Water Public Sewer
- Existing Foul Public Sewer
- Existing Foul Rising Main
- Existing Combined Public Sewer
- Existing Combined Public Rising Main
- Existing Public Sewer Easements
- Catchment 1 (Plot and Highways)
- Catchment 2 (Embankment)
- Catchment 3 (Plot and Highways)
- Catchment 4 (Embankment)
- Catchment 4 (Community Park Car Park)
- Catchment 5 (Embankment)
- Catchment 6 (Plot and Highways)
- Catchment 6 (Embankment)
- Catchment 7 (Plot and Highways)
- Catchment 7 (Embankment)
- Catchment 8 (Embankment)
- Catchment 9 (Embankment)
- Proposed Surface Water Sewer
- Proposed Headwall
- Proposed Flow Control
- Proposed Downstream Defender
- Proposed Underground Attenuation Tank
- Proposed SuDS Basin
- Proposed Conveyance Swale
- Proposed Toe Drain
- Proposed Type 3 Foul Pumping Station (TBC)
- Proposed Foul Rising Main - Option 1
- Proposed Foul Rising Main - Option 2

This conceptual drainage strategy is subject to confirmation of proposed parameters plan, proposed finished levels and earthworks strategy, hydraulic modeling and is to be agreed with a relevant statutory consultees, including the Environment Agency (and the Lead Local Flood authority by proxy), Severn Trent Water and National Highways.

On Plot Surface Water Treatment Requirements
All plots to utilise upstream SuDS systems for water quality treatment where possible. These systems include:

- Filter Drains
- Permeable Paving / Bypass Separator
- Full Retention Separators
- Downstream Defender, and being routed through SuDS Basins.

BWB	Birmingham	0121 233 3322
LONDON	London	020 7407 3879
MANCHESTER	Manchester	0161 233 4260
NOTTINGHAM	Nottingham	0115 924 1100

Client

SEGRO

Project Title

East Midlands Gateway 2

Main Site Concept Drainage Strategy

Drawn:	M. Bailey	Reviewed:	Rowan Jobling
BWB Ref:	220500	Date:	20.11.24
Scale:	A0	1:2000	
For Information			
Project - Originator - Zone - Level - Type - Role - Number			
EMG2-BWB-WAT-ZZ-DR-CD-0501			
Status	S2	Rev	P4

Appendix 8: Causeway Flow Calculations

Design Settings

Rainfall Methodology	FEH-22	Maximum Time of Concentration (mins)	30.00	Preferred Cover Depth (m)	1.200
Return Period (years)	100	Maximum Rainfall (mm/hr)	50.0	Include Intermediate Ground	✓
Additional Flow (%)	0	Minimum Velocity (m/s)	1.00	Enforce best practice design rules	x
CV	0.750	Connection Type	Level Soffits		
Time of Entry (mins)	5.00	Minimum Backdrop Height (m)	0.200		

Nodes

Name	Area (ha)	T of E (mins)	Cover Level (m)	Diameter (mm)	Easting (m)	Northing (m)	Depth (m)
Catchment 1a	22.668	12.00	74.350		-92.158	100.836	2.300
Catchment 1b	0.585	12.00	74.300		-93.671	70.218	2.300
Catchment 2a	2.378	5.00	73.300		-92.916	37.295	2.300
Catchment 2b	0.272	5.00	73.250		-92.626	22.671	2.300
Catchment 3a	19.404	5.00	74.550		-65.281	7.280	2.300
Catchment 3b	0.421	5.00	74.500		-65.281	-8.329	2.300
Catchment 3c	0.355	5.00	74.450		-65.484	-22.137	2.300
Catchment 4	0.822	5.00	67.500		-36.265	-57.268	2.000
Catchment 5	0.482	5.00	66.000		-8.464	-60.549	1.300
Catchment 6	4.658	5.00	70.000		1.763	-39.130	3.200
Catchment 7	13.345	5.00	67.000		18.165	-40.189	3.200
Catchment 8	0.782	5.00	62.000		29.356	-65.759	1.300
Catchment 9	0.989	5.00	54.000		98.244	-74.249	1.650
2			53.000	1200	111.190	-87.933	0.967

Links

Name	US Node	DS Node	Length (m)	ks (mm) / n	US IL (m)	DS IL (m)	Fall (m)	Slope (1:X)	Dia (mm)	T of C (mins)	Rain (mm/hr)
1.000	Catchment 1a	Catchment 1b	30.000	0.600	72.050	72.000	0.050	600.0	600	12.51	0.0
2.000	Catchment 2a	Catchment 2b	24.000	0.600	71.000	70.950	0.050	480.0	600	5.36	50.0
1.000_1	Catchment 3a	Catchment 3b	24.000	0.600	72.250	72.200	0.050	480.0	600	5.36	50.0
1.001_1	Catchment 3b	Catchment 3c	23.900	0.600	72.200	72.150	0.050	478.0	600	5.72	50.0
4.000	Catchment 4	Catchment 5	32.500	0.600	65.500	64.700	0.800	40.6	365	5.19	50.0
5.000	Catchment 9	2	18.837	0.600	52.350	52.033	0.317	59.4	450	5.12	50.0

Name	Vel (m/s)	Cap (l/s)	Flow (l/s)	US Depth (m)	DS Depth (m)	Σ Area (ha)	Σ Add Inflow (l/s)	Pro Depth (mm)	Pro Velocity (m/s)
1.000	0.987	279.0	0.0	1.700	1.700	22.668	0.0	0	0.000
2.000	1.105	312.3	322.3	1.700	1.700	2.378	0.0	517	1.245
1.000_1	1.105	312.3	2629.7	1.700	1.700	19.404	0.0	600	1.114
1.001_1	1.107	313.0	2686.8	1.700	1.700	19.825	0.0	600	1.117
4.000	2.801	293.1	111.4	1.635	0.935	0.822	0.0	156	2.617
5.000	2.641	420.0	134.0	1.200	0.517	0.989	0.0	174	2.361

Pipeline Schedule















Link	Length (m)	Slope (1:X)	Dia (mm)	Link Type	US CL (m)	US IL (m)	US Depth (m)	DS CL (m)	DS IL (m)	DS Depth (m)
1.000	30.000	600.0	600	Circular	74.350	72.050	1.700	74.300	72.000	1.700
2.000	24.000	480.0	600	Circular	73.300	71.000	1.700	73.250	70.950	1.700
1.000_1	24.000	480.0	600	Circular	74.550	72.250	1.700	74.500	72.200	1.700
1.001_1	23.900	478.0	600	Circular	74.500	72.200	1.700	74.450	72.150	1.700
4.000	32.500	40.6	365	Circular	67.500	65.500	1.635	66.000	64.700	0.935
5.000	18.837	59.4	450	Circular	54.000	52.350	1.200	53.000	52.033	0.517

Link	US Node	Node Type	DS Node	Dia (mm)	Node Type	MH Type
1.000	Catchment 1a	Junction	Catchment 1b		Junction	
2.000	Catchment 2a	Junction	Catchment 2b		Junction	
1.000_1	Catchment 3a	Junction	Catchment 3b		Junction	
1.001_1	Catchment 3b	Junction	Catchment 3c		Junction	
4.000	Catchment 4	Junction	Catchment 5		Junction	
5.000	Catchment 9	Junction	2	1200	Manhole	Adoptable

Manhole Schedule

Node	Easting (m)	Northing (m)	CL (m)	Depth (m)	Dia (mm)	Connections	Link	IL (m)	Dia (mm)
Catchment 1a	-92.158	100.836	74.350	2.300		<div><div></div><div>0</div></div>	1.000	72.050	600

Manhole Schedule

Node	Easting (m)	Northing (m)	CL (m)	Depth (m)	Dia (mm)	Connections	Link	IL (m)	Dia (mm)
Catchment 1b	-93.671	70.218	74.300	2.300		 1	1.000	72.000	600
Catchment 2a	-92.916	37.295	73.300	2.300		 0	2.000	71.000	600
Catchment 2b	-92.626	22.671	73.250	2.300		 1	2.000	70.950	600
Catchment 3a	-65.281	7.280	74.550	2.300		 0	1.000_1	72.250	600
Catchment 3b	-65.281	-8.329	74.500	2.300		 1	1.000_1	72.200	600
Catchment 3c	-65.484	-22.137	74.450	2.300		 0	1.001_1	72.200	600
Catchment 4	-36.265	-57.268	67.500	2.000		 0	1.001_1	72.150	600
Catchment 5	-8.464	-60.549	66.000	1.300		 0	4.000	65.500	365
Catchment 6	1.763	-39.130	70.000	3.200		 1	4.000	64.700	365
Catchment 7	18.165	-40.189	67.000	3.200		 0			
Catchment 8	29.356	-65.759	62.000	1.300		 0			
Catchment 9	98.244	-74.249	54.000	1.650		 0			
2	111.190	-87.933	53.000	0.967	1200	 1	5.000	52.350	450
						 1	5.000	52.033	450

Simulation Settings

Rainfall Methodology	FEH-22	Winter CV	0.840	Drain Down Time (mins)	240	Check Discharge Rate(s)	x
Rainfall Events	Singular	Analysis Speed	Normal	Additional Storage (m³/ha)	20.0	Check Discharge Volume	✓
Summer CV	0.750	Skip Steady State	x	Starting Level (m)		100 year 360 minute (m³)	21256

Storm Durations

15	60	180	360	600	960	2160	4320	7200	10080
30	120	240	480	720	1440	2880	5760	8640	

Return Period (years)	Climate Change (CC %)	Additional Area (A %)	Additional Flow (Q %)	Return Period (years)	Climate Change (CC %)	Additional Area (A %)	Additional Flow (Q %)
100	25	0	0	100	40	0	0

Pre-development Discharge Volume

Site Makeup	Greenfield	Soil Index	4	Return Period (years)	100	Betterment (%)	0
Greenfield Method	FSR/FEH	SPR	0.45	Climate Change (%)	0	PR	0.428
Positively Drained Area (ha)	69.160	CWI	95.852	Storm Duration (mins)	360	Runoff Volume (m³)	21256

Node Catchment 1b Offline Orifice Control

Flap Valve	x	Invert Level (m)	72.000	Design Flow (l/s)	95.0	Discharge Coefficient	0.600
Loop to Node	Catchment 2a	Design Depth (m)	2.100	Diameter (m)	0.179		

Node Catchment 2b Offline ACO Q-Brake Control

Flap Valve	x	Invert Level (m)	70.950	Design Flow (l/s)	42.9	Min Node Diameter (mm)	1500
Loop to Node	Catchment 4	Design Depth (m)	2.200	Min Outlet Diameter (m)	0.295	Orifice Diameter (m)	0.235

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	3543.0	0.0	2.300	5311.3	0.0

Node Catchment 3b Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	72.200
Side Inf Coefficient (m/hr)	0.00000	Porosity	1.00	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	2704.4	0.0	2.300	4207.3	0.0

Node Catchment 3c Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	72.150
Side Inf Coefficient (m/hr)	0.00000	Porosity	1.00	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	2138.0	0.0	2.300	3551.7	0.0

Node Catchment 4 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	65.500
Side Inf Coefficient (m/hr)	0.00000	Porosity	1.00	Time to half empty (mins)	0

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	229.6	0.0	2.000	1765.8	0.0

Node Catchment 5 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	64.700
Side Inf Coefficient (m/hr)	0.00000	Porosity	1.00	Time to half empty (mins)	240

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	471.1	0.0	1.300	1621.6	0.0

Node Catchment 6 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	66.800
Side Inf Coefficient (m/hr)	0.00000	Porosity	0.95	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	2240.0	0.0	2.000	2240.0	0.0	2.001	0.0	0.0

Node Catchment 7 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	63.800
Side Inf Coefficient (m/hr)	0.00000	Porosity	0.95	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	6300.0	0.0	2.000	6300.0	0.0	2.001	0.0	0.0

Node Catchment 8 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	60.700
Side Inf Coefficient (m/hr)	0.00000	Porosity	1.00	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	928.4	0.0	1.300	2120.6	0.0

Node Catchment 9 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	52.500
Side Inf Coefficient (m/hr)	0.00000	Porosity	1.00	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	263.8	0.0	1.500	1094.5	0.0

Rainfall

Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)	Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)
100 year +25% CC 15 minute summer	454.119	128.500	100 year +25% CC 60 minute winter	133.213	52.988
100 year +25% CC 15 minute winter	318.680	128.500	100 year +25% CC 120 minute summer	125.655	33.207
100 year +25% CC 30 minute summer	298.680	84.516	100 year +25% CC 120 minute winter	83.482	33.207
100 year +25% CC 30 minute winter	209.600	84.516	100 year +25% CC 180 minute summer	97.319	25.044
100 year +25% CC 60 minute summer	200.508	52.988	100 year +25% CC 180 minute winter	63.260	25.044

Rainfall

Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)	Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)
100 year +25% CC 240 minute summer	77.003	20.350	100 year +40% CC 60 minute winter	149.198	59.347
100 year +25% CC 240 minute winter	51.159	20.350	100 year +40% CC 120 minute summer	140.733	37.192
100 year +25% CC 360 minute summer	58.156	14.966	100 year +40% CC 120 minute winter	93.500	37.192
100 year +25% CC 360 minute winter	37.803	14.966	100 year +40% CC 180 minute summer	108.998	28.049
100 year +25% CC 480 minute summer	45.007	11.894	100 year +40% CC 180 minute winter	70.851	28.049
100 year +25% CC 480 minute winter	29.902	11.894	100 year +40% CC 240 minute summer	86.244	22.792
100 year +25% CC 600 minute summer	36.154	9.889	100 year +40% CC 240 minute winter	57.298	22.792
100 year +25% CC 600 minute winter	24.703	9.889	100 year +40% CC 360 minute summer	65.135	16.761
100 year +25% CC 720 minute summer	31.615	8.473	100 year +40% CC 360 minute winter	42.339	16.761
100 year +25% CC 720 minute winter	21.247	8.473	100 year +40% CC 480 minute summer	50.408	13.321
100 year +25% CC 960 minute summer	25.048	6.596	100 year +40% CC 480 minute winter	33.490	13.321
100 year +25% CC 960 minute winter	16.592	6.596	100 year +40% CC 600 minute summer	40.493	11.076
100 year +25% CC 1440 minute summer	17.118	4.588	100 year +40% CC 600 minute winter	27.667	11.076
100 year +25% CC 1440 minute winter	11.505	4.588	100 year +40% CC 720 minute summer	35.408	9.490
100 year +25% CC 2160 minute summer	11.504	3.179	100 year +40% CC 720 minute winter	23.797	9.490
100 year +25% CC 2160 minute winter	7.927	3.179	100 year +40% CC 960 minute summer	28.054	7.387
100 year +25% CC 2880 minute summer	9.170	2.458	100 year +40% CC 960 minute winter	18.583	7.387
100 year +25% CC 2880 minute winter	6.163	2.458	100 year +40% CC 1440 minute summer	19.172	5.138
100 year +25% CC 4320 minute summer	6.620	1.731	100 year +40% CC 1440 minute winter	12.885	5.138
100 year +25% CC 4320 minute winter	4.360	1.731	100 year +40% CC 2160 minute summer	12.884	3.561
100 year +25% CC 5760 minute summer	5.332	1.365	100 year +40% CC 2160 minute winter	8.878	3.561
100 year +25% CC 5760 minute winter	3.451	1.365	100 year +40% CC 2880 minute summer	10.271	2.753
100 year +25% CC 7200 minute summer	4.508	1.150	100 year +40% CC 2880 minute winter	6.903	2.753
100 year +25% CC 7200 minute winter	2.909	1.150	100 year +40% CC 4320 minute summer	7.415	1.939
100 year +25% CC 8640 minute summer	3.954	1.009	100 year +40% CC 4320 minute winter	4.883	1.939
100 year +25% CC 8640 minute winter	2.552	1.009	100 year +40% CC 5760 minute summer	5.972	1.529
100 year +25% CC 10080 minute summer	3.566	0.910	100 year +40% CC 5760 minute winter	3.865	1.529
100 year +25% CC 10080 minute winter	2.301	0.910	100 year +40% CC 7200 minute summer	5.049	1.288
100 year +40% CC 15 minute summer	508.613	143.920	100 year +40% CC 7200 minute winter	3.258	1.288
100 year +40% CC 15 minute winter	356.922	143.920	100 year +40% CC 8640 minute summer	4.428	1.130
100 year +40% CC 30 minute summer	334.522	94.658	100 year +40% CC 8640 minute winter	2.858	1.130
100 year +40% CC 30 minute winter	234.752	94.658	100 year +40% CC 10080 minute summer	3.993	1.019
100 year +40% CC 60 minute summer	224.569	59.347	100 year +40% CC 10080 minute winter	2.577	1.019

Results for 100 year +25% CC Critical Storm Duration. Lowest mass balance: 99.97%

Node Event	US Node	Peak (mins)	Level (m)	Depth (m)	Inflow (l/s)	Node Vol (m³)	Flood (m³)	Status
720 minute winter	Catchment 1a	705	73.876	1.826	1123.7	8736.5840	0.0000	SURCHARGED
720 minute winter	Catchment 1b	720	73.870	1.870	573.4	8816.1990	0.0000	OK
7200 minute winter	Catchment 2a	7200	72.721	1.721	84.1	4959.4740	0.0000	SURCHARGED
7200 minute winter	Catchment 2b	7200	72.721	1.771	59.2	3506.6700	0.0000	OK
1440 minute winter	Catchment 3a	1440	73.837	1.587	520.9	6859.2290	0.0000	SURCHARGED
1440 minute winter	Catchment 3b	1440	73.837	1.637	315.5	5308.3870	0.0000	SURCHARGED
1440 minute winter	Catchment 3c	1440	73.837	1.687	163.2	4485.4600	0.0000	OK
720 minute winter	Catchment 4	675	66.311	0.811	109.1	445.7053	0.0000	SURCHARGED
1440 minute winter	Catchment 5	1440	65.328	0.628	90.1	475.3204	0.0000	OK
1440 minute winter	Catchment 6	1440	68.564	1.764	125.0	3804.9970	0.0000	OK
960 minute winter	Catchment 7	960	65.568	1.768	516.7	10727.3500	0.0000	OK
960 minute winter	Catchment 8	930	61.308	0.608	130.1	740.7857	0.0000	OK
720 minute winter	Catchment 9	705	53.467	1.117	152.2	527.6341	0.0000	SURCHARGED
15 minute summer	2	1	52.033	0.000	114.4	0.0000	0.0000	OK

Link Event (Upstream Depth)	US Node	Link	DS Node	Outflow (l/s)	Velocity (m/s)	Flow/Cap	Link Vol (m³)	Discharge Vol (m³)
720 minute winter	Catchment 1a	1.000	Catchment 1b	545.5	2.263	1.956	8.4503	
720 minute winter	Catchment 1b	Orifice	Catchment 2a	89.3				3545.9
7200 minute winter	Catchment 2a	2.000	Catchment 2b	57.6	1.096	0.184	6.7603	
7200 minute winter	Catchment 2b	ACO Q-Brake	Catchment 4	42.9				13230.6
1440 minute winter	Catchment 3a	1.000_1	Catchment 3b	304.2	1.669	0.974	6.7603	
1440 minute winter	Catchment 3b	1.001_1	Catchment 3c	153.7	1.692	0.491	6.7321	
1440 minute winter	Catchment 3c	ACO Q-Brake	Catchment 4	33.4				2383.2
720 minute winter	Catchment 4	ACO Q-Brake	Catchment 5	77.6				
1440 minute winter	Catchment 5	Hydro-Brake®	Catchment 8	78.4				5948.9
1440 minute winter	Catchment 6	ACO Q-Brake	Catchment 5	7.7				598.9
960 minute winter	Catchment 7	ACO Q-Brake	Catchment 8	25.4				1431.6
960 minute winter	Catchment 8	Hydro-Brake®	Catchment 9	105.0				5708.9
720 minute winter	Catchment 9	Hydro-Brake®	2	114.4				4938.7

Results for 100 year +40% CC Critical Storm Duration. Lowest mass balance: 99.97%

Node Event	US Node	Peak (mins)	Level (m)	Depth (m)	Inflow (l/s)	Node Vol (m³)	Flood (m³)	Status
720 minute winter	Catchment 1a	705	74.071	2.021	1258.7	9898.3300	0.0000	FLOOD RISK
720 minute winter	Catchment 1b	720	74.064	2.064	632.2	9899.9390	0.0000	OK
7200 minute winter	Catchment 2a	7260	72.890	1.890	90.3	5547.9100	0.0000	SURCHARGED
7200 minute winter	Catchment 2b	7260	72.889	1.939	61.2	3926.4500	0.0000	OK
1440 minute winter	Catchment 3a	1440	74.016	1.766	583.4	7754.9880	0.0000	SURCHARGED
1440 minute winter	Catchment 3b	1440	74.016	1.816	351.0	5995.3960	0.0000	SURCHARGED
1440 minute winter	Catchment 3c	1440	74.016	1.866	178.9	5064.2690	0.0000	OK
720 minute winter	Catchment 4	705	66.426	0.926	114.4	549.3162	0.0000	SURCHARGED
2160 minute winter	Catchment 5	1980	65.378	0.678	87.5	527.7742	0.0000	OK
1440 minute winter	Catchment 6	1440	68.793	1.993	140.0	4298.7390	0.0000	OK
1440 minute winter	Catchment 7	1440	65.794	1.994	401.2	12100.0800	0.0000	OK
960 minute winter	Catchment 8	960	61.378	0.678	132.6	849.1179	0.0000	OK
480 minute winter	Catchment 9	464	53.537	1.187	180.5	585.4462	0.0000	SURCHARGED
15 minute summer	2	1	52.033	0.000	114.4	0.0000	0.0000	OK

Link Event (Upstream Depth)	US Node	Link	DS Node	Outflow (l/s)	Velocity (m/s)	Flow/Cap	Link Vol (m³)	Discharge Vol (m³)
720 minute winter	Catchment 1a	1.000	Catchment 1b	601.0	2.363	2.154	8.4503	
720 minute winter	Catchment 1b	Orifice	Catchment 2a	94.0				3750.1
7200 minute winter	Catchment 2a	2.000	Catchment 2b	59.3	1.108	0.190	6.7603	
7200 minute winter	Catchment 2b	ACO Q-Brake	Catchment 4	42.9				13671.0
1440 minute winter	Catchment 3a	1.000_1	Catchment 3b	338.3	1.761	1.083	6.7603	
1440 minute winter	Catchment 3b	1.001_1	Catchment 3c	168.2	1.714	0.537	6.7321	
1440 minute winter	Catchment 3c	ACO Q-Brake	Catchment 4	33.4				2480.1
720 minute winter	Catchment 4	ACO Q-Brake	Catchment 5	77.6				
2160 minute winter	Catchment 5	Hydro-Brake®	Catchment 8	78.4				8602.5
1440 minute winter	Catchment 6	ACO Q-Brake	Catchment 5	7.7				627.1
1440 minute winter	Catchment 7	ACO Q-Brake	Catchment 8	25.4				2061.8
960 minute winter	Catchment 8	Hydro-Brake®	Catchment 9	105.0				5782.7
480 minute winter	Catchment 9	Hydro-Brake®	2	114.4				3914.5

Appendix 9: A42 Culvert Capacity Review

Job No. 220500	Doc No. EMG2-BWB-ZZ-XX-T-W_0009	Rev. P02	Page Page 1
Project East Midlands Gateway Phase 2		Date Prepared 24/03/25	Prepared by Robin Green
Title A42 Culvert Capacity Review			Authorised by Claire Gardner

Introduction

The note has been prepared to provide further information in respect to a number of flood risk and drainage related comments raised in the Environment Agency's (EA) scoping opinion of the proposed East Midlands Gateway Phase 2 scheme.

Specifically, the note provides further information relating to the culvert that flows from north to south at the toe of the A42 highway embankment between the EMG2 Works and the Diseworth Brook. In the returned scoping opinion, the EA state: *"The Drainage Report should assess if there is sufficient capacity within the piped connection alongside the A42 and consider the risk of blockage and how this would be managed."*

This note is based upon the emerging Development Proposals, that are still subject to change.

Existing Arrangements

The EMG2 Works currently falls towards the Hall Brook and the village of Diseworth in the west and the Diseworth Brook in the south. Hyam's Lane, which bisects the site diagonally from the south-west to north-east, is located on the approximate alignment of the catchment break. The generalised topography of the area is illustrated within **Figure 1**.

Ground Investigation completed by Fairhurst has identified that the EMG2 Works is underlain by clayey soils with very poor infiltration rates. During a storm event, when the very limited infiltration capacity of the soils is exceeded, surface water runoff will follow the fall on the topography and flow overland towards the receiving watercourses. To the south of Hyam's Lane a number of field drains/ditches are present that help to intercept and direct overland flows towards the south-eastern corner of the Site. A culvert provides ongoing connectivity beneath Long Holden (a footpath/track located off the southern boundary), and after a very short open reach flows enter a culvert that runs at the toe of the A42 embankment.

Using the emerging parameters plan for the EMG2 Works, the approximate development area (84ha) and likely impermeable area (69.6ha) have been calculated. Approximately 61% of the developable area is located with the catchment that is currently drained to the A42 culvert – which equates to an impermeable area of 42.4ha. The HR Wallingford UK SUDS greenfield runoff tool was used to estimate the equivalent greenfield runoff rate from the future impermeable area within the current A42 culvert catchment. The rates are summarised within **Table 1**.

Table 1 – Greenfield Runoff Rates

Return Period Storm (yrs)	FEH Runoff Rate (l/s/ha)	Equivalent Runoff Rate from the Total Estimated EMG2 Imp. Area: 69.6ha (l/s)	Equivalent Runoff Rate from the Estimated EMG2 Imp. Area Proposed within the Existing A42 Catchment: 42.4ha (l/s)
1 in 1	2.7	187.9	114.4
Annual Average Runoff Rate (QBAR)	3.3	229.7	139.9
1 in 30	6.6	459.4	279.8
1 in 100	8.4	612.5	373.1
1 in 100+25%	10.5	730.8	445.2
1 in 100+40%	11.8	821.3	500.3

Job No. 220500	Doc No. EMG2-BWB-ZZ-XX-T-W_0009	Rev. P02	Page Page 2
Project East Midlands Gateway Phase 2		Date Prepared 24/03/25	Prepared by Robin Green
Title A42 Culvert Capacity Review			Authorised by Claire Gardner

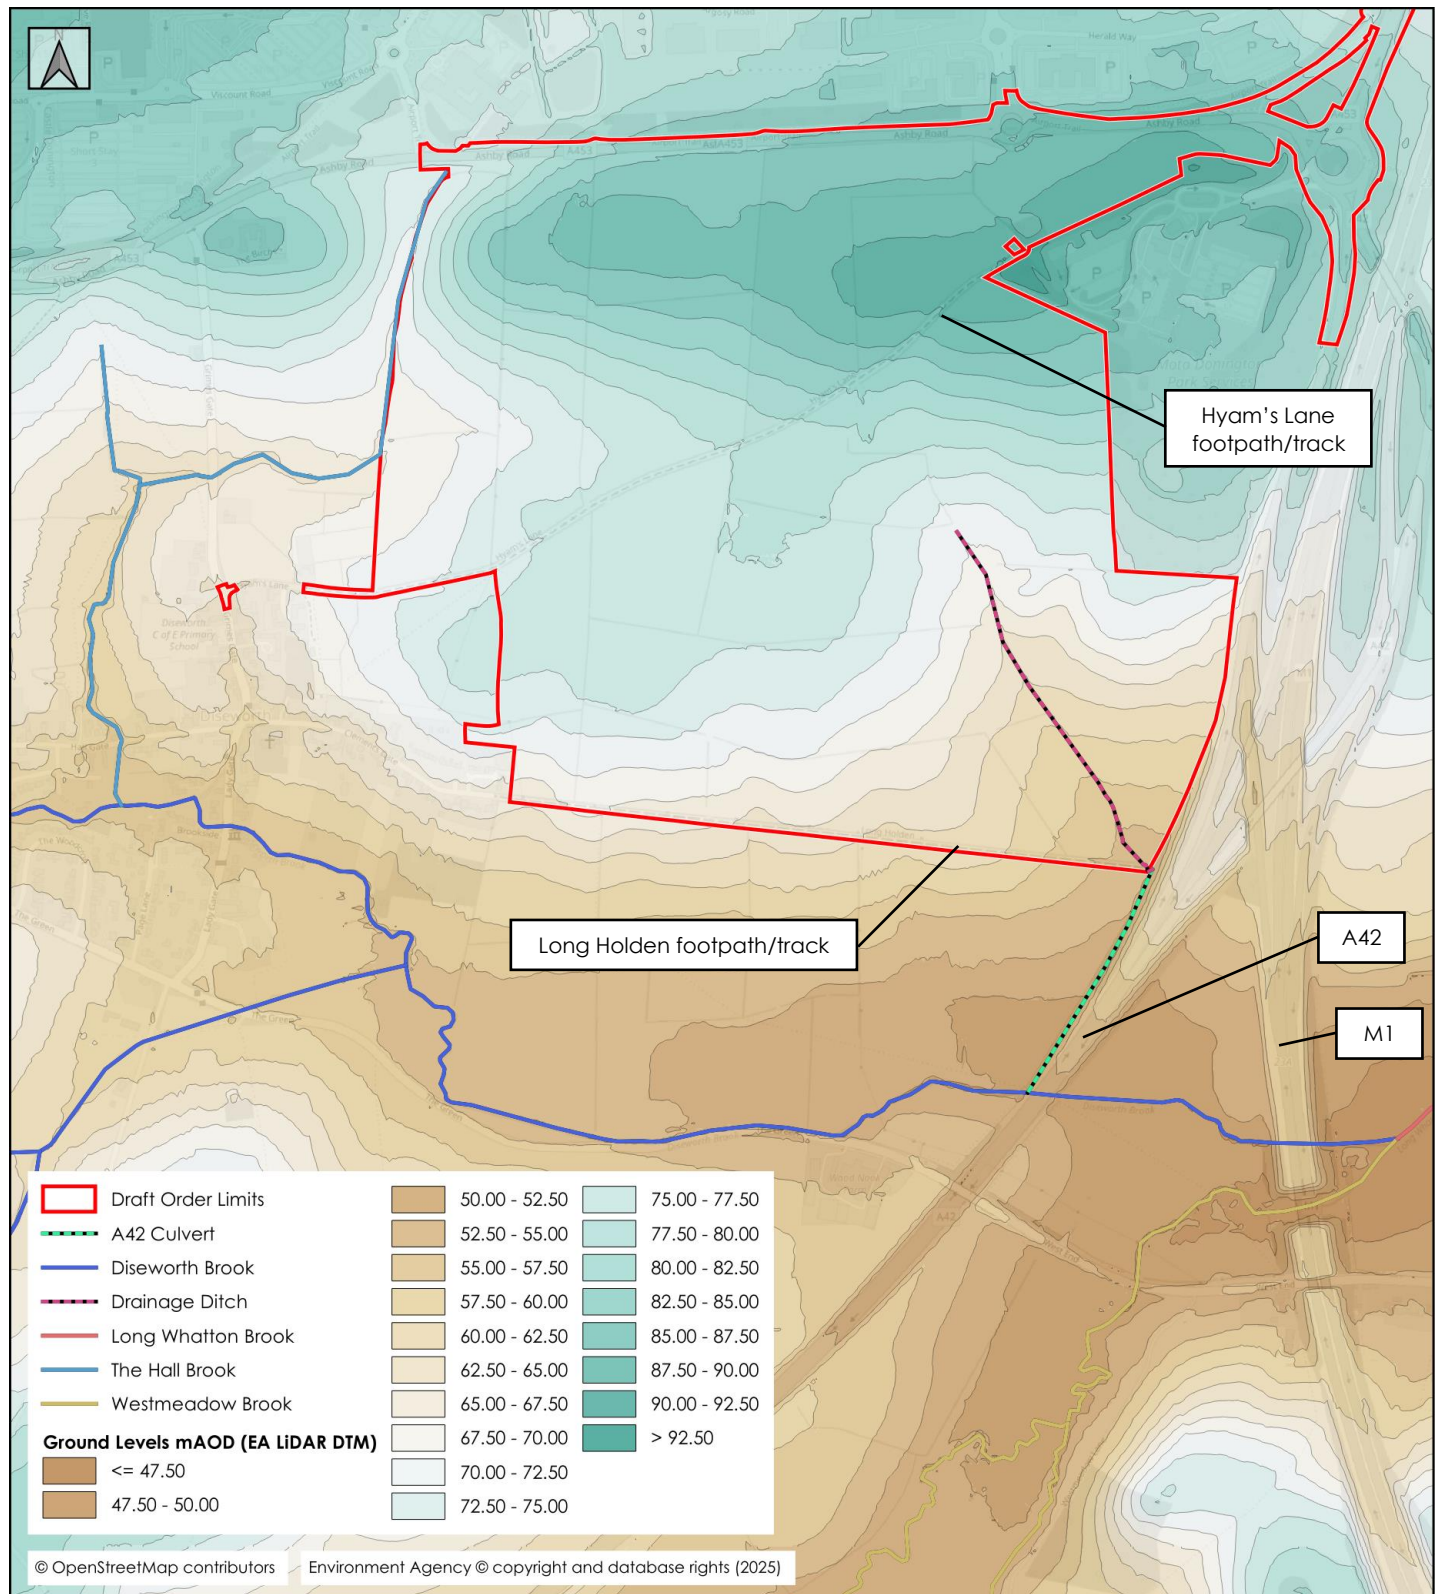


Figure 1 – Generalised Topography at EMG2 Main Site

Job No. 220500	Doc No. EMG2-BWB-ZZ-XX-T-W_0009	Rev. P02	Page Page 3
Project East Midlands Gateway Phase 2		Date Prepared 24/03/25	Prepared by Robin Green
Title A42 Culvert Capacity Review			Authorised by Claire Gardner

A CCTV survey of the downstream A42 culvert connectivity has been completed. The survey has shown that:

- To reach the A42 culvert the runoff from the area first passes beneath the Long Holden footpath/track within a 500dia pipe laid at 1:30 – using the Colebrook-White equation a pipe full capacity of 780l/s can be estimated.
- After passing beneath the track, flows enter a 525dia pipe laid at roughly 1:7 – this has a pipe full capacity of 1840l/s
- A 700dia pipe then runs at the toe of the A42 embankment eventually outfalling to the Diseworth Brook. This has an average gradient of 1:100 – this has a pipe full capacity of 1030l/s.

Proposed Arrangements

The scheme proposes to maintain a connection for the disposal of surface water runoff from the development to the A42 culvert.

In paragraph 59 of the Department for Transport (DfT) Circular 01/2022 and written into the DMRB (CG 501 paragraph 6.3.1) it is stated that where there is already an existing informal or formal connection into the highway drainage system from a proposed development site, the right for a connection may be allowed to continue provided that the flow, rate and quality of the discharge into the highway drainage system remains unaltered or results in a betterment.

Therefore, the discharge rate into the culvert from the development will be restricted to the equivalent 1 in 1-year greenfield rate from the proposed impermeable area that will be located within the current A42 catchment – a rate of 114.4l/s. Additionally, the surface water runoff from the development will receive treatment prior to be discharged. Therefore, the relevant requirements of DfT Circular 01/2022 will be fulfilled.

The proposed peak discharge rate of 114.4/s is well below the downstream pipe capacity and below the existing contributing runoff from the site at larger storms (see **Table 2**). Therefore, it is concluded that there is sufficient capacity within the existing A42 culvert, and that scheme will reduce flows in the culvert in most large storm events.

Table 2 – Greenfield Runoff Rates

Return Period Storm (yrs)	Equivalent Greenfield Runoff Rate from the Estimated EMG2 Imp. Area Proposed within the Existing A42 Catchment (l/s)	Proposed Discharge Rate to the A42 Culvert (l/s)	Percentage Change in Peak Flow to the A42 Culvert
1 in 1	114.4	114.4	0%
Annual Average Runoff Rate (QBAR)	139.9	114.4	-18%
1 in 30	279.8	114.4	-59%
1 in 100	373.1	114.4	-69%
1 in 100+25%	445.2	114.4	-74%
1 in 100+40%	500.3	114.4	-77%

Risk of Blockage

During a site visit it was observed that debris can accumulate at the inlet to the A42 culvert. In the event of blockage, surface water would follow the fall of the topography (see **Figure 1**) and flow southwards at the toe of the A42 highway embankment (over the top of the A42 culvert) before outfalling to the Diseworth Brook just upstream of the culvert outfall.

Job No. 220500	Doc No. EMG2-BWB-ZZ-XX-T-W_0009	Rev. P02	Page Page 4
Project East Midlands Gateway Phase 2		Date Prepared 24/03/25	Prepared by Robin Green
Title A42 Culvert Capacity Review			Authorised by Claire Gardner

It is proposed that the inlet to the A42 pipe will be added to the inspection and maintenance regime of the EMG2 Project to ensure that it is kept in good condition to manage the risk of a potential blockage.

Furthermore, the runoff from the development will be treated to remove sediments and debris, whereas currently runoff from the agriculture fields can freely enter the pipe system transporting debris and sediment.

Therefore, the EMG2 Project is expected to reduce the risk of blockage within the A42 culvert.

Appendix 10: STW Pre-development Enquiry

WONDERFUL ON TAP

SEVERN
TRENT

BWB Consulting
11 Portland Street
Manchester
M1 3HU

Severn Trent Water Ltd
Leicester Water Centre
Gorse Hill
Anstey
Leicester
LE7 7GU

www.stwater.co.uk

25th November 2024

Email:

Network.Solutions@SevernTrent.co.uk

Vijay Tanna

F.A.O: Matthew Bailey

Our ref: **1133992**

Dear Sir/Madam,

Proposed Development: (Upto 24xIndustrial units -20.83l/s)
North and South of Hyams Lane, Long Whatton and Disewoth, Derby
XY:446000;325000

I refer to your 'Development Enquiry Request' in respect of the above named site. Please find enclosed the sewer records that are included in the fee together with the Supplementary Guidance Notes (SGN) which refer to surface water disposal from development sites.

Protective Strip

Sewer records show a public foul rising main running across your development site. The sewer will require a 10m clearance about the pipe's centreline (5m each side). Please note, no planting of trees or construction should take place within these easements.

Sewer records show a public 300 foul water sewer towards the north west of the site. The sewer will require a 10m clearance about the pipe's centreline (5m each side). Please note, no planting of trees or construction should take place within these easements.

Sewer records show a public 375mm surface water sewer towards the south east of the site. The sewer will require a 10m clearance about the pipe's centreline (5m each side). Please note, no planting of trees or construction should take place within these easements.

Due to a change in legislation on 1 October 2011 there may be former private sewers on the site which have transferred to the responsibility of Severn Trent Water Ltd, which are not shown on the statutory sewer records, but are located in your client's land. These sewers would require protective strips of 3 metres either side of the sewer's centreline that we will not allow to be built over. If such sewers are identified to be present on the site, please contact us for further guidance.

Please note: there is no guarantee that you will be able to build over or close to any Severn Trent sewers, and where a diversion is required there is no guarantee that you will be able to undertake those works on a self-lay basis. Every approach to build near to or divert our assets has to be assessed on its own merit and the decision of what is or isn't permissible is taken based on the risk to the asset and the wider catchment it serves. It is vital therefore that you contact us at the earliest opportunity to discuss the implications of our assets crossing your site. Failure to do so could significantly affect the costs and timescales of your project if it transpires diversionary works need to be carried out by Severn Trent.

Foul Water Drainage

The nearest foul sewers are located in the highway to the west of the site on Grimes Gate and nearest mh is SK45243702. It is anticipated the approximate development of such size would generate approx. foul flows of 20.83l/s (2xdwf).

Due to the nature of the development, the additional flows and existing flood and surcharge levels, there is insufficient capacity within the Severn Trent network and insufficient capacity within the receiving pumping station (Diseworth - Ladygate (SPS)) at present and modelling will be required, which may show that improvements are required to the Severn Trent network.

We are undergoing a prioritisation process of all investment requirements and emerging risks from growth on our network and treatment works as we build our plan for the coming Asset Management Plan period (2025-2030) and beyond.

We will pass the details of your site over for consideration and feedback if anything arises which is of concern. We will let you know as soon as possible if anything will affect your connection points and timescales and whether we need to make representation to the Planning Authority to apply conditions relating to phasing or occupation of the site. This will enable us to understand what system improvements are required due to your proposed development drainage scheme.

In the meantime, the site will be added to our modelling tracker and reviewed regularly until the site can be progressed for sewer modelling. I would therefore be grateful if you would forward as soon as possible the following details:

- Confirmation whether a pumped solution is required (please provide pump rate and frequency, if available), all adoptable pump stations must pump min of 3.8l/s minimal
- Anticipated flow rate from the site
- Proposed planned start and completion date
- Any phasing details of the proposed development

- Confirm how many properties will discharge into each of the connections to the public sewer.

All connections are subject to the required Section 106 sewer connection application.

Please note for any discharge of non- domestic flows you will need to also consult with our Trade Effluent team via :

trade.effluent@severntrent.co.uk

Surface Water Drainage

Under the terms of Section H of the Building Regulations 2000, the disposal of surface water by means of soakaways should be considered as the primary method. If these are found to be unsuitable, satisfactory evidence will need to be submitted. The evidence should be either percolation test results or by the submission of a statement from the SI consultant (extract or a supplementary letter).

Subject to above Severn Trent Water expects all surface water from the development to be drained in a sustainable way to the nearest watercourse or land drainage channel, subject to the developer discussing all aspects of the developments surface water drainage with the Local Lead Flood Authority (LLFA). Any discharge rate to a watercourse or drainage ditch will be determined by the LLFA / EA.

Note, STW will have to be satisfied that all sustainable option have been exhausted before allowing discharge to the public network. Please note you must ensure to look in to connecting the SW into any nearby watercourses.

Subject to above, a connection to the 375mm surface water sewer and nearest mh SK4624**6501** running across the east of the site can be considered with flows restricted in line with greenfield run off rates of 5l/s per hectare Therefore, a gravity connection to the public sewer (direct or indirect) is acceptable subject to a formal Section 106 sewer connection approval.

Connections

For any new connections (including the re-use of existing connections) to the public sewerage system, the developer will need to submit a Section 106 application form. Our Developer Services department are responsible for handling all new connections enquiries

WONDERFUL ON TAP

SEVERN

TRENT

and applications. To contact them for an application form and associated guidance notes please call 0800 7076600 or download from www.stwater.co.uk.

Please quote the above reference in any future correspondence (including e-mails) with STW Limited. Please note that Developer Enquiry responses are only valid for 6 months from the date of this letter.

Yours sincerely

Vijay Tanna
Network Solutions
Developer Services

